

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P640566

Luminaire Tested: ML5612LSFL4097FS1E - 592H - 900LM - 2700K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P640566
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-26)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSFL4097FS1E - 592H - 900LM - 2700K
Description: ML56 RR, 40D TIR OPTIC, 5" HAZE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1239.4 lumens
Efficiency: N/A
Efficacy: 93.2 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 13.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P640566
CATALOG NUMBER: ML5612LSFL4097FS1E - 592H - 900LM - 2700K

Luminous Intensity Polar Plot

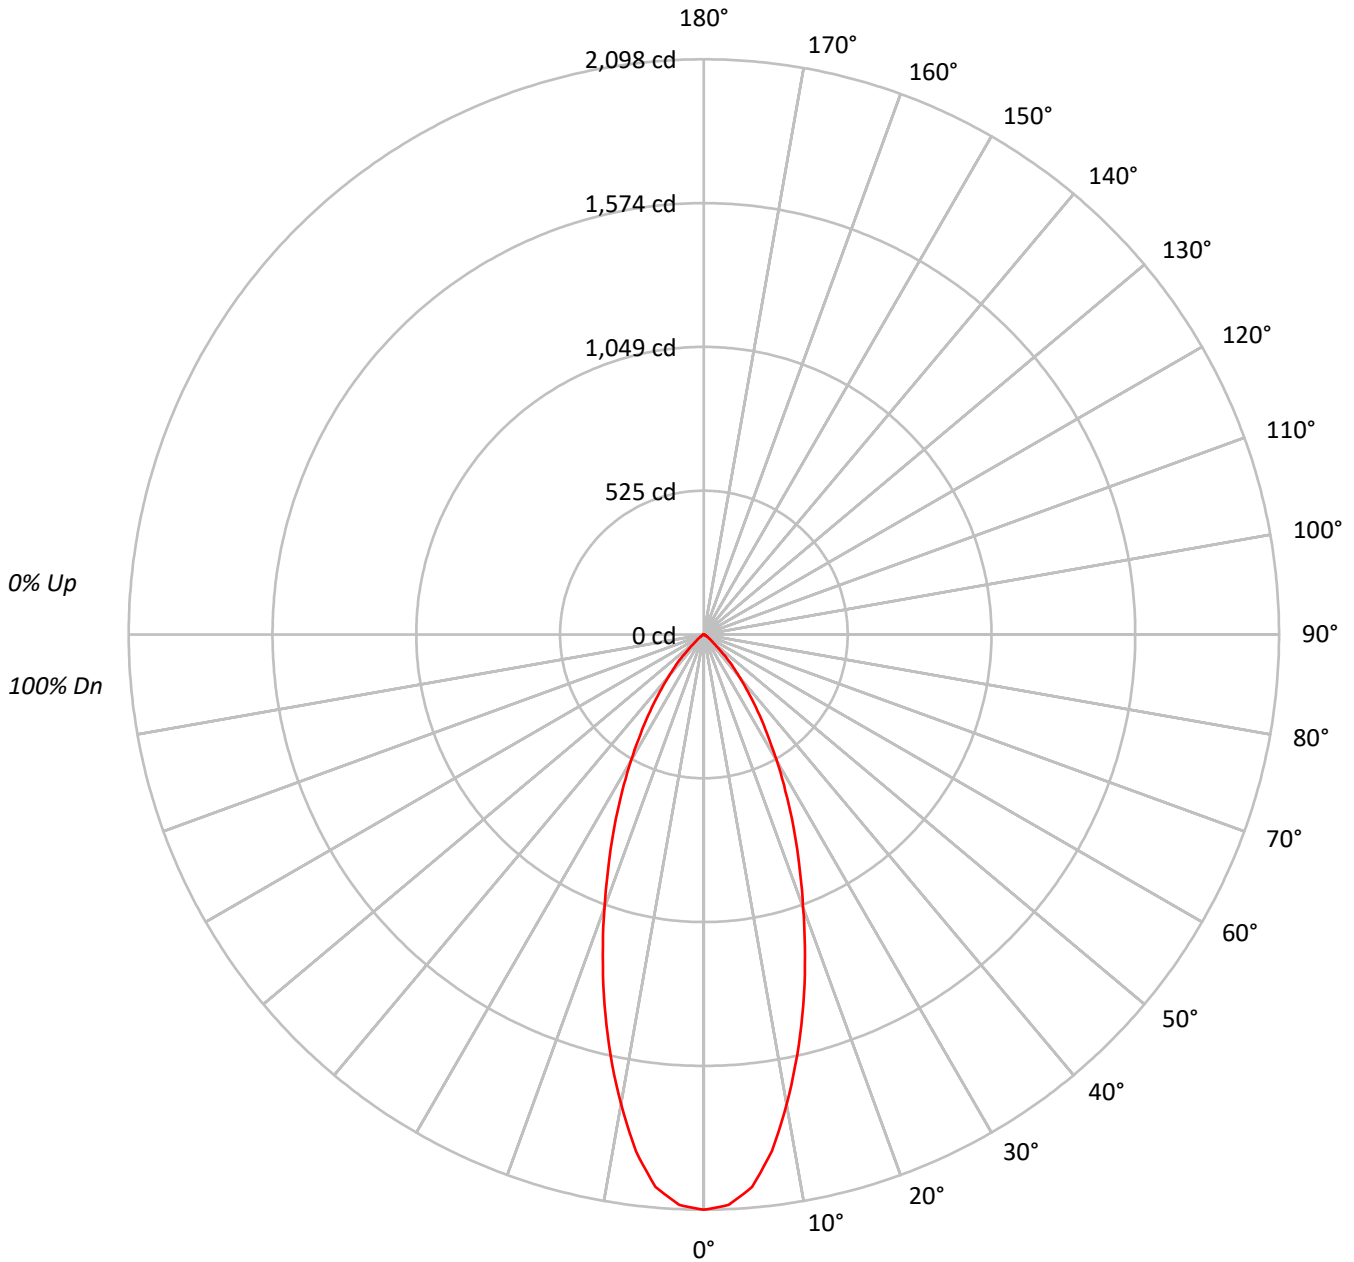



TEST NUMBER: P640566

CATALOG NUMBER: ML5612LSFL4097FS1E - 592H - 900LM - 2700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94					94			
2	108	104	100	97	106	102	99	96	99	96	94	96	94	92	93	91	90	88					88			
3	103	97	92	89	101	96	91	88	93	90	87	91	88	85	89	86	84	82					82			
4	98	91	86	82	97	90	85	81	88	84	80	86	82	80	84	81	79	77					77			
5	94	86	80	76	92	85	80	76	83	79	75	82	78	75	80	77	74	72					72			
6	89	81	75	71	88	80	75	71	79	74	70	77	73	70	76	72	70	68					68			
7	85	77	71	67	84	76	70	67	75	70	66	73	69	66	72	69	66	64					64			
8	82	72	67	63	80	72	67	63	71	66	63	70	65	62	69	65	62	61					61			
9	78	69	63	59	77	68	63	59	67	63	59	67	62	59	66	62	59	57					57			
10	75	65	60	56	74	65	60	56	64	59	56	63	59	56	63	59	56	55					55			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	165626
5°	160292
10°	139492
15°	114400
20°	88905
25°	67190
30°	48329
35°	32910
40°	20466
45°	11209
50°	4151
55°	2409
60°	1374
65°	411
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11209 cd/sqm



TEST NUMBER: P640566

CATALOG NUMBER: ML5612LSFL4097FS1E - 592H - 900LM - 2700K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	183.8	14.8
10°-20°	386.8	31.2
20°-30°	353.6	28.5
30°-40°	215.8	17.4
40°-50°	79.8	6.4
50°-60°	16.8	1.4
60°-70°	2.9	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	924.1	74.6
0°-40°	1139.9	92.0
0°-60°	1236.5	99.8
0°-90°	1239.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1239.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2098	
5°	2023	184
15°	1400	387
25°	771	354
35°	342	216
45°	100	80
55°	18	17
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P640566

CATALOG NUMBER: ML5612LSFL4097FS1E - 592H - 900LM - 2700K

CANDELA DISTRIBUTION (FULL):

	0°
0°	2098.1
2.5°	2082.8
5°	2022.8
7.5°	1900.6
10°	1740.2
12.5°	1572.2
15°	1399.8
17.5°	1226.3
20°	1058.3
22.5°	906.7
25°	771.4
27.5°	644.8
30°	530.2
32.5°	428.8
35°	341.5
37.5°	265.1
40°	198.6
42.5°	150.6
45°	100.4
47.5°	54.6
50°	33.8
52.5°	25.1
55°	17.5
57.5°	12.0
60°	8.7
62.5°	5.5
65°	2.2
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)