

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P640567

Luminaire Tested: ML5612LSFL4097FS1E - 592H - 900LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P640567
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-26)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSFL4097FS1E - 592H - 900LM - 3000K
Description: ML56 RR, 40D TIR OPTIC, 5" HAZE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1274.8 lumens
Efficiency: N/A
Efficacy: 95.8 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 13.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P640567
CATALOG NUMBER: ML5612LSFL4097FS1E - 592H - 900LM - 3000K

Luminous Intensity Polar Plot

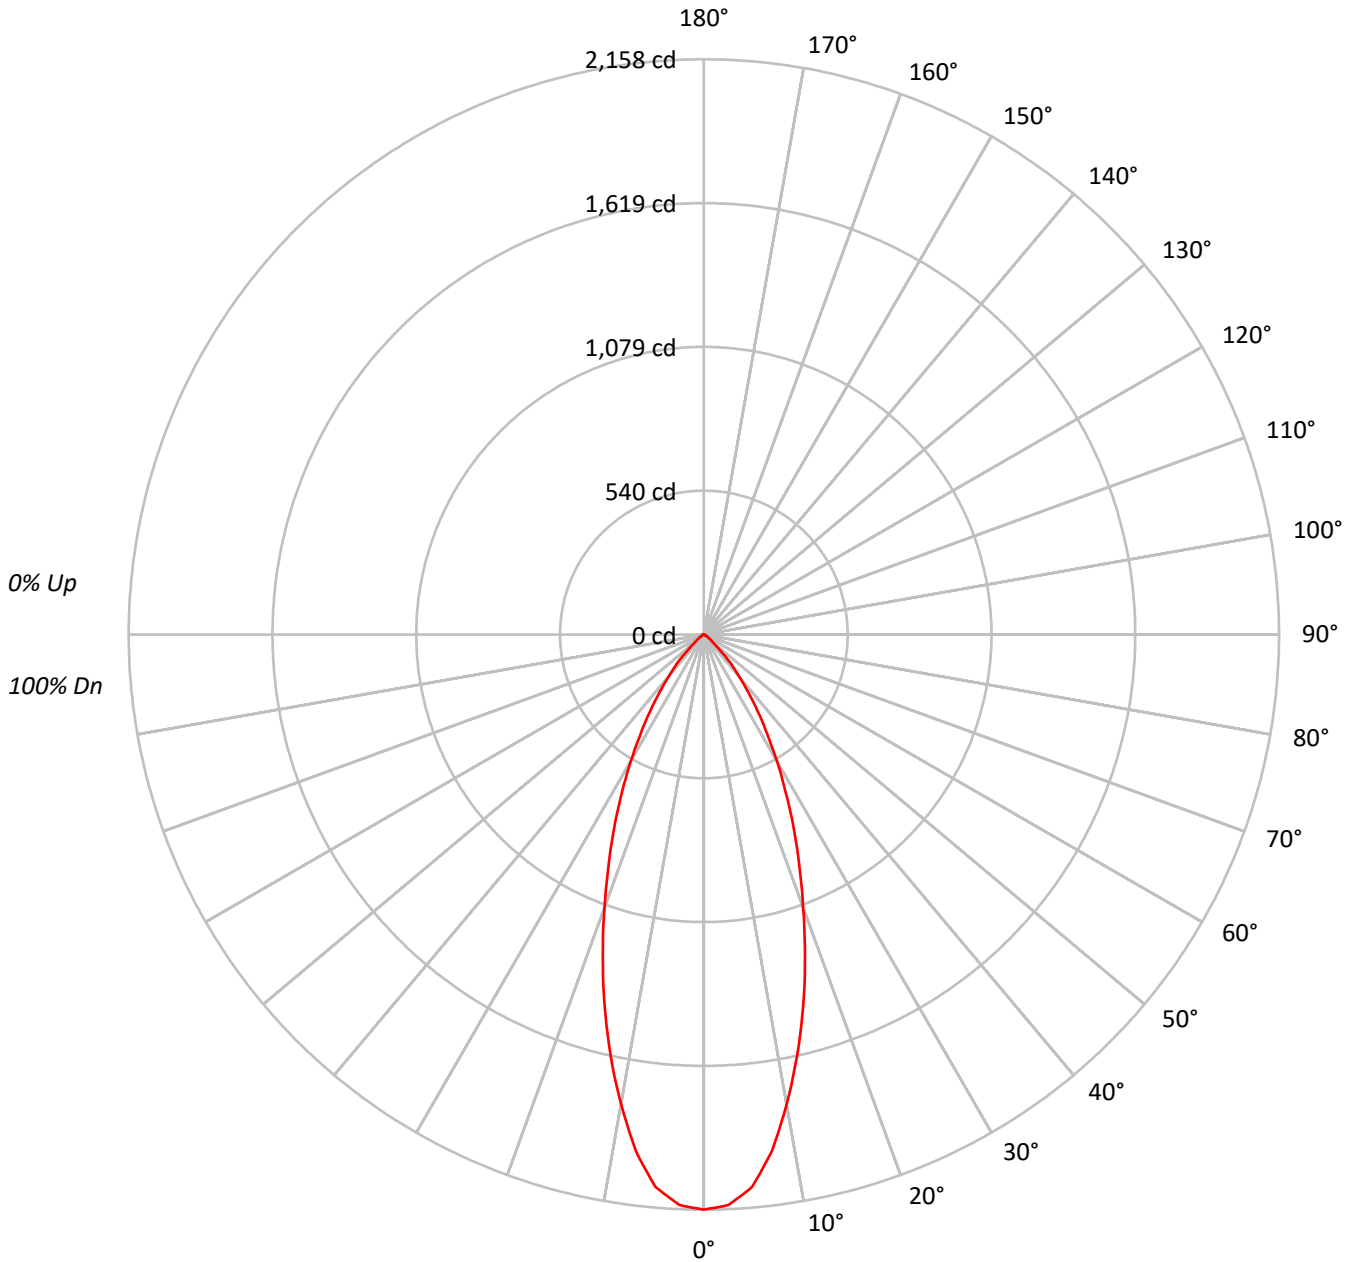



TEST NUMBER: P640567

CATALOG NUMBER: ML5612LSFL4097FS1E - 592H - 900LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	108	104	100	97	106	102	99	96	99	96	94	96	94	92	93	91	90	88			
3	103	97	92	89	101	96	91	88	93	90	87	91	88	85	89	86	84	82			
4	98	91	86	82	97	90	85	81	88	84	80	86	82	80	84	81	79	77			
5	94	86	80	76	92	85	80	76	83	79	75	82	78	75	80	77	74	72			
6	89	81	75	71	88	80	75	71	79	74	70	77	73	70	76	72	70	68			
7	85	77	71	67	84	76	70	67	75	70	66	73	69	66	72	69	66	64			
8	82	72	67	63	80	72	67	63	71	66	63	70	65	62	69	65	62	61			
9	78	69	63	59	77	68	63	59	67	63	59	67	62	59	66	62	59	57			
10	75	65	60	56	74	65	60	56	64	59	56	63	59	56	63	59	56	55			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	170354
5°	164872
10°	143476
15°	117669
20°	91442
25°	69106
30°	49715
35°	33854
40°	21043
45°	11521
50°	4274
55°	2477
60°	1421
65°	411
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11521 cd/sqm



TEST NUMBER: P640567

CATALOG NUMBER: ML5612LSFL4097FS1E - 592H - 900LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.0	14.8
10°-20°	397.8	31.2
20°-30°	363.7	28.5
30°-40°	222.0	17.4
40°-50°	82.1	6.4
50°-60°	17.3	1.4
60°-70°	3.0	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	950.5	74.6
0°-40°	1172.5	92.0
0°-60°	1271.8	99.8
0°-90°	1274.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1274.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2158	
5°	2081	189
15°	1440	398
25°	793	364
35°	351	222
45°	103	82
55°	18	17
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P640567

CATALOG NUMBER: ML5612LSFL4097FS1E - 592H - 900LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	2158.0
2.5°	2142.3
5°	2080.6
7.5°	1954.9
10°	1789.9
12.5°	1617.1
15°	1439.8
17.5°	1261.4
20°	1088.5
22.5°	932.6
25°	793.4
27.5°	663.2
30°	545.4
32.5°	441.0
35°	351.3
37.5°	272.7
40°	204.2
42.5°	154.9
45°	103.2
47.5°	56.1
50°	34.8
52.5°	25.8
55°	18.0
57.5°	12.3
60°	9.0
62.5°	5.6
65°	2.2
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)