

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P640735

Luminaire Tested: ML5612LSFL4097FS1E - 691WB - 900LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P640735
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSFL4097FS1E - 691WB - 900LM - 5000K
Description: ML56 RR, 40D TIR OPTIC, 6" DEADFRONT TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1420.7 lumens
Efficiency: N/A
Efficacy: 106.8 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 13.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P640735
CATALOG NUMBER: ML5612LSFL4097FS1E - 691WB - 900LM - 5000K

Luminous Intensity Polar Plot

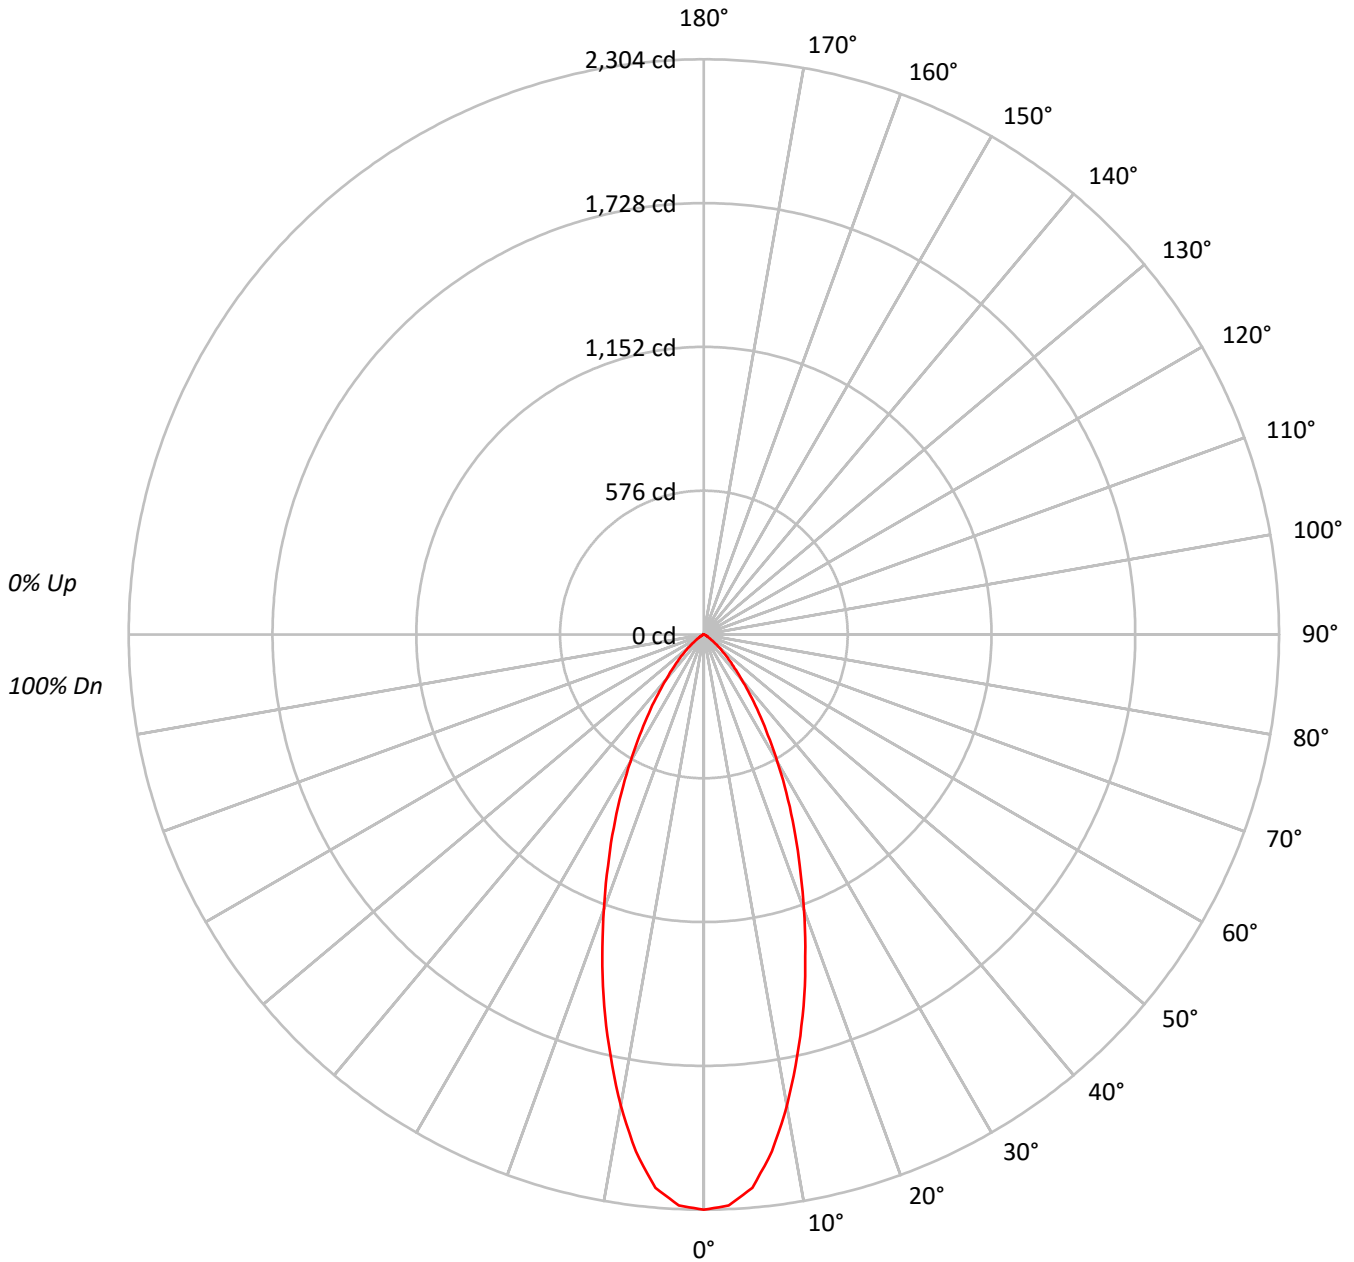



TEST NUMBER: P640735

CATALOG NUMBER: ML5612LSFL4097FS1E - 691WB - 900LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	93	91	89	87			
3	103	96	91	87	101	95	90	87	92	89	85	90	87	84	88	85	83	81			
4	98	90	85	81	96	89	84	80	87	83	79	85	81	78	83	80	77	76			
5	93	85	79	75	91	84	78	74	82	77	74	80	76	73	79	75	72	71			
6	88	80	74	70	87	79	73	69	77	72	69	76	72	68	75	71	68	67			
7	84	75	69	65	83	74	69	65	73	68	65	72	68	64	71	67	64	63			
8	80	71	65	61	79	70	65	61	69	64	61	68	64	61	67	63	60	59			
9	77	67	62	58	76	67	61	58	66	61	57	65	61	57	64	60	57	56			
10	73	64	58	55	72	64	58	55	63	58	54	62	57	54	61	57	54	53			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	126311
5°	122430
10°	106656
15°	87486
20°	68297
25°	51680
30°	37291
35°	25645
40°	16774
45°	10962
50°	6448
55°	3441
60°	1908
65°	1129
70°	593
75°	254
80°	379
85°	755

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 10962 cd/sqm



TEST NUMBER: P640735

CATALOG NUMBER: ML5612LSFL4097FS1E - 691WB - 900LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	202.1	14.2
10°-20°	426.1	30.0
20°-30°	391.6	27.6
30°-40°	243.0	17.1
40°-50°	111.2	7.8
50°-60°	35.0	2.5
60°-70°	9.0	0.6
70°-80°	1.9	0.1
80°-90°	0.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1019.7	71.8
0°-40°	1262.8	88.9
0°-60°	1408.9	99.2
0°-90°	1420.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1420.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2304	
5°	2225	202
15°	1542	426
25°	854	392
35°	383	243
45°	141	111
55°	36	35
65°	9	9
75°	1	2
85°	1	1
90°	0	



TEST NUMBER: P640735

CATALOG NUMBER: ML5612LSFL4097FS1E - 691WB - 900LM - 5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	2304.1
2.5°	2289.2
5°	2224.8
7.5°	2088.3
10°	1916.0
12.5°	1728.7
15°	1541.5
17.5°	1351.7
20°	1170.7
22.5°	1003.3
25°	854.4
27.5°	714.3
30°	589.1
32.5°	477.4
35°	383.2
37.5°	302.6
40°	234.4
42.5°	182.3
45°	141.4
47.5°	104.2
50°	75.6
52.5°	52.1
55°	36.0
57.5°	23.6
60°	17.4
62.5°	12.4
65°	8.7
67.5°	5.0
70°	3.7
72.5°	2.5
75°	1.2
77.5°	1.2
80°	1.2
82.5°	1.2
85°	1.2
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)