

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P640950

Luminaire Tested: ML5612LSNFL2597FS1E - 593BB - 1200LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P640950
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-6)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSNFL2597FS1E - 593BB - 1200LM - 5000K
Description: ML56 RR, 25D TIR OPTIC, 5" BLACK BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1437.9 lumens
Efficiency: N/A
Efficacy: 87.1 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.43
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P640950
CATALOG NUMBER: ML5612LSNFL2597FS1E - 593BB - 1200LM - 5000K

Luminous Intensity Polar Plot

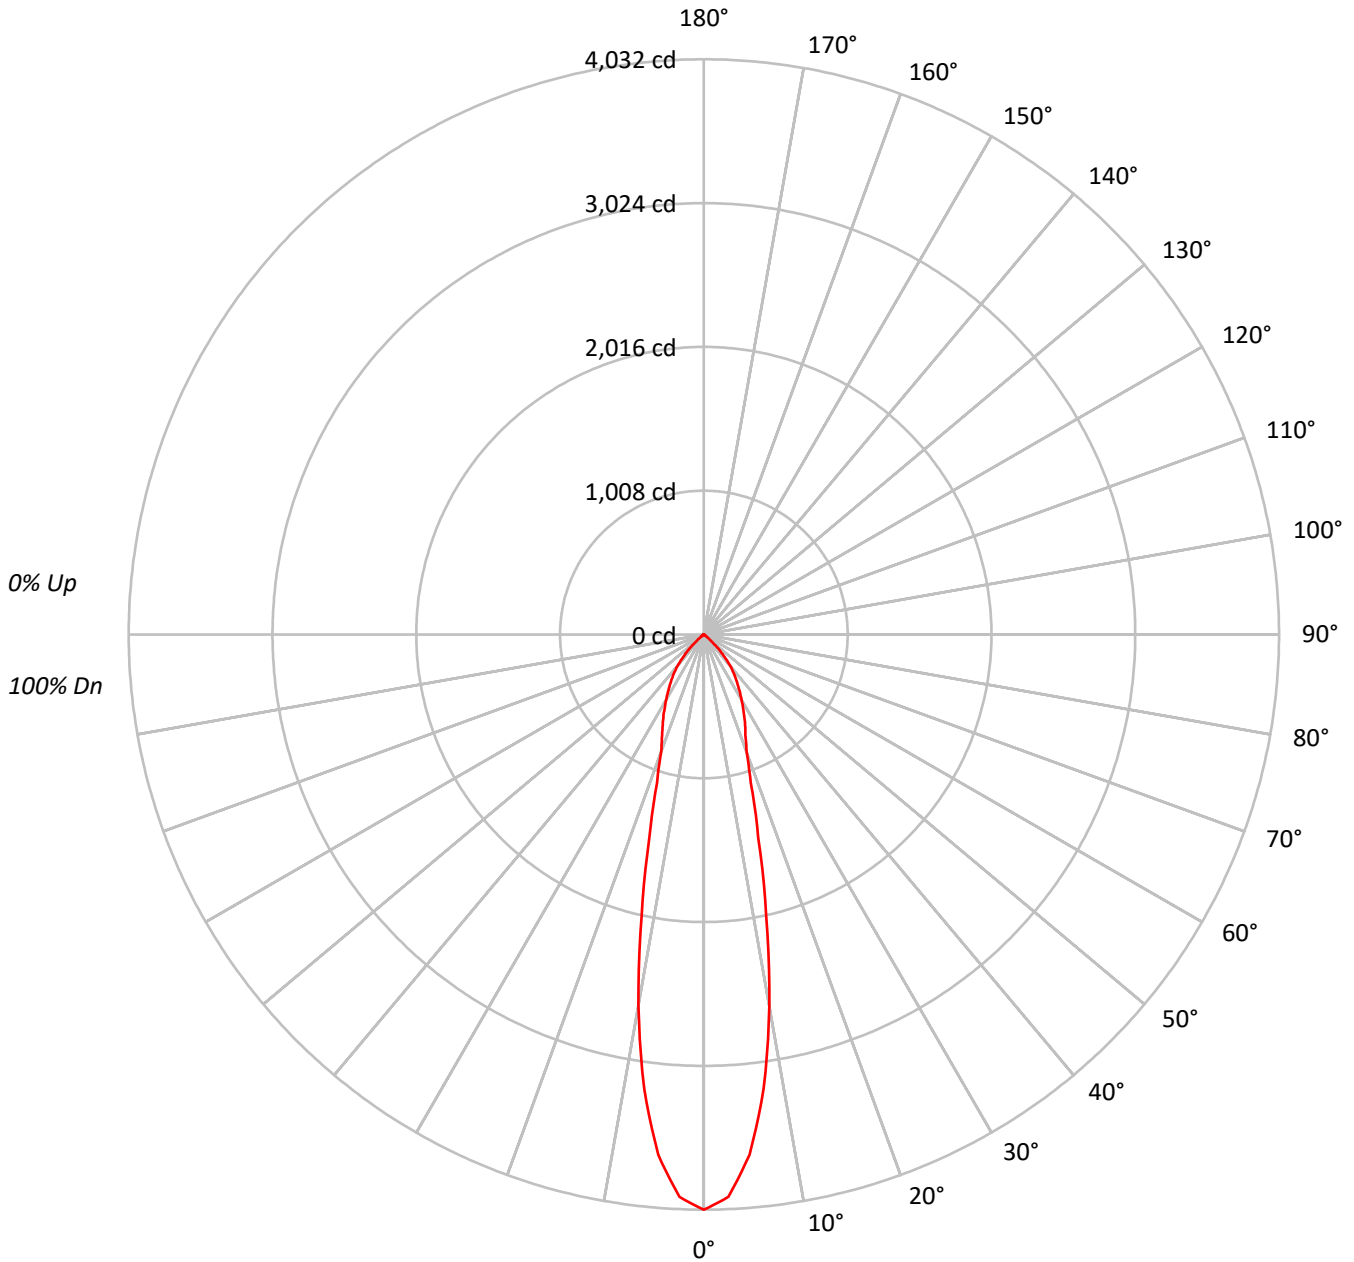



TEST NUMBER: P640950
 CATALOG NUMBER: ML5612LSNFL2597FS1E - 593BB - 1200LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20										
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	114	111	109	107	112	109	107	105	105	104	102	102	100	99	98	97	96	94					94			
2	109	104	101	97	107	103	99	96	99	97	94	96	94	92	94	92	90	89					89			
3	104	98	93	90	102	97	92	89	94	91	88	92	89	86	89	87	85	83					83			
4	99	92	87	83	98	91	86	83	89	85	82	87	84	81	85	82	80	79					79			
5	95	87	82	78	93	86	81	78	85	80	77	83	79	76	81	78	76	74					74			
6	91	83	77	73	89	82	77	73	80	76	72	79	75	72	78	74	72	70					70			
7	87	78	73	69	86	78	73	69	77	72	69	75	71	68	74	71	68	67					67			
8	83	75	69	66	82	74	69	65	73	68	65	72	68	65	71	67	65	63					63			
9	80	71	66	62	79	71	66	62	70	65	62	69	65	62	68	64	62	60					60			
10	77	68	63	59	76	68	63	59	67	62	59	66	62	59	66	62	59	58					58			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	318321
5°	290241
10°	211916
15°	120374
20°	73355
25°	59299
30°	48083
35°	38673
40°	29740
45°	17114
50°	4065
55°	1858
60°	1421
65°	560
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 17114 cd/sqm



TEST NUMBER: P640950

CATALOG NUMBER: ML5612LSNFL2597FS1E - 593BB - 1200LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	316.7	22.0
10°-20°	423.3	29.4
20°-30°	313.0	21.8
30°-40°	251.2	17.5
40°-50°	116.0	8.1
50°-60°	14.3	1.0
60°-70°	3.3	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1053.1	73.2
0°-40°	1304.3	90.7
0°-60°	1434.6	99.8
0°-90°	1437.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1437.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4032	
5°	3663	317
15°	1473	423
25°	681	313
35°	401	251
45°	153	116
55°	14	14
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P640950
CATALOG NUMBER: ML5612LSNFL2597FS1E - 593BB - 1200LM - 5000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	4032.4
2.5°	3946.7
5°	3662.7
7.5°	3211.8
10°	2643.7
12.5°	2018.4
15°	1472.9
17.5°	1091.1
20°	873.2
22.5°	762.0
25°	680.8
27.5°	601.2
30°	527.5
32.5°	461.4
35°	401.3
37.5°	347.2
40°	288.6
42.5°	214.9
45°	153.3
47.5°	84.2
50°	33.1
52.5°	19.5
55°	13.5
57.5°	10.5
60°	9.0
62.5°	4.5
65°	3.0
67.5°	1.5
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)