

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641130

Luminaire Tested: ML5612LSNFL2597FS1E - 693BB - 1200LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641130
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-18)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSNFL2597FS1E - 693BB - 1200LM - 5000K
Description: ML56 RR, 25D TIR OPTIC, 6" BLACK BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1499.7 lumens
Efficiency: N/A
Efficacy: 90.9 lumens/watt
Spacing Criteria (0/90/45): 0.43 / 0.43 / 0.43
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641130
CATALOG NUMBER: ML5612LSNFL2597FS1E - 693BB - 1200LM - 5000K

Luminous Intensity Polar Plot

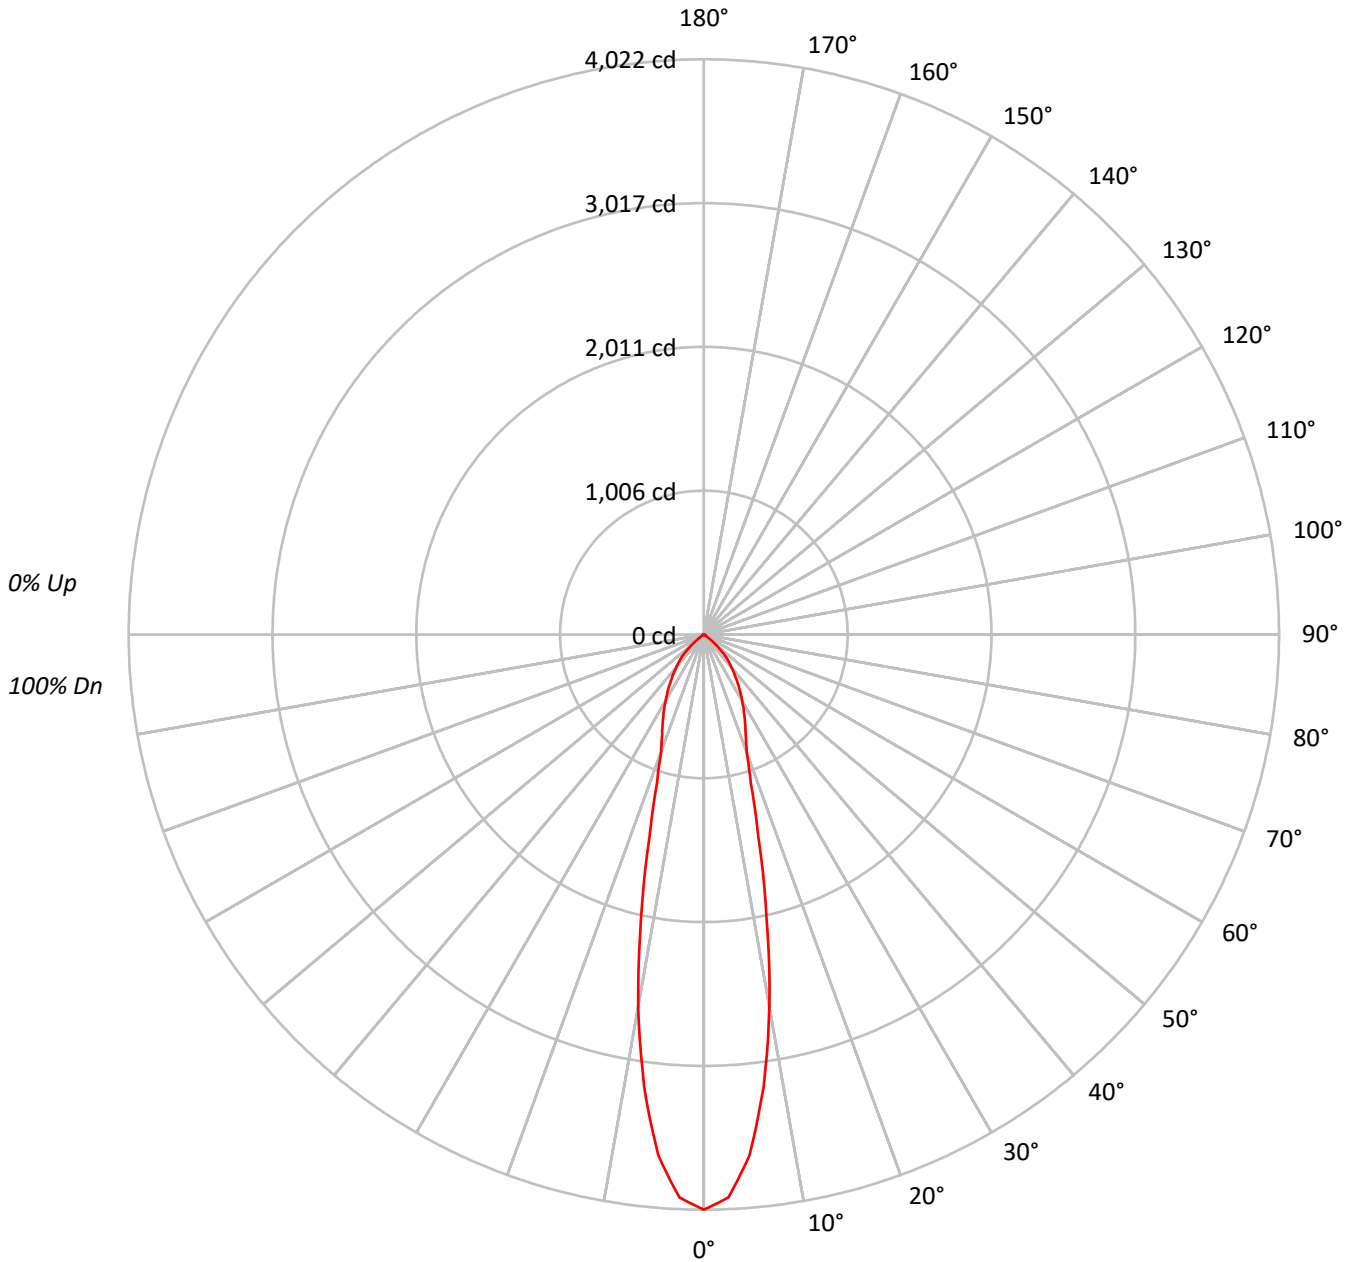



TEST NUMBER: P641130
 CATALOG NUMBER: ML5612LSNFL2597FS1E - 693BB - 1200LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94			94
2	108	104	100	97	106	102	99	96	99	96	94	96	94	92	93	91	90	88			88
3	103	97	92	89	101	96	92	88	93	90	87	91	88	85	89	86	84	82			82
4	98	91	86	82	97	90	85	82	88	84	81	86	83	80	84	81	79	77			77
5	94	86	81	76	92	85	80	76	83	79	75	82	78	75	80	77	74	73			73
6	90	81	76	72	88	80	75	71	79	74	71	78	74	70	76	73	70	69			69
7	86	77	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65			65
8	82	73	68	64	81	73	67	64	72	67	63	71	66	63	70	66	63	62			62
9	79	70	64	60	78	69	64	60	68	64	60	67	63	60	67	63	60	59			59
10	76	67	61	58	75	66	61	57	65	61	57	65	60	57	64	60	57	56			56

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	220481
5°	201144
10°	147080
15°	83678
20°	50941
25°	41271
30°	33872
35°	27358
40°	21619
45°	16428
50°	8332
55°	1864
60°	1151
65°	584
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16428 cd/sqm



TEST NUMBER: P641130

CATALOG NUMBER: ML5612LSNFL2597FS1E - 693BB - 1200LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.8	21.1
10°-20°	423.7	28.2
20°-30°	314.3	21.0
30°-40°	256.4	17.1
40°-50°	156.7	10.4
50°-60°	28.3	1.9
60°-70°	4.6	0.3
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1053.7	70.3
0°-40°	1310.1	87.4
0°-60°	1495.2	99.7
0°-90°	1499.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1499.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4022	
5°	3655	316
15°	1474	424
25°	682	314
35°	409	256
45°	212	157
55°	20	28
65°	4	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P641130

CATALOG NUMBER: ML5612LSNFL2597FS1E - 693BB - 1200LM - 5000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	4021.9
2.5°	3940.8
5°	3655.2
7.5°	3193.8
10°	2642.2
12.5°	2027.5
15°	1474.4
17.5°	1088.1
20°	873.2
22.5°	762.0
25°	682.3
27.5°	605.7
30°	535.1
32.5°	470.4
35°	408.8
37.5°	353.2
40°	302.1
42.5°	257.0
45°	211.9
47.5°	151.8
50°	97.7
52.5°	42.1
55°	19.5
57.5°	13.5
60°	10.5
62.5°	7.5
65°	4.5
67.5°	1.5
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)