

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641157

Luminaire Tested: ML5612LSNFL2597FS1E - 693TBZB - 1200LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641157
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSNFL2597FS1E - 693TBZB - 1200LM - 3000K
Description: ML56 RR, 25D TIR OPTIC, 6" TUSCON BRONZE BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1373.5 lumens
Efficiency: N/A
Efficacy: 83.2 lumens/watt
Spacing Criteria (0/90/45): 0.43 / 0.43 / 0.44
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641157

CATALOG NUMBER: ML5612LSNFL2597FS1E - 693TBZB - 1200LM - 3000K

Luminous Intensity Polar Plot

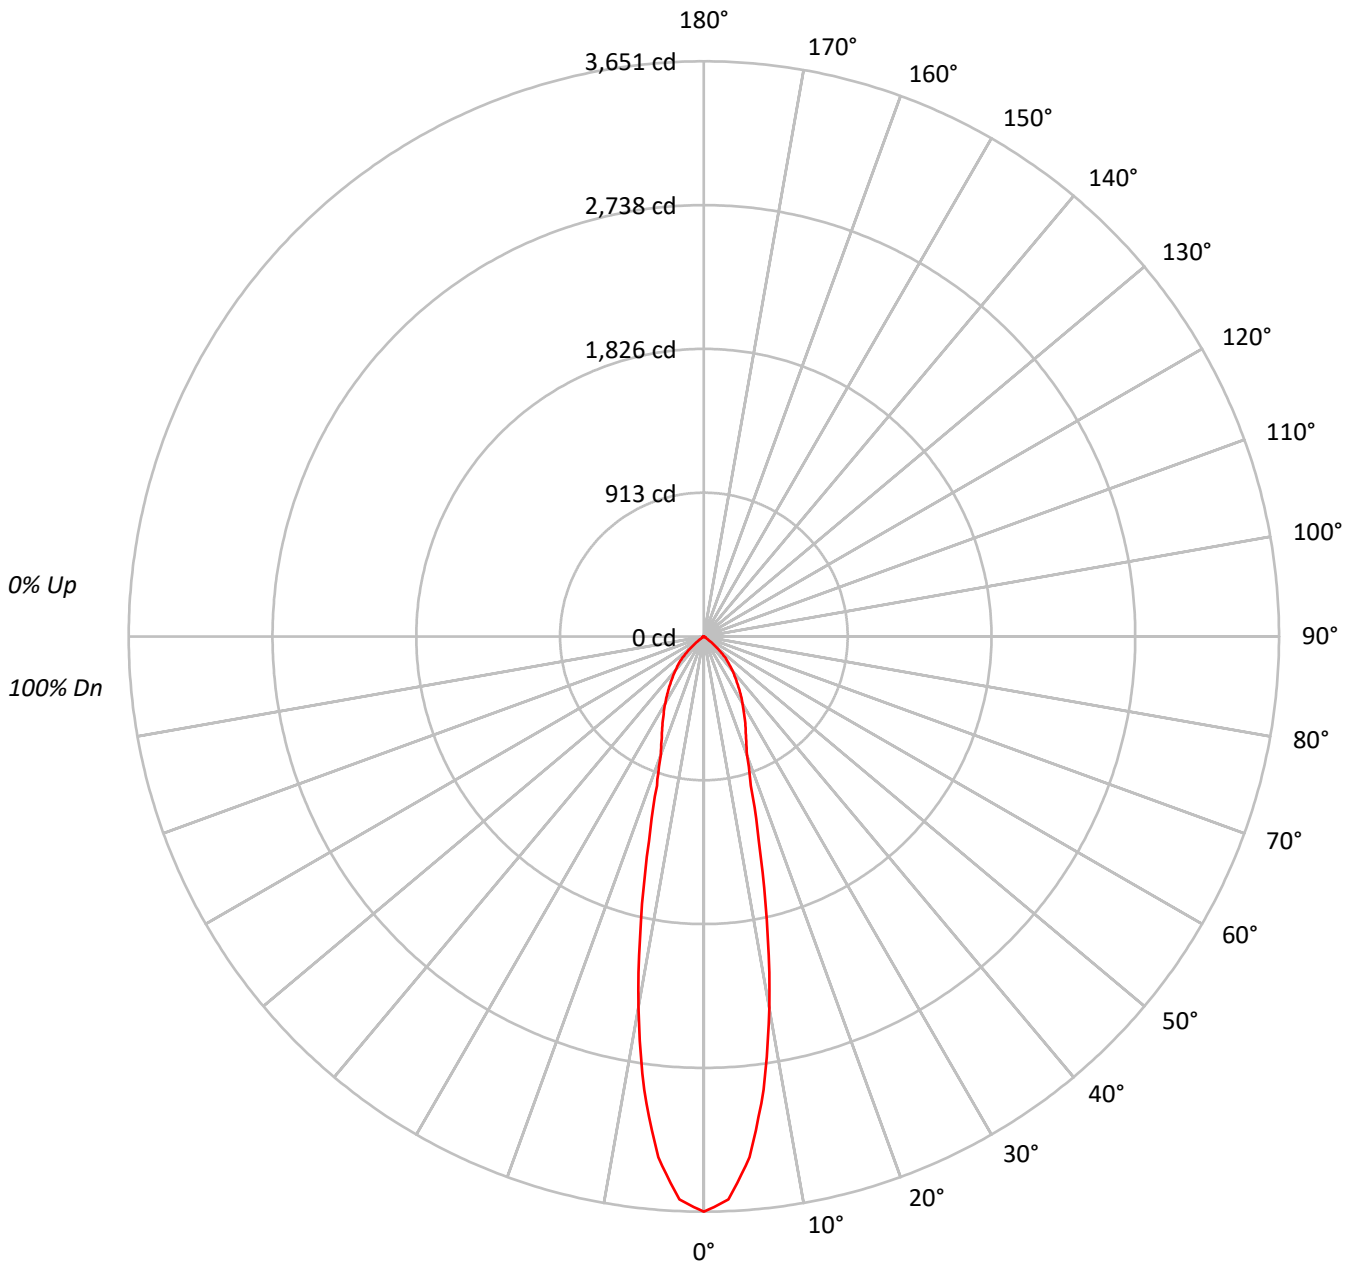



TEST NUMBER: P641157

CATALOG NUMBER: ML5612LSNFL2597FS1E - 693TBZB - 1200LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	108	104	100	97	106	102	99	96	99	96	93	96	94	91	93	91	90	88			
3	103	97	92	89	101	96	91	88	93	89	86	91	88	85	88	86	84	82			
4	98	91	86	82	97	90	85	81	88	84	80	86	82	79	84	81	79	77			
5	94	86	80	76	92	85	80	76	83	79	75	82	78	75	80	77	74	72			
6	90	81	75	71	88	80	75	71	79	74	71	77	73	70	76	73	70	68			
7	86	77	71	67	84	76	71	67	75	70	67	74	69	66	73	69	66	65			
8	82	73	67	63	81	72	67	63	71	66	63	70	66	63	69	65	63	61			
9	78	69	64	60	77	69	64	60	68	63	60	67	63	60	66	62	59	58			
10	75	66	61	57	74	66	61	57	65	60	57	64	60	57	64	60	57	56			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	200165
5°	182605
10°	133281
15°	76272
20°	46537
25°	37726
30°	31049
35°	25190
40°	19937
45°	15273
50°	7761
55°	1950
60°	1195
65°	532
70°	224
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 15273 cd/sqm



TEST NUMBER: P641157

CATALOG NUMBER: ML5612LSNFL2597FS1E - 693TBZB - 1200LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	286.7	20.9
10°-20°	385.5	28.1
20°-30°	287.3	20.9
30°-40°	236.0	17.2
40°-50°	145.3	10.6
50°-60°	27.6	2.0
60°-70°	4.5	0.3
70°-80°	0.5	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	959.5	69.9
0°-40°	1195.5	87.0
0°-60°	1368.4	99.6
0°-90°	1373.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1373.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3651	
5°	3318	287
15°	1344	385
25°	624	287
35°	376	236
45°	197	145
55°	20	28
65°	4	5
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P641157

CATALOG NUMBER: ML5612LSNFL2597FS1E - 693TBZB - 1200LM - 3000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	3651.3
2.5°	3577.9
5°	3318.3
7.5°	2902.5
10°	2394.3
12.5°	1841.3
15°	1343.9
17.5°	992.0
20°	797.7
22.5°	697.1
25°	623.7
27.5°	553.1
30°	490.5
32.5°	432.1
35°	376.4
37.5°	326.1
40°	278.6
42.5°	237.8
45°	197.0
47.5°	141.3
50°	91.0
52.5°	40.8
55°	20.4
57.5°	13.6
60°	10.9
62.5°	6.8
65°	4.1
67.5°	1.4
70°	1.4
72.5°	1.4
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)