

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641233

Luminaire Tested: ML5612LSVWFL7597FS1E - 591WB - 1200LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641233
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-70)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 591WB - 1200LM - 3500K
Description: ML56 RR, 75D TIR OPTIC, 5" DEADFRONT TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1518.3 lumens
Efficiency: N/A
Efficacy: 92.0 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641233
CATALOG NUMBER: ML5612LSVWFL7597FS1E - 591WB - 1200LM - 3500K

Luminous Intensity Polar Plot

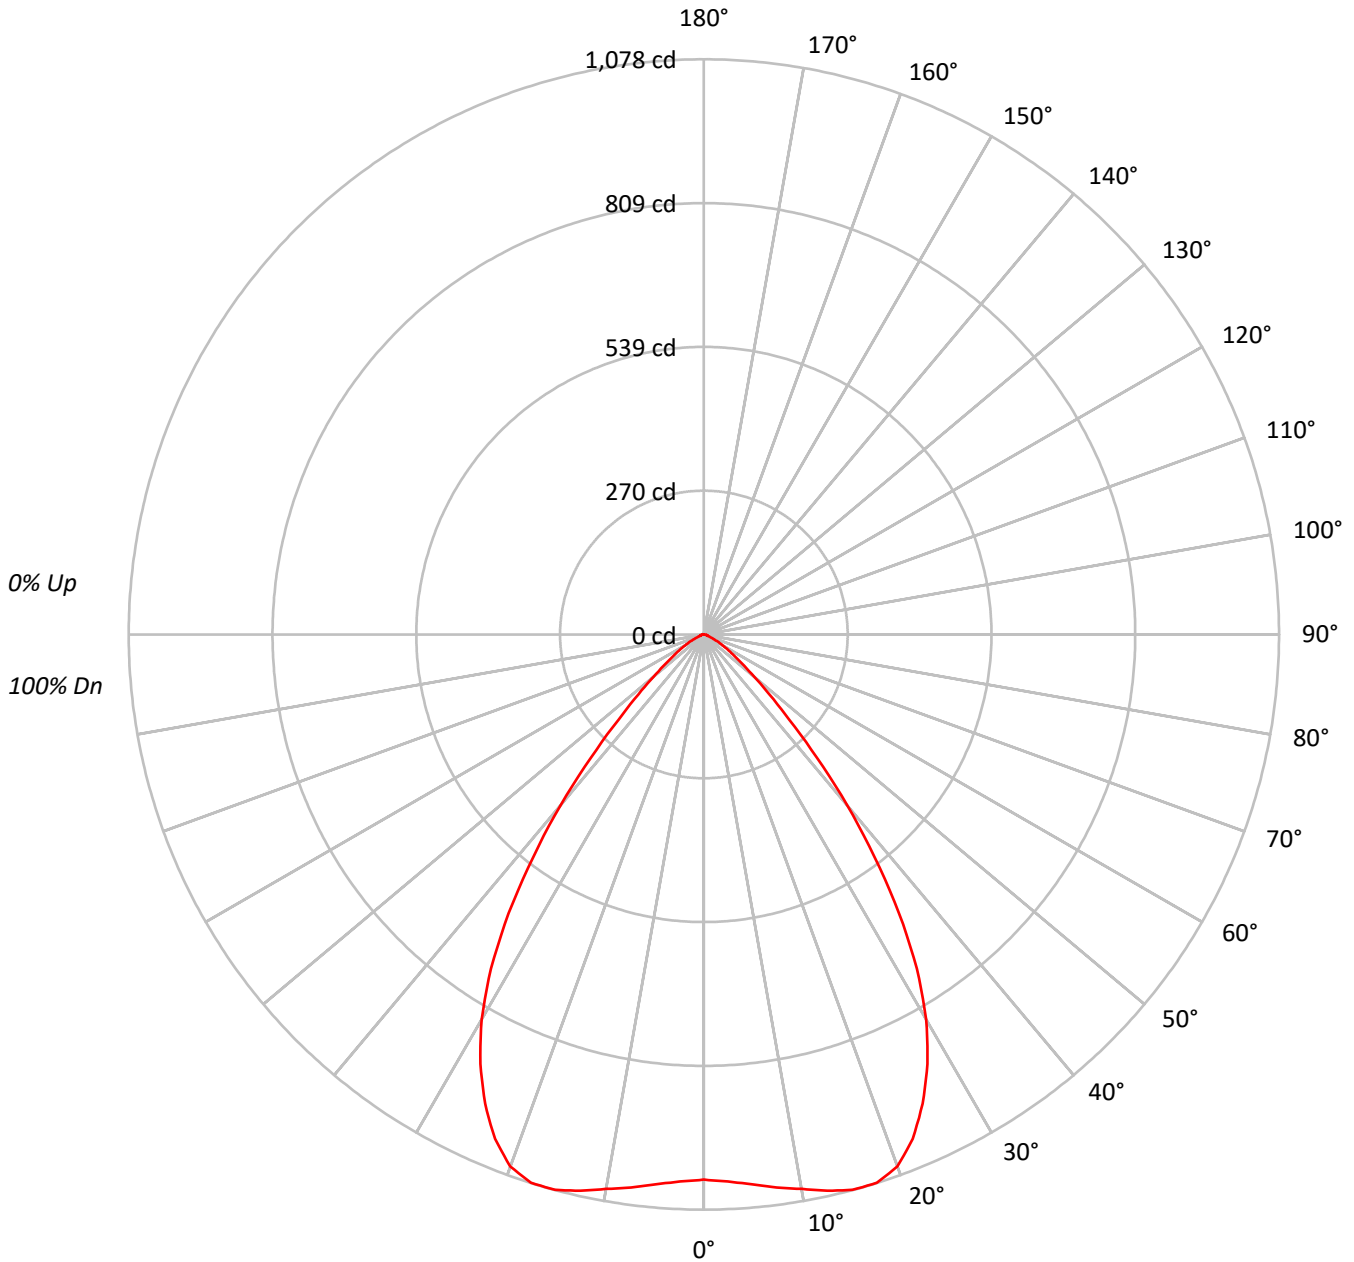



TEST NUMBER: P641233

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 591WB - 1200LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	107	104	110	107	105	103	103	101	99	99	98	96	96	95	94	92			
2	106	101	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76			
4	94	85	79	74	92	84	78	73	82	77	73	80	75	72	78	74	71	69			
5	88	79	72	67	86	78	71	67	76	70	66	74	69	65	72	68	65	63			
6	83	73	66	61	81	72	65	61	70	65	60	69	64	60	67	63	60	58			
7	78	68	61	56	77	67	60	56	65	60	55	64	59	55	63	58	55	53			
8	74	63	56	51	72	62	56	51	61	55	51	60	55	51	59	54	51	49			
9	69	59	52	48	68	58	52	47	57	51	47	56	51	47	55	50	47	45			
10	66	55	48	44	65	54	48	44	54	48	44	53	47	44	52	47	44	42			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	56010
5°	56917
10°	58739
15°	61152
20°	61885
25°	58679
30°	52749
35°	42690
40°	29863
45°	17529
50°	10473
55°	6537
60°	4440
65°	2529
70°	1346
75°	1186
80°	1326
85°	1761

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 17529 cd/sqm



TEST NUMBER: P641233

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 591WB - 1200LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	99.4	6.5
10°-20°	303.5	20.0
20°-30°	442.1	29.1
30°-40°	392.2	25.8
40°-50°	185.6	12.2
50°-60°	64.9	4.3
60°-70°	21.1	1.4
70°-80°	6.5	0.4
80°-90°	2.9	0.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	845.1	55.7
0°-40°	1237.3	81.5
0°-60°	1487.9	98.0
0°-90°	1518.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1518.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1022	
5°	1034	99
15°	1078	304
25°	970	442
35°	638	392
45°	226	186
55°	68	65
65°	20	21
75°	6	6
85°	3	3
90°	0	



TEST NUMBER: P641233

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 591WB - 1200LM - 3500K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1021.7
2.5°	1025.9
5°	1034.3
7.5°	1045.4
10°	1055.2
12.5°	1067.8
15°	1077.5
17.5°	1077.5
20°	1060.8
22.5°	1023.1
25°	970.1
27.5°	907.3
30°	833.3
32.5°	742.6
35°	637.9
37.5°	524.8
40°	417.3
42.5°	312.7
45°	226.1
47.5°	166.1
50°	122.8
52.5°	89.3
55°	68.4
57.5°	53.0
60°	40.5
62.5°	29.3
65°	19.5
67.5°	12.6
70°	8.4
72.5°	7.0
75°	5.6
77.5°	5.6
80°	4.2
82.5°	4.2
85°	2.8
87.5°	1.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)