

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641266

Luminaire Tested: ML5612LSVWFL7597FS1E - 592SC - 600LM - 2700K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641266
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-71)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 592SC - 600LM - 2700K
Description: ML56 RR, 75D TIR OPTIC, 5" SPECULAR CLEAR TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 923.5 lumens
Efficiency: N/A
Efficacy: 89.7 lumens/watt
Spacing Criteria (0/90/45): 1.15 / 1.15 / 1.07
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641266

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 592SC - 600LM - 2700K

Luminous Intensity Polar Plot

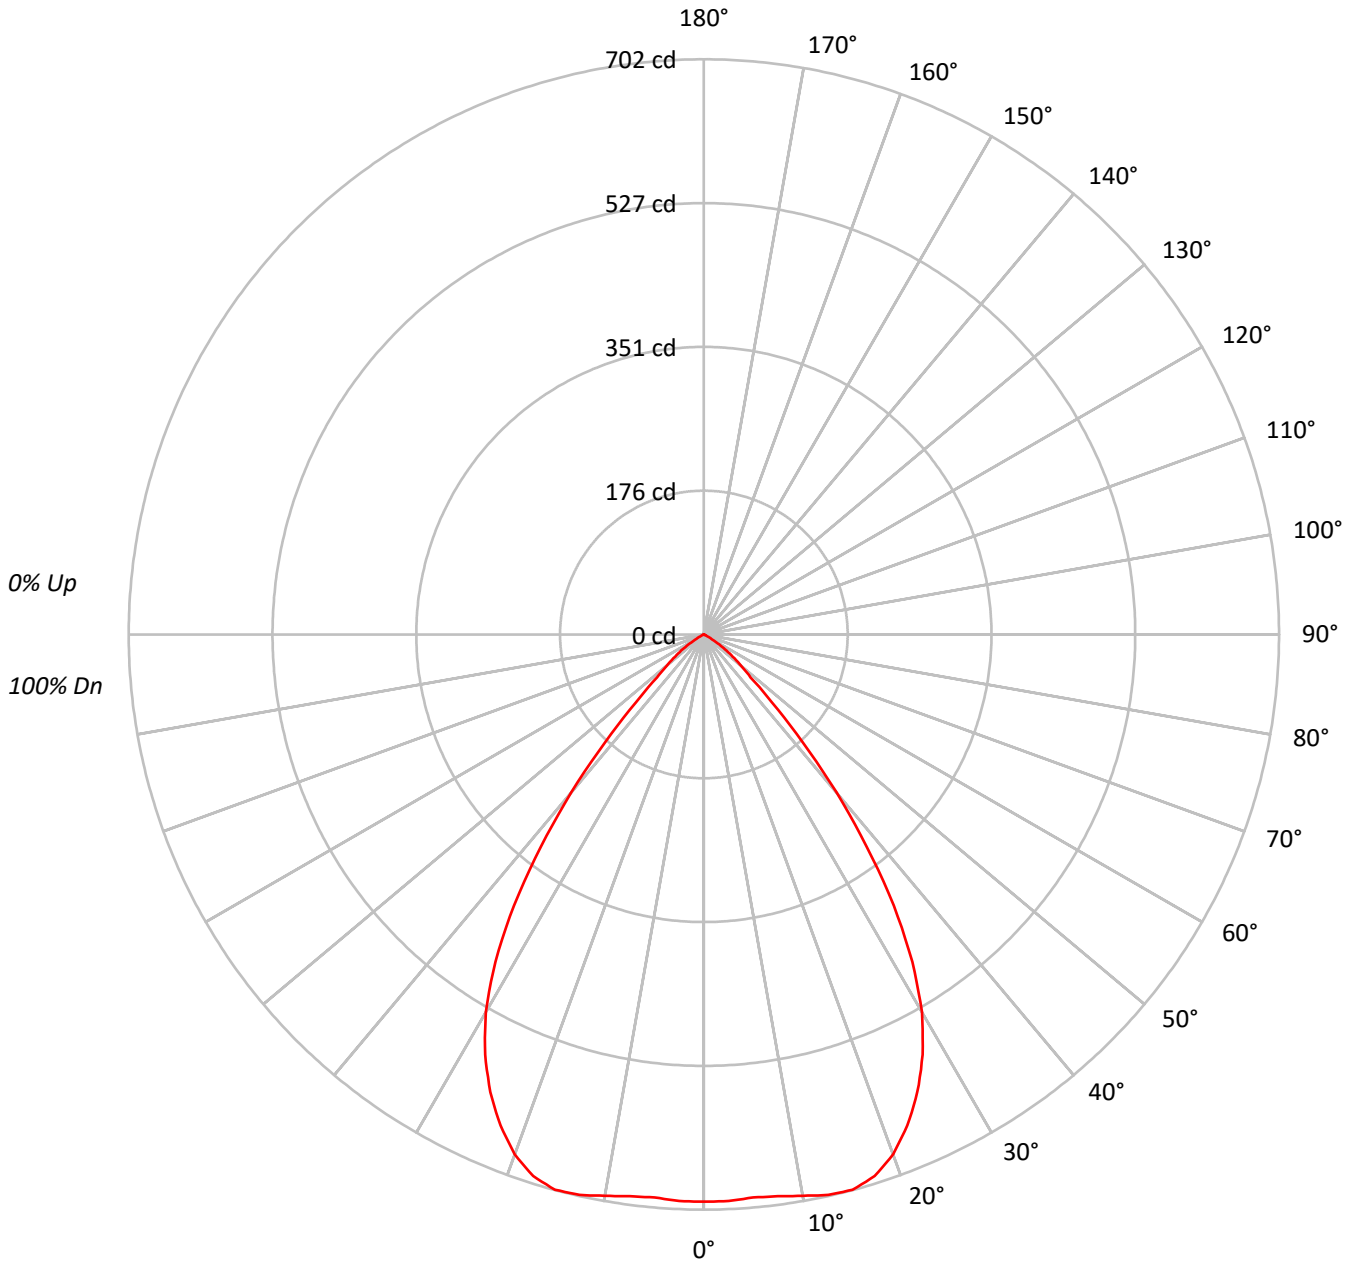



TEST NUMBER: P641266

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 592SC - 600LM - 2700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | | 50 | 30 | 10 | | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | | 106 | 106 | 106 | | 102 | 102 | 102 | 100 |
| 1 | 113 | 110 | 107 | 105 | 111 | 108 | 106 | 103 | 104 | 102 | 100 | | 100 | 99 | 97 | | 97 | 95 | 94 | 93 |
| 2 | 107 | 102 | 97 | 93 | 105 | 100 | 96 | 92 | 96 | 93 | 90 | | 93 | 91 | 88 | | 91 | 89 | 87 | 85 |
| 3 | 101 | 94 | 88 | 84 | 99 | 92 | 87 | 83 | 90 | 85 | 82 | | 87 | 84 | 81 | | 85 | 82 | 79 | 78 |
| 4 | 95 | 87 | 81 | 76 | 93 | 85 | 80 | 75 | 83 | 78 | 75 | | 81 | 77 | 74 | | 79 | 76 | 73 | 71 |
| 5 | 89 | 80 | 74 | 69 | 88 | 79 | 73 | 69 | 77 | 72 | 68 | | 76 | 71 | 68 | | 74 | 70 | 67 | 65 |
| 6 | 84 | 75 | 68 | 63 | 83 | 74 | 68 | 63 | 72 | 67 | 63 | | 71 | 66 | 62 | | 69 | 65 | 62 | 60 |
| 7 | 80 | 69 | 63 | 58 | 78 | 69 | 62 | 58 | 67 | 62 | 58 | | 66 | 61 | 57 | | 65 | 60 | 57 | 55 |
| 8 | 75 | 65 | 58 | 54 | 74 | 64 | 58 | 54 | 63 | 57 | 53 | | 62 | 57 | 53 | | 61 | 56 | 53 | 51 |
| 9 | 71 | 60 | 54 | 50 | 70 | 60 | 54 | 50 | 59 | 53 | 49 | | 58 | 53 | 49 | | 57 | 52 | 49 | 48 |
| 10 | 67 | 57 | 50 | 46 | 66 | 56 | 50 | 46 | 55 | 50 | 46 | | 55 | 49 | 46 | | 54 | 49 | 46 | 44 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|-------|
| | 0° |
| 0° | 54643 |
| 5° | 54654 |
| 10° | 55758 |
| 15° | 57339 |
| 20° | 56722 |
| 25° | 53698 |
| 30° | 48521 |
| 35° | 38923 |
| 40° | 25938 |
| 45° | 13106 |
| 50° | 7307 |
| 55° | 4335 |
| 60° | 1610 |
| 65° | 318 |
| 70° | 0 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13106 cd/sqm



TEST NUMBER: P641266

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 592SC - 600LM - 2700K

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 66.1 | 7.2 |
| 10°-20° | 196.8 | 21.3 |
| 20°-30° | 281.3 | 30.5 |
| 30°-40° | 247.2 | 26.8 |
| 40°-50° | 100.2 | 10.8 |
| 50°-60° | 29.0 | 3.1 |
| 60°-70° | 3.1 | 0.3 |
| 70°-80° | 0.0 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 544.1 | 58.9 |
| 0°-40° | 791.3 | 85.7 |
| 0°-60° | 920.4 | 99.7 |
| 0°-90° | 923.5 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 923.5 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-----|------|
| 0° | 692 | |
| 5° | 690 | 66 |
| 15° | 702 | 197 |
| 25° | 616 | 281 |
| 35° | 404 | 247 |
| 45° | 117 | 100 |
| 55° | 32 | 29 |
| 65° | 2 | 3 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P641266

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 592SC - 600LM - 2700K

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|-------|
| 0° | 692.2 |
| 2.5° | 692.2 |
| 5° | 689.7 |
| 7.5° | 691.4 |
| 10° | 695.6 |
| 12.5° | 700.7 |
| 15° | 701.6 |
| 17.5° | 693.1 |
| 20° | 675.2 |
| 22.5° | 648.8 |
| 25° | 616.5 |
| 27.5° | 578.3 |
| 30° | 532.3 |
| 32.5° | 473.7 |
| 35° | 403.9 |
| 37.5° | 326.5 |
| 40° | 251.7 |
| 42.5° | 177.7 |
| 45° | 117.4 |
| 47.5° | 77.4 |
| 50° | 59.5 |
| 52.5° | 44.2 |
| 55° | 31.5 |
| 57.5° | 20.4 |
| 60° | 10.2 |
| 62.5° | 5.1 |
| 65° | 1.7 |
| 67.5° | 0.9 |
| 70° | 0.0 |
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)