

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641284

Luminaire Tested: ML5612LSVWFL7597FS1E - 592W - 600LM - 4000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641284
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 592W - 600LM - 4000K
Description: ML56 RR, 75D TIR OPTIC, 5" WHITE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1042.2 lumens
Efficiency: N/A
Efficacy: 101.2 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641284

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 592W - 600LM - 4000K

Luminous Intensity Polar Plot

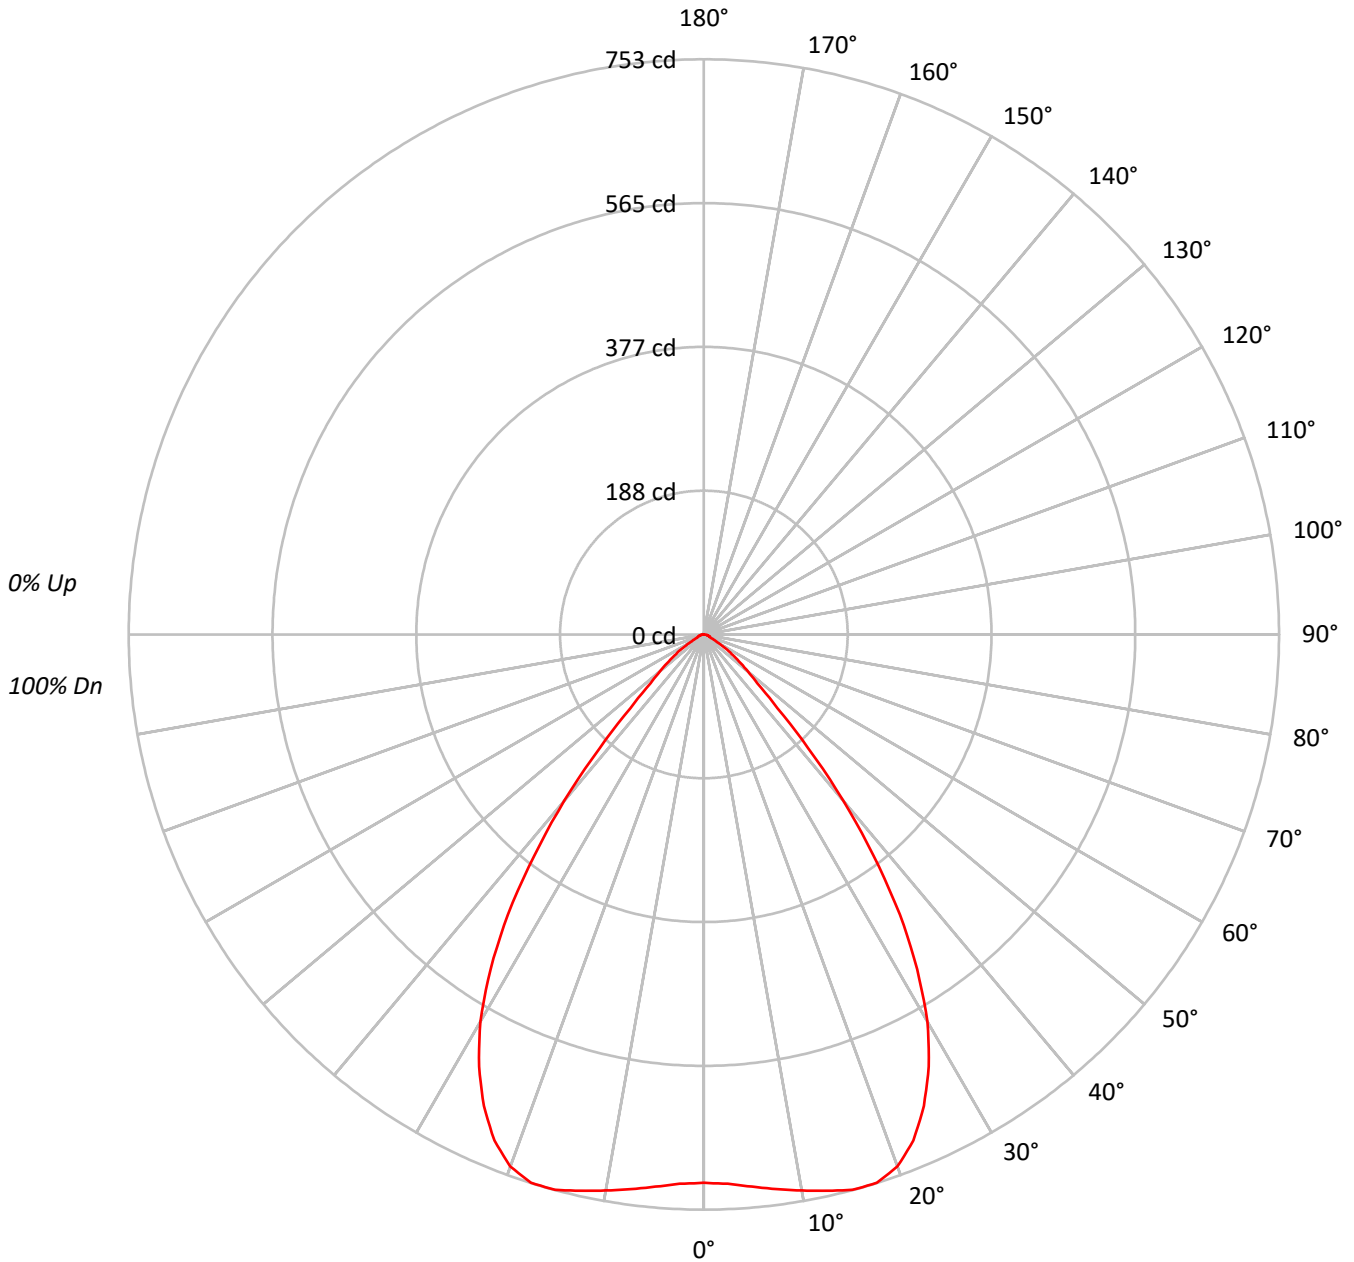



TEST NUMBER: P641284

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 592W - 600LM - 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	104	110	107	105	103	103	101	99	100	98	96	96	95	94	92	92	92	92
2	106	101	96	92	104	99	95	91	96	92	89	93	90	87	90	87	85	84	84	84	84
3	100	93	87	83	98	91	86	82	89	84	81	86	82	79	84	81	78	76	76	76	76
4	94	85	79	74	92	84	78	74	82	77	73	80	76	72	78	74	71	70	70	70	70
5	88	79	72	68	87	78	72	67	76	71	67	74	70	66	73	69	65	64	64	64	64
6	83	73	66	62	82	72	66	61	71	65	61	69	64	61	68	64	60	58	58	58	58
7	78	68	61	57	77	67	61	56	66	60	56	65	60	56	64	59	55	54	54	54	54
8	74	63	57	52	73	63	56	52	62	56	52	61	55	51	59	55	51	50	50	50	50
9	70	59	53	48	69	59	52	48	58	52	48	57	51	48	56	51	48	46	46	46	46
10	66	55	49	45	65	55	49	45	54	48	44	53	48	44	52	48	44	43	43	43	43

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	56672
5°	57498
10°	59245
15°	61515
20°	62258
25°	59334
30°	53370
35°	43116
40°	29277
45°	15205
50°	9260
55°	6111
60°	3205
65°	1812
70°	1777
75°	1769
80°	1773
85°	1721

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 15205 cd/sqm



TEST NUMBER: P641284

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 592W - 600LM - 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	69.7	6.7
10°-20°	212.1	20.4
20°-30°	310.2	29.8
30°-40°	273.7	26.3
40°-50°	116.4	11.2
50°-60°	40.4	3.9
60°-70°	11.6	1.1
70°-80°	6.1	0.6
80°-90°	2.1	0.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	592.0	56.8
0°-40°	865.7	83.1
0°-60°	1022.4	98.1
0°-90°	1042.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1042.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	718	
5°	726	70
15°	753	212
25°	681	310
35°	447	274
45°	136	116
55°	44	40
65°	10	12
75°	6	6
85°	2	2
90°	0	



TEST NUMBER: P641284

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 592W - 600LM - 4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	717.9
2.5°	719.8
5°	725.6
7.5°	732.4
10°	739.1
12.5°	745.9
15°	752.7
17.5°	752.7
20°	741.1
22.5°	716.9
25°	681.2
27.5°	637.7
30°	585.5
32.5°	519.8
35°	447.4
37.5°	364.3
40°	284.1
42.5°	201.9
45°	136.2
47.5°	94.7
50°	75.4
52.5°	58.0
55°	44.4
57.5°	31.9
60°	20.3
62.5°	14.5
65°	9.7
67.5°	8.7
70°	7.7
72.5°	6.8
75°	5.8
77.5°	4.8
80°	3.9
82.5°	2.9
85°	1.9
87.5°	1.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)