

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641292

Luminaire Tested: ML5612LSVWFL7597FS1E - 593BB - 1200LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641292
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-75)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 593BB - 1200LM - 3000K
Description: ML56 RR, 75D TIR OPTIC, 5" BLACK BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1395.2 lumens
Efficiency: N/A
Efficacy: 84.6 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641292

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593BB - 1200LM - 3000K

Luminous Intensity Polar Plot

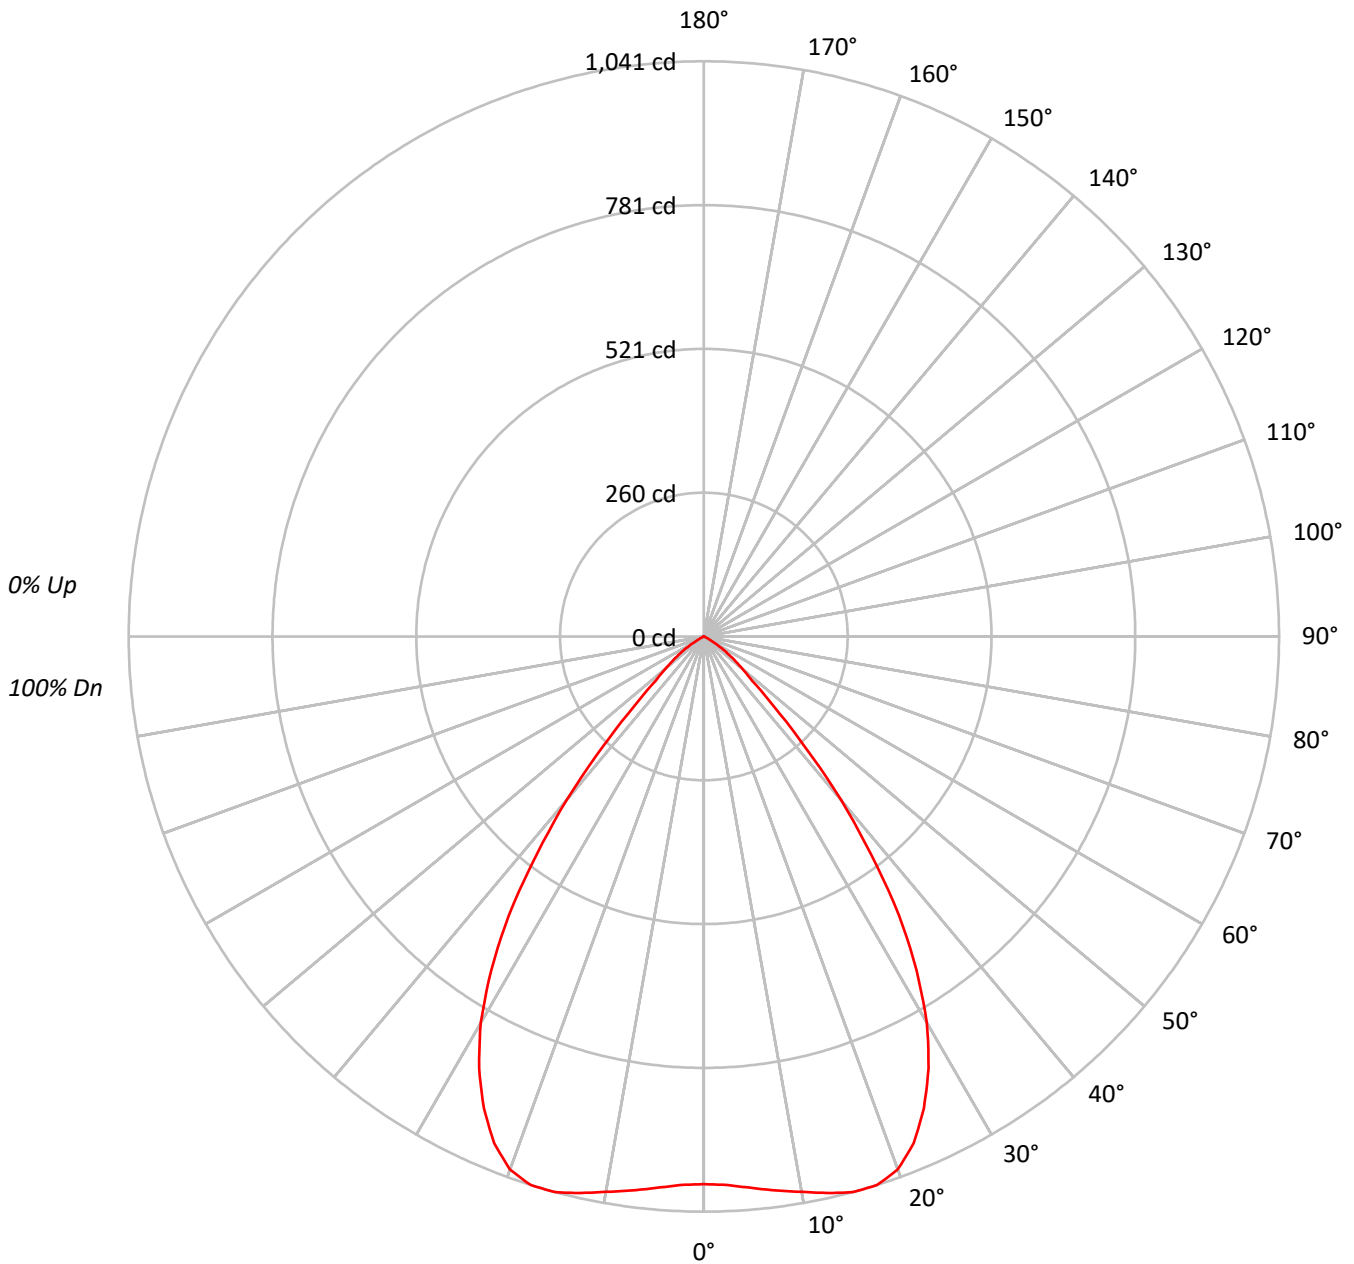



TEST NUMBER: P641292

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593BB - 1200LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92	92	92	92
2	107	101	97	93	104	100	96	92	96	93	90	93	91	88	91	88	86	85	85	85	85
3	101	94	88	84	99	92	87	83	90	85	82	87	83	81	85	82	79	78	78	78	78
4	95	87	80	76	93	85	80	75	83	78	74	81	77	74	79	76	73	71	71	71	71
5	89	80	74	69	88	79	73	69	77	72	68	76	71	67	74	70	67	65	65	65	65
6	84	74	68	63	83	74	67	63	72	66	62	70	66	62	69	65	61	60	60	60	60
7	79	69	63	58	78	68	62	58	67	62	57	66	61	57	65	60	57	55	55	55	55
8	75	64	58	53	74	64	58	53	63	57	53	62	57	53	61	56	53	51	51	51	51
9	71	60	54	49	70	60	54	49	59	53	49	58	53	49	57	52	49	47	47	47	47
10	67	56	50	46	66	56	50	46	55	50	46	54	49	46	54	49	45	44	44	44	44

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	78223
5°	79385
10°	81826
15°	85093
20°	86217
25°	82050
30°	73597
35°	59344
40°	39777
45°	19883
50°	11188
55°	6730
60°	2368
65°	262
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 19883 cd/sqm



TEST NUMBER: P641292

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593BB - 1200LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	96.2	6.9
10°-20°	293.4	21.0
20°-30°	428.9	30.7
30°-40°	375.6	26.9
40°-50°	152.5	10.9
50°-60°	44.5	3.2
60°-70°	4.1	0.3
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	818.5	58.7
0°-40°	1194.1	85.6
0°-60°	1391.1	99.7
0°-90°	1395.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1395.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	991	
5°	1002	96
15°	1041	293
25°	942	429
35°	616	376
45°	178	153
55°	49	44
65°	1	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P641292

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593BB - 1200LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	990.9
2.5°	993.6
5°	1001.8
7.5°	1011.3
10°	1020.8
12.5°	1031.7
15°	1041.2
17.5°	1041.2
20°	1026.3
22.5°	992.3
25°	942.0
27.5°	880.8
30°	807.4
32.5°	716.3
35°	615.8
37.5°	496.1
40°	386.0
42.5°	269.1
45°	178.1
47.5°	118.3
50°	91.1
52.5°	68.0
55°	48.9
57.5°	31.3
60°	15.0
62.5°	8.2
65°	1.4
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)