

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641308

Luminaire Tested: ML5612LSVWFL7597FS1E - 593SNB - 1200LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641308
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-76)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 593SNB - 1200LM - 3500K
Description: ML56 RR, 75D TIR OPTIC, 5" SATIN NICKLE BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1472.2 lumens
Efficiency: N/A
Efficacy: 89.2 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641308

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593SNB - 1200LM - 3500K

Luminous Intensity Polar Plot

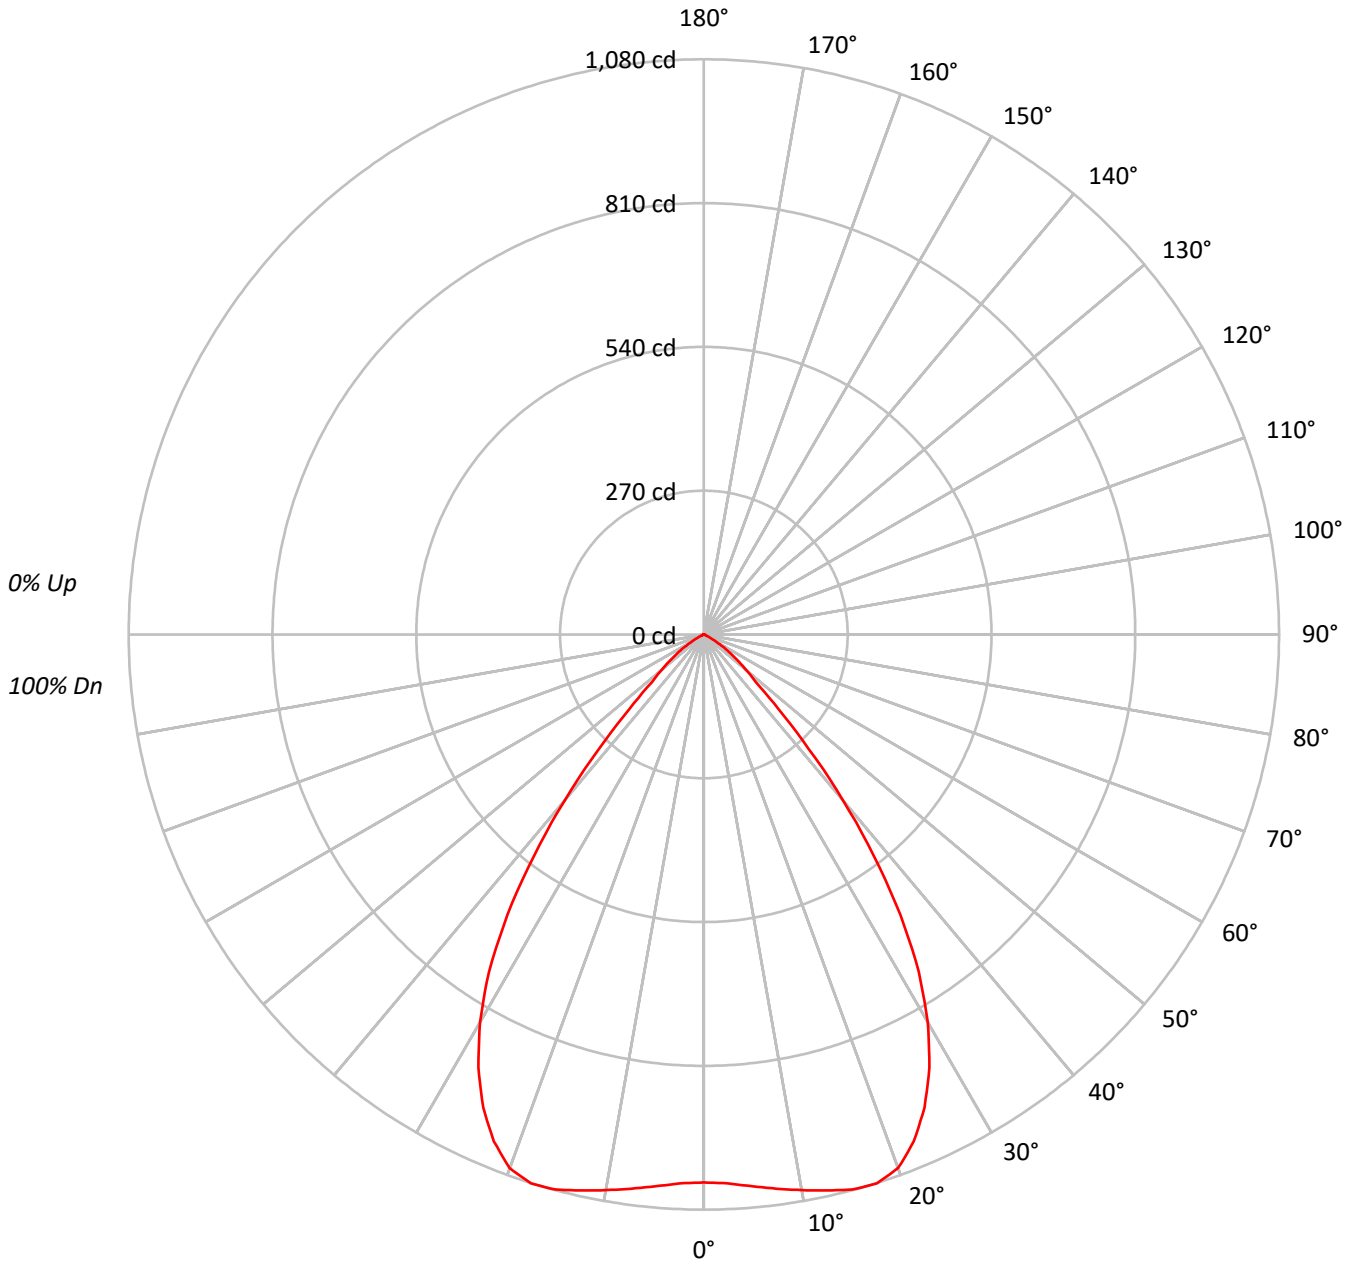



TEST NUMBER: P641308

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593SNB - 1200LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	96	95	94	92	92	92	92
2	107	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84	84	84	84
3	100	93	88	83	98	92	87	83	89	85	81	87	83	80	84	81	79	77	77	77	77
4	95	86	80	75	93	85	79	75	83	78	74	81	76	73	79	75	72	71	71	71	71
5	89	80	73	68	87	79	73	68	77	72	67	75	70	67	74	69	66	65	65	65	65
6	84	74	67	63	82	73	67	62	72	66	62	70	65	61	69	64	61	59	59	59	59
7	79	69	62	57	78	68	62	57	67	61	57	65	60	57	64	60	56	55	55	55	55
8	75	64	57	53	73	63	57	53	62	57	52	61	56	52	60	55	52	50	50	50	50
9	70	60	53	49	69	59	53	49	58	53	49	57	52	48	56	52	48	47	47	47	47
10	67	56	50	45	66	56	49	45	55	49	45	54	49	45	53	48	45	43	43	43	43

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	81207
5°	82404
10°	84920
15°	88182
20°	89585
25°	85351
30°	76596
35°	62013
40°	41859
45°	21971
50°	12686
55°	7872
60°	3521
65°	1046
70°	646
75°	427
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 21971 cd/sqm



TEST NUMBER: P641308

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593SNB - 1200LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	99.9	6.8
10°-20°	304.3	20.7
20°-30°	446.0	30.3
30°-40°	393.9	26.8
40°-50°	166.3	11.3
50°-60°	52.5	3.6
60°-70°	7.9	0.5
70°-80°	1.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	850.2	57.7
0°-40°	1244.1	84.5
0°-60°	1462.9	99.4
0°-90°	1472.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1472.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1029	
5°	1040	100
15°	1079	304
25°	980	446
35°	644	394
45°	197	166
55°	57	53
65°	6	8
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P641308

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593SNB - 1200LM - 3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1028.7
2.5°	1031.5
5°	1039.9
7.5°	1049.7
10°	1059.4
12.5°	1069.2
15°	1079.0
17.5°	1080.4
20°	1066.4
22.5°	1030.1
25°	979.9
27.5°	917.0
30°	840.3
32.5°	750.9
35°	643.5
37.5°	524.8
40°	406.2
42.5°	291.7
45°	196.8
47.5°	132.6
50°	103.3
52.5°	78.2
55°	57.2
57.5°	39.1
60°	22.3
62.5°	11.2
65°	5.6
67.5°	2.8
70°	2.8
72.5°	1.4
75°	1.4
77.5°	1.4
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)