

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641325

Luminaire Tested: ML5612LSVWFL7597FS1E - 593TBZB - 1200LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641325
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-77)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 593TBZB - 1200LM - 5000K
Description: ML56 RR, 75D TIR OPTIC, 5" TUSCON BRONZE BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1550.1 lumens
Efficiency: N/A
Efficacy: 93.9 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641325

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593TBZB - 1200LM - 5000K

Luminous Intensity Polar Plot

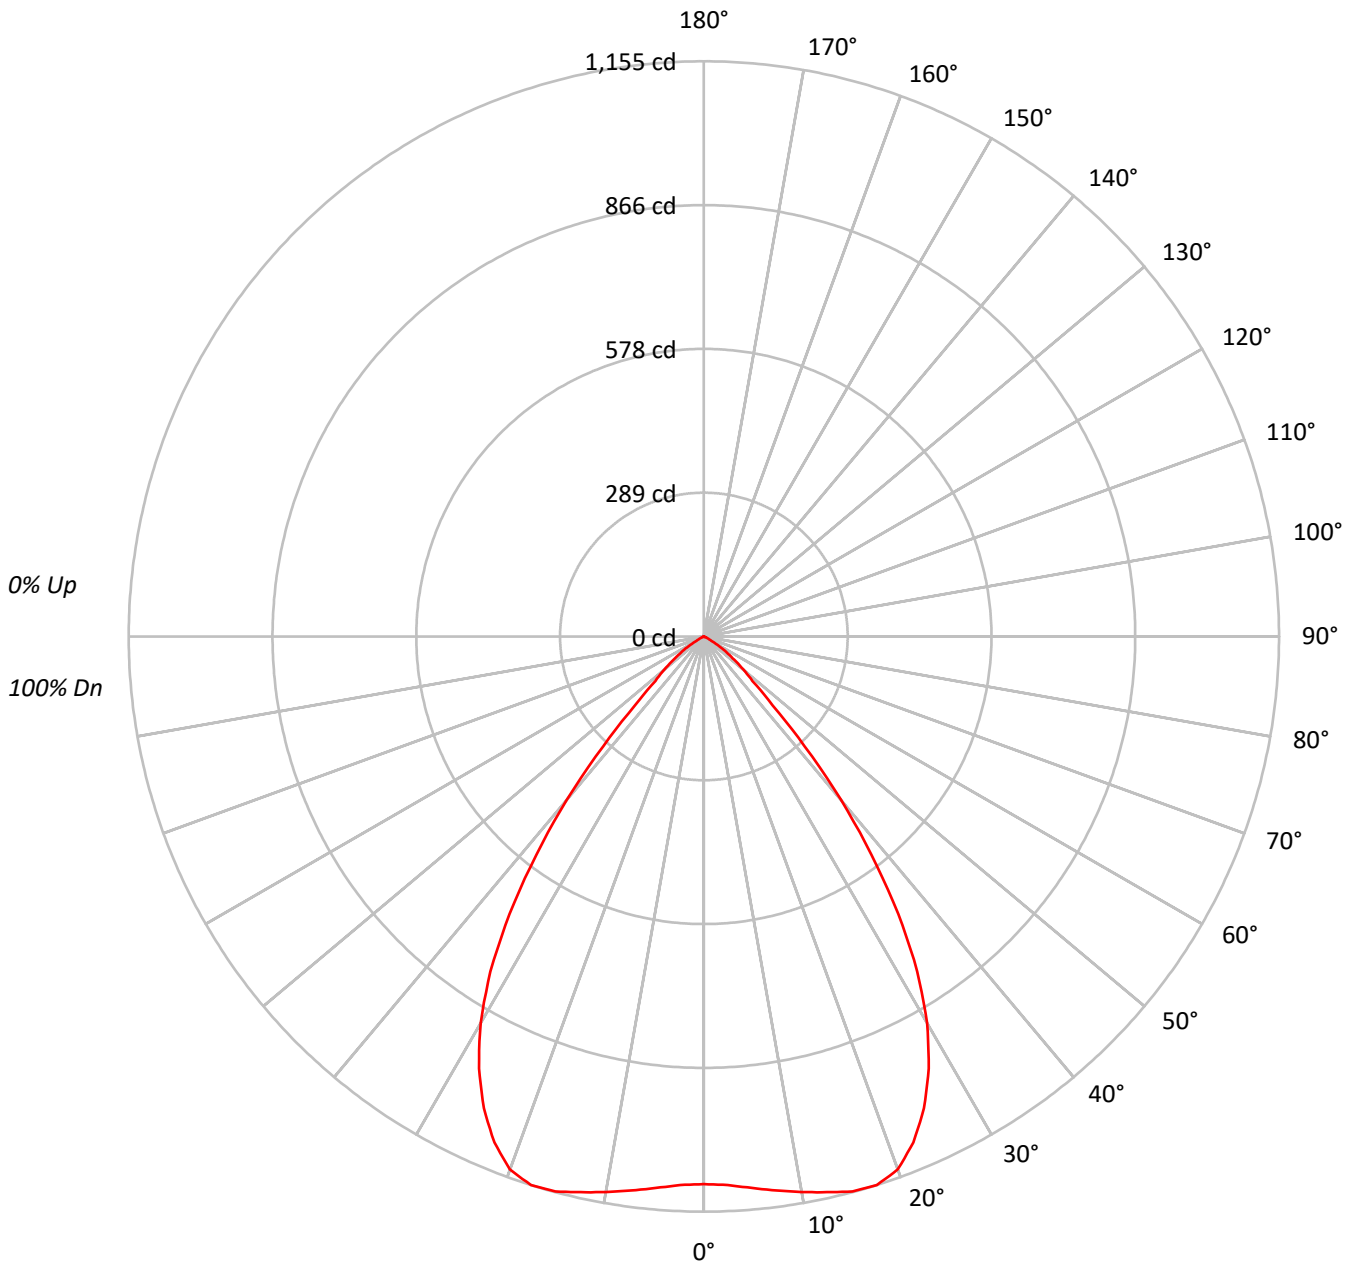



TEST NUMBER: P641325

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593TBZB - 1200LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92	92	92	92
2	107	101	97	93	104	100	96	92	96	93	90	93	91	88	91	88	86	85	85	85	85
3	101	94	88	84	99	92	87	83	89	85	82	87	83	80	85	82	79	78	78	78	78
4	95	86	80	76	93	85	80	75	83	78	74	81	77	73	79	76	73	71	71	71	71
5	89	80	74	69	88	79	73	69	77	72	68	76	71	67	74	70	67	65	65	65	65
6	84	74	68	63	83	73	67	63	72	66	62	70	66	62	69	65	61	60	60	60	60
7	79	69	62	58	78	68	62	58	67	61	57	66	61	57	65	60	57	55	55	55	55
8	75	64	58	53	74	64	58	53	63	57	53	62	56	53	61	56	52	51	51	51	51
9	71	60	54	49	70	60	53	49	59	53	49	58	53	49	57	52	49	47	47	47	47
10	67	56	50	46	66	56	50	46	55	49	46	54	49	45	53	49	45	44	44	44	44

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	86796
5°	88078
10°	90788
15°	94279
20°	95651
25°	91065
30°	81737
35°	65570
40°	44116
45°	21803
50°	12723
55°	7652
60°	2605
65°	560
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 21803 cd/sqm



TEST NUMBER: P641325

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593TBZB - 1200LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	106.8	6.9
10°-20°	325.3	21.0
20°-30°	475.8	30.7
30°-40°	417.1	26.9
40°-50°	169.3	10.9
50°-60°	50.5	3.3
60°-70°	5.3	0.3
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	907.9	58.6
0°-40°	1325.0	85.5
0°-60°	1544.8	99.7
0°-90°	1550.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1550.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1100	
5°	1112	107
15°	1154	325
25°	1046	476
35°	680	417
45°	195	169
55°	56	50
65°	3	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P641325

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 593TBZB - 1200LM - 5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1099.5
2.5°	1102.5
5°	1111.5
7.5°	1122.1
10°	1132.6
12.5°	1143.1
15°	1153.6
17.5°	1155.1
20°	1138.6
22.5°	1099.5
25°	1045.5
27.5°	977.9
30°	896.7
32.5°	797.6
35°	680.4
37.5°	552.8
40°	428.1
42.5°	298.9
45°	195.3
47.5°	132.2
50°	103.6
52.5°	76.6
55°	55.6
57.5°	36.1
60°	16.5
62.5°	9.0
65°	3.0
67.5°	1.5
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)