

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641357

Luminaire Tested: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641357
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-79)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3000K
Description: ML56 RR, 75D TIR OPTIC, 5" SATIN NICKLE GIMBAL TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 959.5 lumens
Efficiency: N/A
Efficacy: 93.2 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641357
CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3000K

Luminous Intensity Polar Plot

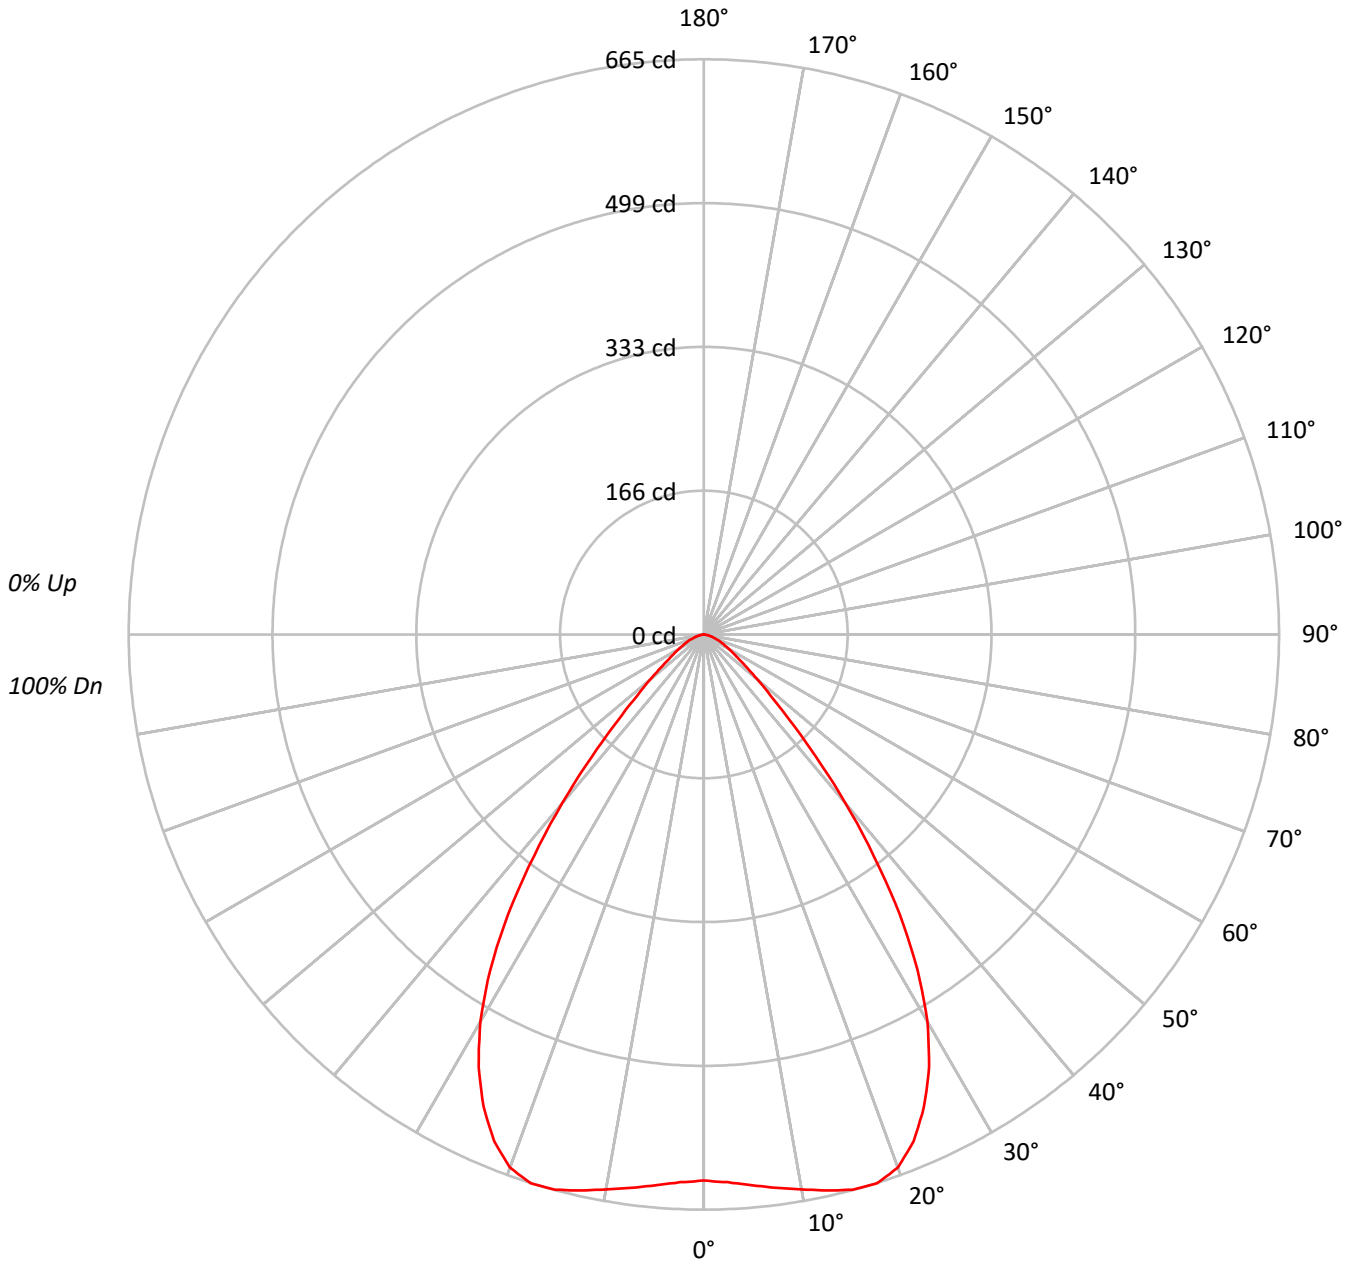



TEST NUMBER: P641357

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100	
1	112	109	106	104	110	107	104	102	103	101	99	99	98	96	96	94	93	91			91	
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	84	83			83	
3	99	92	86	81	97	90	85	80	87	83	79	85	81	78	83	79	77	75			75	
4	93	84	78	73	91	83	77	72	81	76	72	79	74	71	77	73	70	68			68	
5	87	78	71	66	86	77	70	66	75	69	65	73	68	64	71	67	64	62			62	
6	82	72	65	60	81	71	64	60	69	64	59	68	63	59	67	62	58	57			57	
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52			52	
8	73	62	55	50	72	61	55	50	60	54	50	59	54	50	58	53	50	48			48	
9	69	58	51	47	68	57	51	47	56	50	46	55	50	46	54	50	46	44			44	
10	65	54	48	43	64	54	47	43	53	47	43	52	47	43	51	46	43	41			41	

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	49835
5°	50644
10°	52215
15°	54307
20°	55092
25°	52470
30°	47099
35°	37998
40°	26216
45°	15618
50°	9874
55°	6744
60°	5242
65°	4240
70°	3439
75°	2654
80°	1591
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 15618 cd/sqm



TEST NUMBER: P641357

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	61.4	6.4
10°-20°	187.3	19.5
20°-30°	274.3	28.6
30°-40°	242.1	25.2
40°-50°	114.9	12.0
50°-60°	46.3	4.8
60°-70°	23.0	2.4
70°-80°	9.3	1.0
80°-90°	0.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	523.0	54.5
0°-40°	765.1	79.7
0°-60°	926.2	96.5
0°-90°	959.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	959.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	631	
5°	639	61
15°	664	187
25°	602	274
35°	394	242
45°	140	115
55°	49	46
65°	23	23
75°	9	9
85°	0	1
90°	0	



TEST NUMBER: P641357

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	631.3
2.5°	633.9
5°	639.1
7.5°	645.3
10°	651.4
12.5°	658.4
15°	664.5
17.5°	665.4
20°	655.8
22.5°	633.9
25°	602.4
27.5°	563.9
30°	516.7
32.5°	459.9
35°	394.3
37.5°	322.6
40°	254.4
42.5°	191.5
45°	139.9
47.5°	104.0
50°	80.4
52.5°	62.1
55°	49.0
57.5°	40.2
60°	33.2
62.5°	27.1
65°	22.7
67.5°	19.2
70°	14.9
72.5°	11.4
75°	8.7
77.5°	6.1
80°	3.5
82.5°	1.7
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)