

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641358

Luminaire Tested: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641358
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-79)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3500K
Description: ML56 RR, 75D TIR OPTIC, 5" SATIN NICKLE GIMBAL TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 985.7 lumens
Efficiency: N/A
Efficacy: 95.7 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641358

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3500K

Luminous Intensity Polar Plot

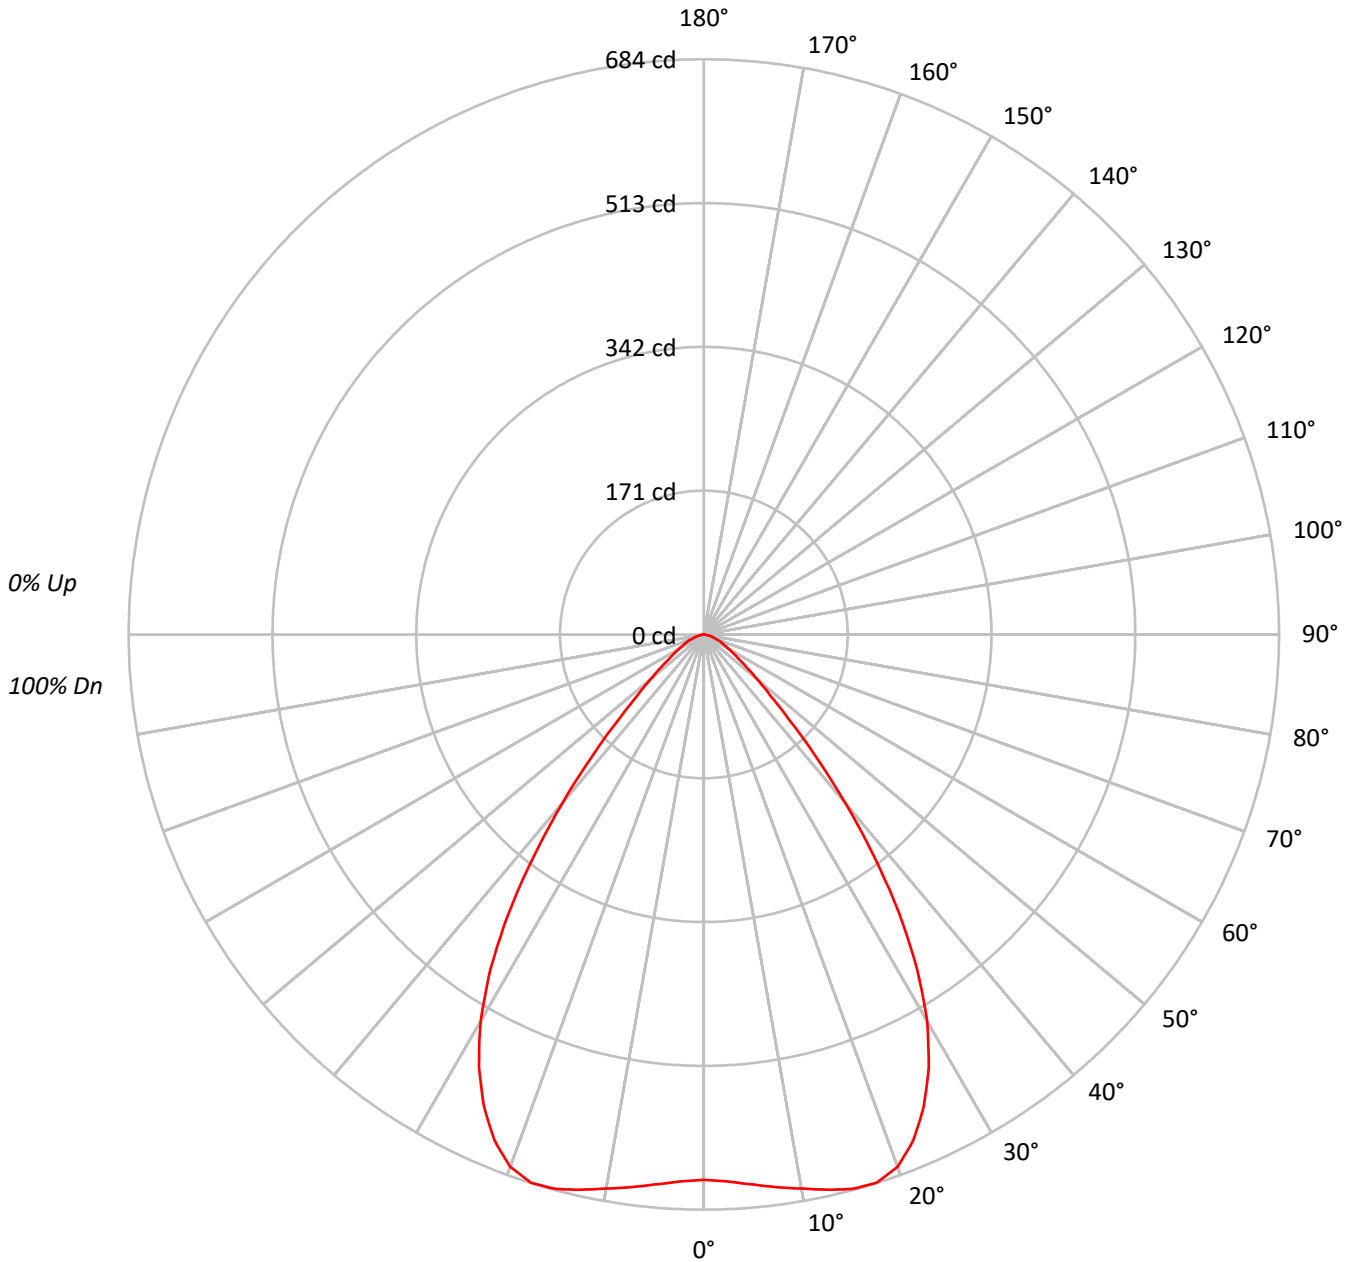



TEST NUMBER: P641358

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	104	110	107	104	102	103	101	99	99	98	96	96	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	84	83			
3	99	92	86	81	97	90	85	80	87	83	79	85	81	78	83	79	77	75			
4	93	84	78	73	91	83	77	72	81	76	72	79	74	71	77	73	70	68			
5	87	78	71	66	86	77	70	66	75	69	65	73	68	64	71	67	64	62			
6	82	72	65	60	81	71	64	60	69	64	59	68	63	59	67	62	58	57			
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52			
8	73	62	55	50	72	61	55	50	60	54	50	59	54	50	58	53	50	48			
9	69	58	51	47	68	57	51	46	56	50	46	55	50	46	54	50	46	44			
10	65	54	48	43	64	54	47	43	53	47	43	52	47	43	51	46	43	41			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	51193
5°	52023
10°	53634
15°	55786
20°	56587
25°	53899
30°	48384
35°	39039
40°	26937
45°	16043
50°	10144
55°	6923
60°	5384
65°	4371
70°	3531
75°	2745
80°	1637
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16043 cd/sqm



TEST NUMBER: P641358

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	63.1	6.4
10°-20°	192.4	19.5
20°-30°	281.7	28.6
30°-40°	248.7	25.2
40°-50°	118.0	12.0
50°-60°	47.5	4.8
60°-70°	23.6	2.4
70°-80°	9.6	1.0
80°-90°	1.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	537.2	54.5
0°-40°	785.9	79.7
0°-60°	951.5	96.5
0°-90°	985.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	985.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	648	
5°	656	63
15°	683	192
25°	619	282
35°	405	249
45°	144	118
55°	50	48
65°	23	24
75°	9	10
85°	0	1
90°	0	



TEST NUMBER: P641358

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594SNB - 600LM - 3500K

CANDELA DISTRIBUTION (FULL):

	0°
0°	648.5
2.5°	651.1
5°	656.5
7.5°	662.8
10°	669.1
12.5°	676.3
15°	682.6
17.5°	683.5
20°	673.6
22.5°	651.1
25°	618.8
27.5°	579.3
30°	530.8
32.5°	472.4
35°	405.1
37.5°	331.4
40°	261.4
42.5°	196.7
45°	143.7
47.5°	106.9
50°	82.6
52.5°	63.8
55°	50.3
57.5°	41.3
60°	34.1
62.5°	27.8
65°	23.4
67.5°	19.8
70°	15.3
72.5°	11.7
75°	9.0
77.5°	6.3
80°	3.6
82.5°	1.8
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)