

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641374

Luminaire Tested: ML5612LSVWFL7597FS1E - 594TBZB - 600LM - 4000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641374
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-80)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 594TBZB - 600LM - 4000K
Description: ML56 RR, 75D TIR OPTIC, 5" TUSCON BRONZE GIMBAL TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1058.6 lumens
Efficiency: N/A
Efficacy: 102.8 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641374
CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594TBZB - 600LM - 4000K

Luminous Intensity Polar Plot

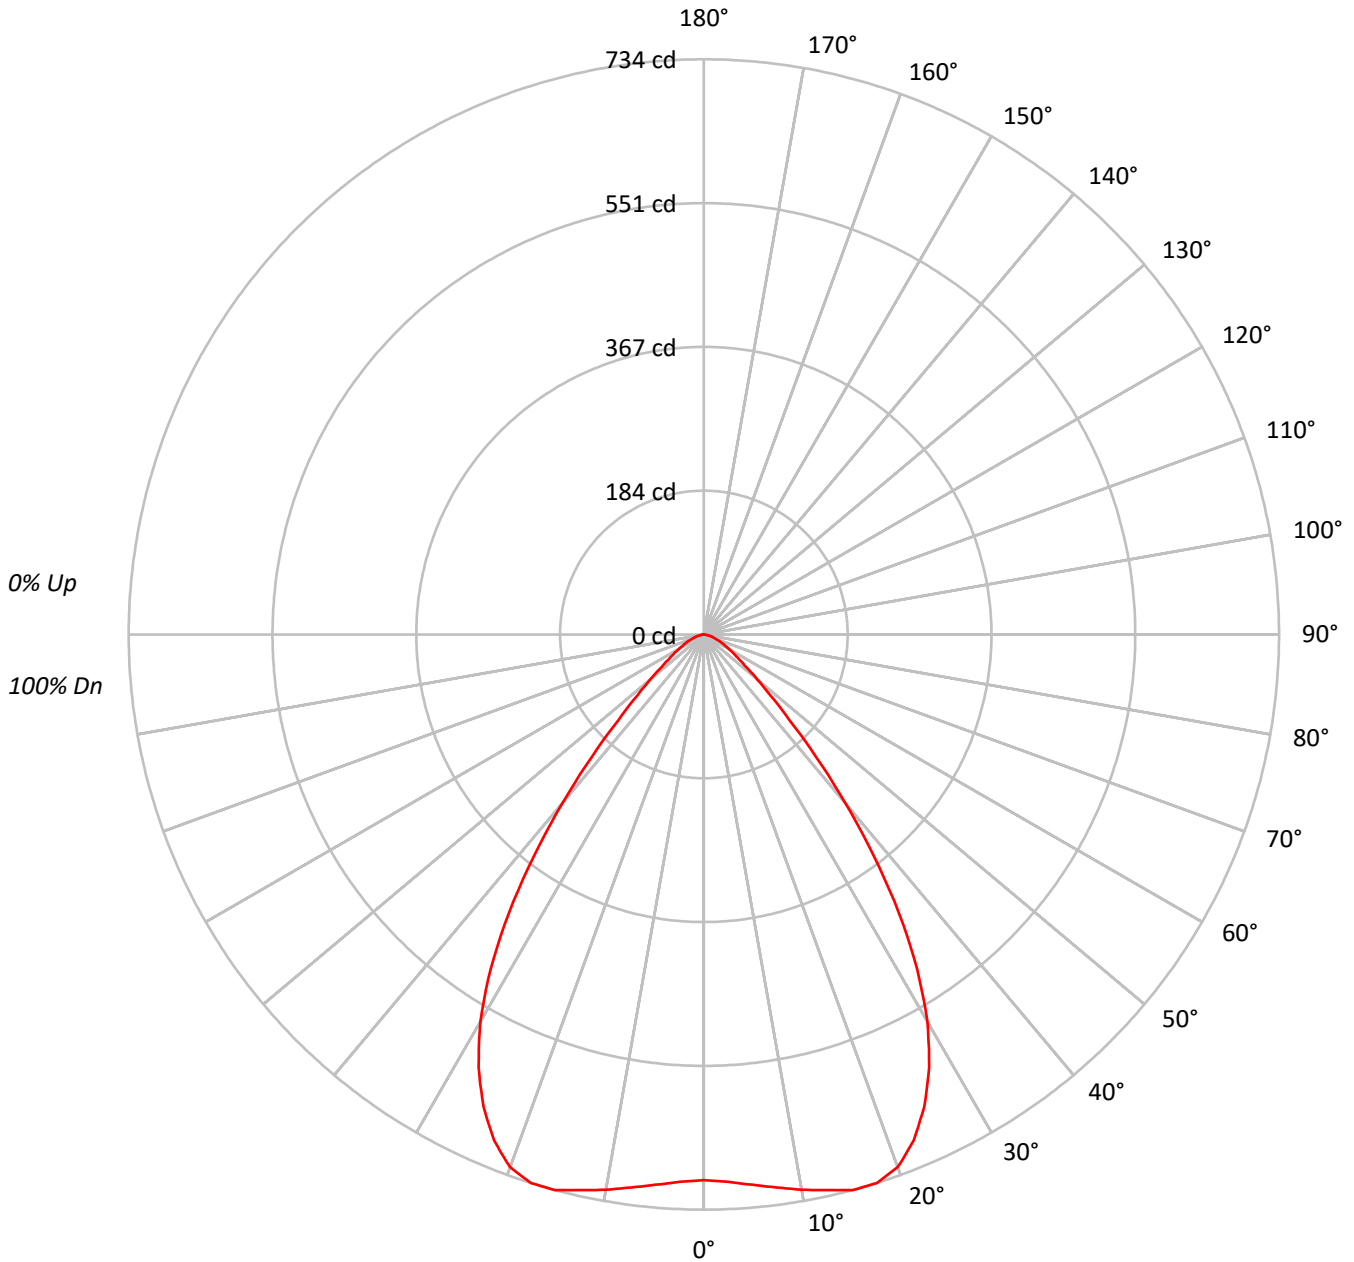



TEST NUMBER: P641374

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594TBZB - 600LM - 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	104	110	107	104	102	103	101	99	99	98	96	96	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	84	83			
3	99	92	86	81	97	90	85	80	87	83	79	85	81	78	83	79	77	75			
4	93	84	78	73	91	83	77	72	81	76	72	79	74	71	77	73	70	68			
5	87	78	71	66	86	77	70	66	75	69	65	73	68	64	71	67	64	62			
6	82	72	65	60	81	71	64	60	69	64	59	68	63	59	67	62	58	57			
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52			
8	73	62	55	50	72	61	55	50	60	54	50	59	54	50	58	53	50	48			
9	69	58	51	47	68	57	51	47	56	50	46	55	50	46	54	50	46	44			
10	65	54	48	43	64	54	47	43	53	47	43	52	47	43	51	46	43	41			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	54959
5°	55858
10°	57666
15°	59978
20°	60762
25°	57949
30°	52003
35°	41843
40°	28895
45°	17271
50°	10930
55°	7446
60°	5794
65°	4688
70°	3785
75°	2959
80°	1773
85°	906

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 17271 cd/sqm



TEST NUMBER: P641374

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594TBZB - 600LM - 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	67.7	6.4
10°-20°	206.7	19.5
20°-30°	302.7	28.6
30°-40°	266.9	25.2
40°-50°	126.8	12.0
50°-60°	51.0	4.8
60°-70°	25.2	2.4
70°-80°	10.3	1.0
80°-90°	1.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	577.2	54.5
0°-40°	844.0	79.7
0°-60°	1021.8	96.5
0°-90°	1058.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1058.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	696	
5°	705	68
15°	734	207
25°	665	303
35°	434	267
45°	155	127
55°	54	51
65°	25	25
75°	10	10
85°	1	1
90°	0	



TEST NUMBER: P641374

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 594TBZB - 600LM - 4000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	696.2
2.5°	699.1
5°	704.9
7.5°	711.7
10°	719.4
12.5°	726.2
15°	733.9
17.5°	733.9
20°	723.3
22.5°	699.1
25°	665.3
27.5°	622.7
30°	570.5
32.5°	506.7
35°	434.2
37.5°	355.8
40°	280.4
42.5°	210.8
45°	154.7
47.5°	115.1
50°	89.0
52.5°	67.7
55°	54.1
57.5°	44.5
60°	36.7
62.5°	30.0
65°	25.1
67.5°	20.3
70°	16.4
72.5°	12.6
75°	9.7
77.5°	6.8
80°	3.9
82.5°	1.9
85°	1.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)