

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641492

Luminaire Tested: ML5612LSVWFL7597FS1E - 693SNB - 600LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641492
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-88)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 693SNB - 600LM - 3000K
Description: ML56 RR, 75D TIR OPTIC, 6" SATIN NICKLE BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 939.5 lumens
Efficiency: N/A
Efficacy: 91.2 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.09
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641492

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693SNB - 600LM - 3000K

Luminous Intensity Polar Plot

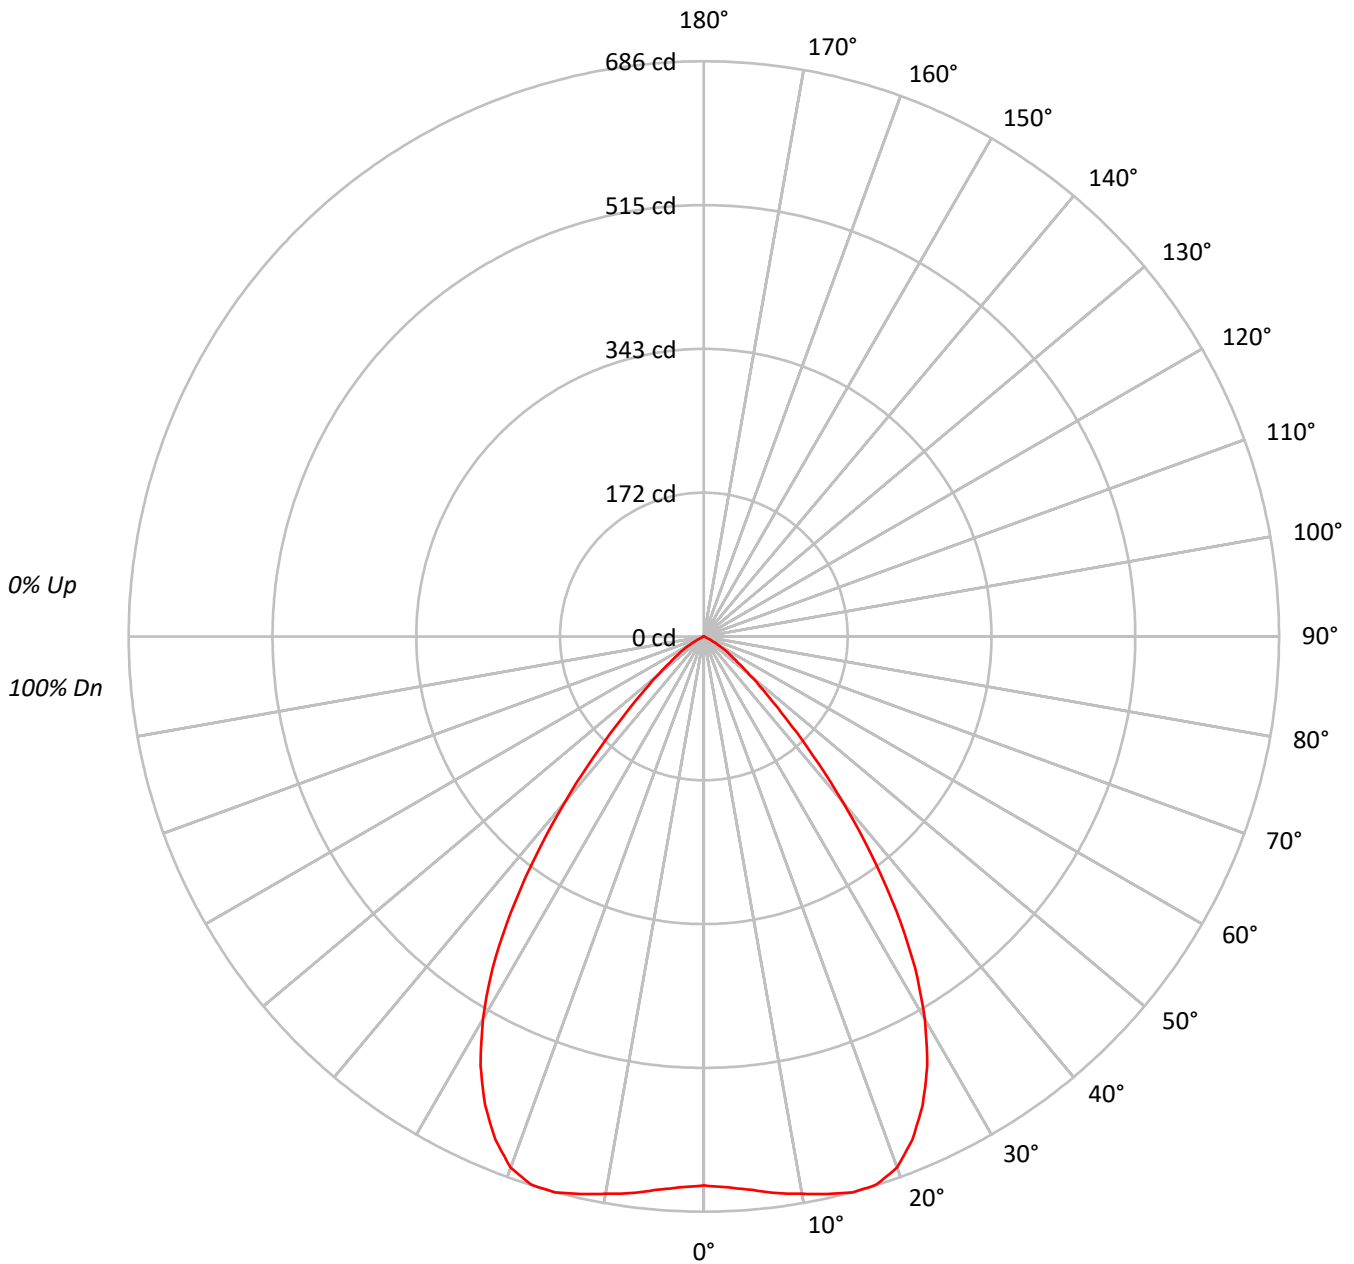



TEST NUMBER: P641492

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693SNB - 600LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	96	95	94	92					92			
2	107	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84					84			
3	100	93	88	83	98	92	87	83	89	85	81	87	83	80	84	81	79	77					77			
4	94	86	80	75	92	85	79	75	83	78	74	81	76	73	79	75	72	70					70			
5	89	80	73	68	87	79	72	68	77	71	67	75	70	67	73	69	66	64					64			
6	84	74	67	62	82	73	67	62	71	66	62	70	65	61	68	64	61	59					59			
7	79	68	62	57	77	68	61	57	66	61	57	65	60	56	64	59	56	54					54			
8	74	64	57	53	73	63	57	52	62	56	52	61	56	52	60	55	52	50					50			
9	70	60	53	49	69	59	53	48	58	52	48	57	52	48	56	51	48	46					46			
10	66	56	49	45	65	55	49	45	54	49	45	54	48	45	53	48	45	43					43			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	35896
5°	36468
10°	37569
15°	38950
20°	39320
25°	37327
30°	33360
35°	26829
40°	18420
45°	10722
50°	6123
55°	3680
60°	2017
65°	571
70°	144
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 10722 cd/sqm



TEST NUMBER: P641492

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693SNB - 600LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	63.7	6.8
10°-20°	193.3	20.6
20°-30°	280.8	29.9
30°-40°	246.4	26.2
40°-50°	113.3	12.1
50°-60°	36.0	3.8
60°-70°	5.8	0.6
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	537.8	57.2
0°-40°	784.3	83.5
0°-60°	933.5	99.4
0°-90°	939.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	939.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	655	
5°	663	64
15°	686	193
25°	617	281
35°	401	246
45°	138	113
55°	38	36
65°	4	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P641492

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693SNB - 600LM - 3000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	654.8
2.5°	657.4
5°	662.7
7.5°	669.7
10°	674.9
12.5°	681.1
15°	686.3
17.5°	685.4
20°	674.0
22.5°	649.5
25°	617.1
27.5°	576.9
30°	527.0
32.5°	469.2
35°	400.9
37.5°	328.3
40°	257.4
42.5°	192.6
45°	138.3
47.5°	99.8
50°	71.8
52.5°	50.8
55°	38.5
57.5°	28.0
60°	18.4
62.5°	8.8
65°	4.4
67.5°	0.9
70°	0.9
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)