

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641500

Luminaire Tested: ML5612LSVWFL7597FS1E - 693SNB - 900LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641500
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-88)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 693SNB - 900LM - 5000K
Description: ML56 RR, 75D TIR OPTIC, 6" SATIN NICKLE BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1332.6 lumens
Efficiency: N/A
Efficacy: 100.2 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.09
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 13.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641500

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693SNB - 900LM - 5000K

Luminous Intensity Polar Plot

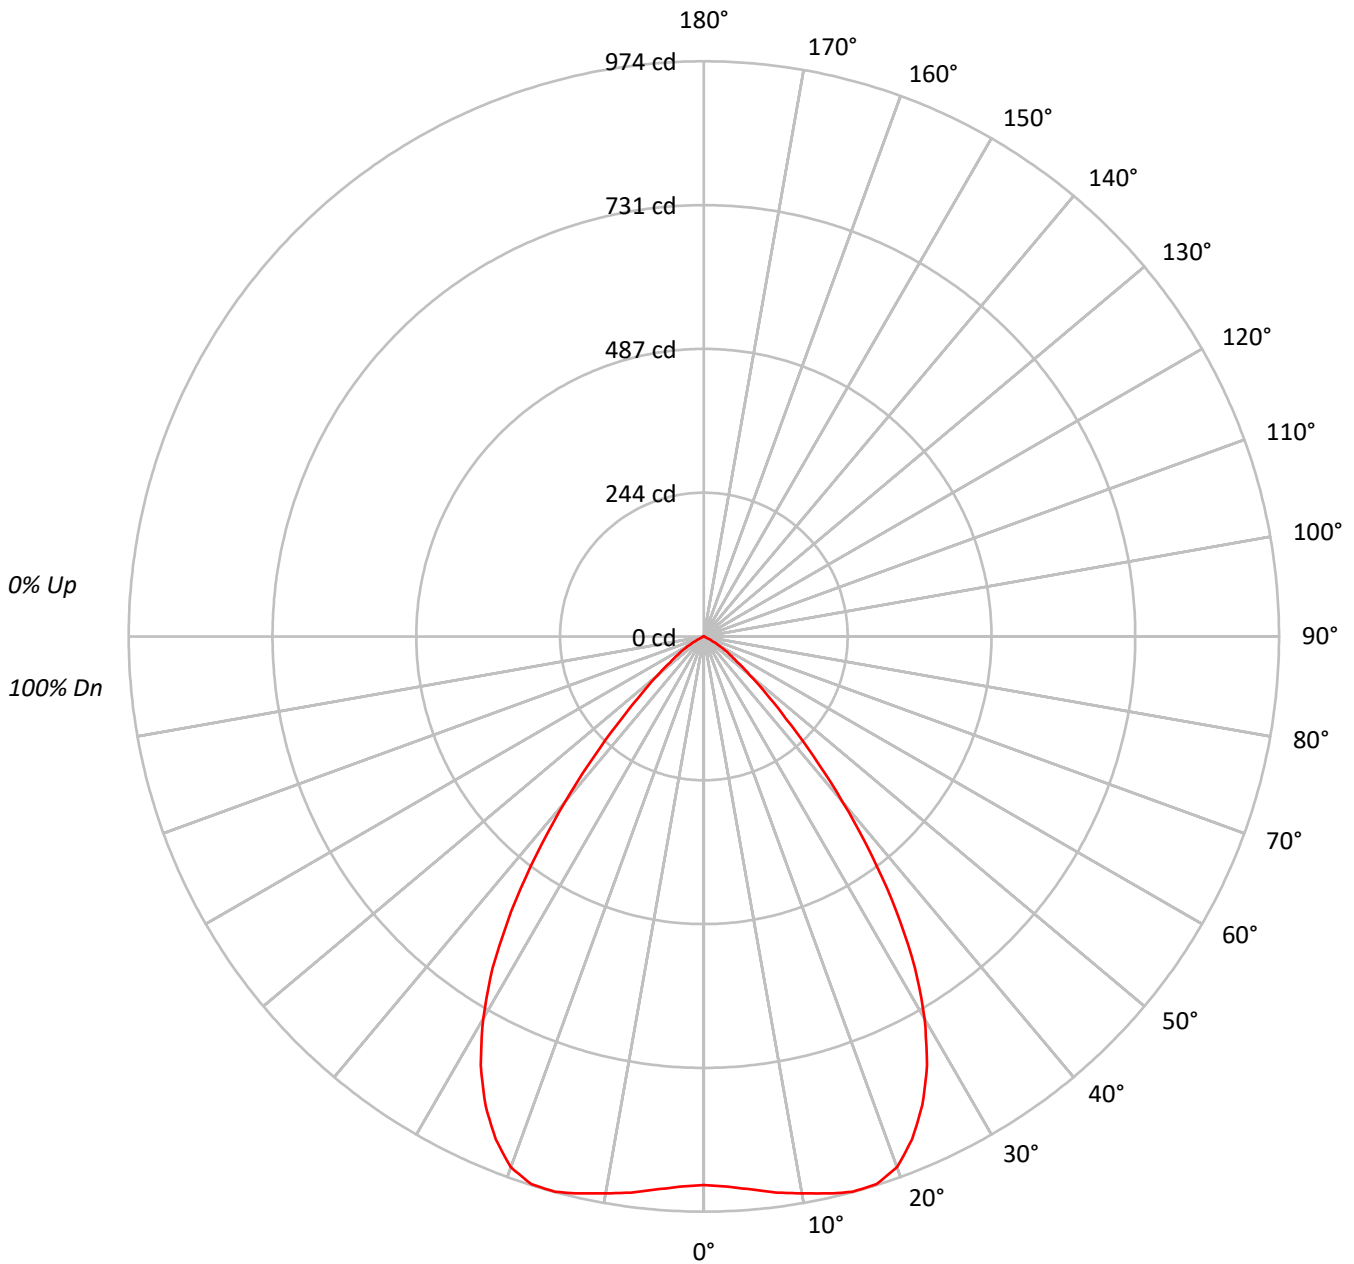



TEST NUMBER: P641500

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693SNB - 900LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1 | 113 | 110 | 107 | 105 | 110 | 108 | 105 | 103 | 104 | 102 | 100 | 100 | 98 | 97 | 96 | 95 | 94 | 92 | 92 | 92 | 92 |
| 2 | 107 | 101 | 97 | 93 | 104 | 99 | 95 | 92 | 96 | 93 | 90 | 93 | 90 | 88 | 90 | 88 | 86 | 84 | 84 | 84 | 84 |
| 3 | 100 | 93 | 88 | 83 | 98 | 92 | 87 | 83 | 89 | 85 | 81 | 87 | 83 | 80 | 84 | 81 | 79 | 77 | 77 | 77 | 77 |
| 4 | 94 | 86 | 80 | 75 | 92 | 85 | 79 | 75 | 83 | 78 | 74 | 81 | 76 | 73 | 79 | 75 | 72 | 70 | 70 | 70 | 70 |
| 5 | 89 | 80 | 73 | 68 | 87 | 79 | 72 | 68 | 77 | 71 | 67 | 75 | 70 | 67 | 73 | 69 | 66 | 64 | 64 | 64 | 64 |
| 6 | 84 | 74 | 67 | 62 | 82 | 73 | 67 | 62 | 71 | 66 | 62 | 70 | 65 | 61 | 68 | 64 | 61 | 59 | 59 | 59 | 59 |
| 7 | 79 | 68 | 62 | 57 | 77 | 68 | 61 | 57 | 66 | 61 | 57 | 65 | 60 | 56 | 64 | 59 | 56 | 54 | 54 | 54 | 54 |
| 8 | 74 | 64 | 57 | 53 | 73 | 63 | 57 | 52 | 62 | 56 | 52 | 61 | 56 | 52 | 60 | 55 | 52 | 50 | 50 | 50 | 50 |
| 9 | 70 | 60 | 53 | 49 | 69 | 59 | 53 | 49 | 58 | 52 | 48 | 57 | 52 | 48 | 56 | 51 | 48 | 46 | 46 | 46 | 46 |
| 10 | 66 | 56 | 49 | 45 | 65 | 55 | 49 | 45 | 54 | 49 | 45 | 54 | 48 | 45 | 53 | 48 | 45 | 43 | 43 | 43 | 43 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|-------|
| | 0° |
| 0° | 50917 |
| 5° | 51728 |
| 10° | 53294 |
| 15° | 55250 |
| 20° | 55783 |
| 25° | 52951 |
| 30° | 47317 |
| 35° | 38059 |
| 40° | 26128 |
| 45° | 15211 |
| 50° | 8682 |
| 55° | 5218 |
| 60° | 2862 |
| 65° | 804 |
| 70° | 192 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 15211 cd/sqm



TEST NUMBER: P641500

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693SNB - 900LM - 5000K

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 90.3 | 6.8 |
| 10°-20° | 274.2 | 20.6 |
| 20°-30° | 398.4 | 29.9 |
| 30°-40° | 349.6 | 26.2 |
| 40°-50° | 160.7 | 12.1 |
| 50°-60° | 51.0 | 3.8 |
| 60°-70° | 8.1 | 0.6 |
| 70°-80° | 0.2 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 762.9 | 57.3 |
| 0°-40° | 1112.5 | 83.5 |
| 0°-60° | 1324.2 | 99.4 |
| 0°-90° | 1332.6 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1332.6 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-----|------|
| 0° | 929 | |
| 5° | 940 | 90 |
| 15° | 974 | 274 |
| 25° | 875 | 398 |
| 35° | 569 | 350 |
| 45° | 196 | 161 |
| 55° | 55 | 51 |
| 65° | 6 | 8 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P641500

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693SNB - 900LM - 5000K

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|-------|
| 0° | 928.8 |
| 2.5° | 932.6 |
| 5° | 940.0 |
| 7.5° | 950.0 |
| 10° | 957.4 |
| 12.5° | 966.1 |
| 15° | 973.5 |
| 17.5° | 972.3 |
| 20° | 956.2 |
| 22.5° | 921.4 |
| 25° | 875.4 |
| 27.5° | 818.3 |
| 30° | 747.5 |
| 32.5° | 665.6 |
| 35° | 568.7 |
| 37.5° | 465.7 |
| 40° | 365.1 |
| 42.5° | 273.2 |
| 45° | 196.2 |
| 47.5° | 141.6 |
| 50° | 101.8 |
| 52.5° | 72.0 |
| 55° | 54.6 |
| 57.5° | 39.7 |
| 60° | 26.1 |
| 62.5° | 12.4 |
| 65° | 6.2 |
| 67.5° | 1.2 |
| 70° | 1.2 |
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)