

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641517

Luminaire Tested: ML5612LSVWFL7597FS1E - 693WB - 1200LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641517
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-86)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 693WB - 1200LM - 3000K
Description: ML56 RR, 75D TIR OPTIC, 6" WHITE BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1476.7 lumens
Efficiency: N/A
Efficacy: 89.5 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.09
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641517
CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693WB - 1200LM - 3000K

Luminous Intensity Polar Plot

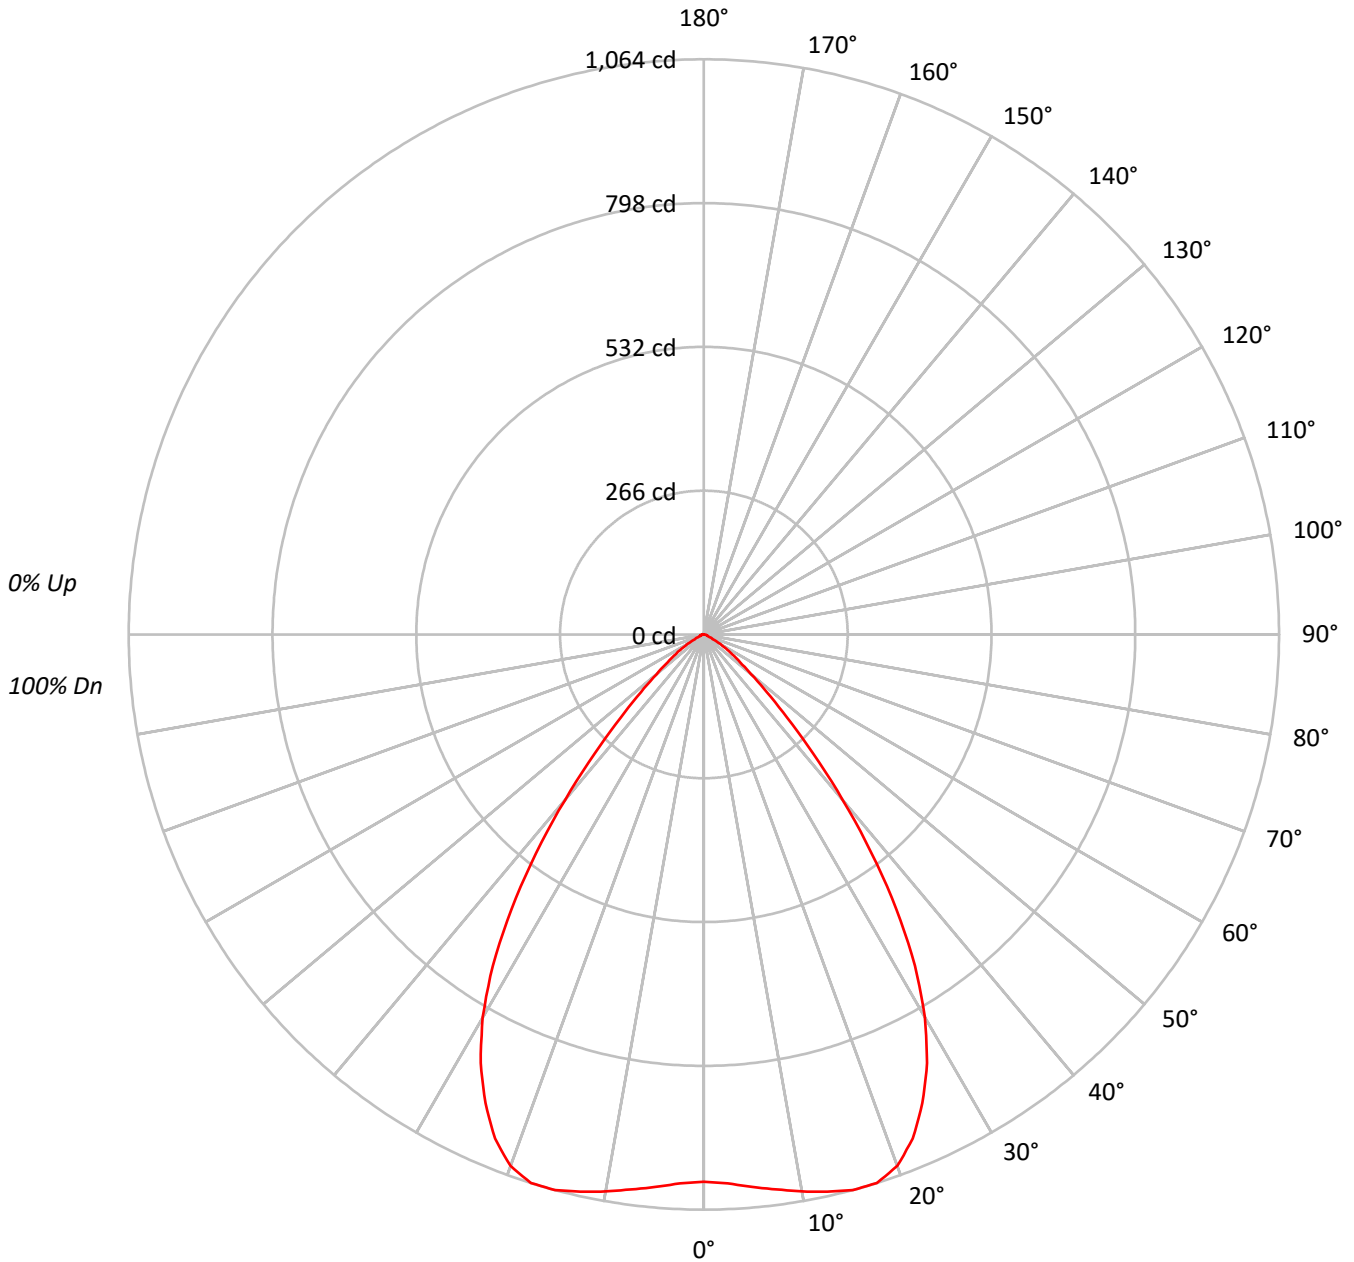



TEST NUMBER: P641517

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693WB - 1200LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	113	110	107	104	110	107	105	103	103	101	100		100	98	97		96	95	94	92
2	106	101	96	92	104	99	95	91	96	92	89		93	90	87		90	88	86	84
3	100	93	87	83	98	91	86	82	89	84	81		86	82	79		84	81	78	76
4	94	85	79	74	92	84	78	74	82	77	73		80	76	72		78	74	71	70
5	88	79	72	67	87	78	72	67	76	71	67		74	70	66		73	69	65	64
6	83	73	66	62	82	72	66	61	71	65	61		69	64	60		68	63	60	58
7	78	68	61	56	77	67	61	56	66	60	56		65	59	56		63	59	55	54
8	74	63	57	52	73	63	56	52	61	56	52		60	55	51		59	55	51	50
9	70	59	52	48	69	59	52	48	58	52	48		57	51	48		56	51	47	46
10	66	55	49	45	65	55	49	44	54	48	44		53	48	44		52	48	44	43

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	55494
5°	56449
10°	58238
15°	60381
20°	61034
25°	57856
30°	51780
35°	41553
40°	28589
45°	16854
50°	9731
55°	6107
60°	3728
65°	1764
70°	1090
75°	1144
80°	1294
85°	881

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 16854 cd/sqm



TEST NUMBER: P641517

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693WB - 1200LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	98.5	6.7
10°-20°	299.8	20.3
20°-30°	435.7	29.5
30°-40°	382.1	25.9
40°-50°	177.2	12.0
50°-60°	60.1	4.1
60°-70°	15.0	1.0
70°-80°	6.1	0.4
80°-90°	2.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	834.1	56.5
0°-40°	1216.2	82.4
0°-60°	1453.5	98.4
0°-90°	1476.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1476.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1012	
5°	1026	99
15°	1064	300
25°	956	436
35°	621	382
45°	217	177
55°	64	60
65°	14	15
75°	5	6
85°	1	2
90°	0	



TEST NUMBER: P641517

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 693WB - 1200LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1012.3
2.5°	1016.3
5°	1025.8
7.5°	1035.4
10°	1046.2
12.5°	1055.7
15°	1063.9
17.5°	1063.9
20°	1046.2
22.5°	1009.5
25°	956.5
27.5°	894.0
30°	818.0
32.5°	726.9
35°	620.9
37.5°	509.5
40°	399.5
42.5°	298.9
45°	217.4
47.5°	157.6
50°	114.1
52.5°	84.2
55°	63.9
57.5°	48.9
60°	34.0
62.5°	19.0
65°	13.6
67.5°	8.2
70°	6.8
72.5°	6.8
75°	5.4
77.5°	5.4
80°	4.1
82.5°	2.7
85°	1.4
87.5°	1.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)