

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641573

Luminaire Tested: ML5612LSVWFL7597FS1E - 696WB - 900LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641573
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-92)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL7597FS1E - 696WB - 900LM - 3500K
Description: ML56 RR, 75D TIR OPTIC, 6" SHALLOW WHITE BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1264.6 lumens
Efficiency: N/A
Efficacy: 95.1 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.09
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 13.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641573

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 696WB - 900LM - 3500K

Luminous Intensity Polar Plot

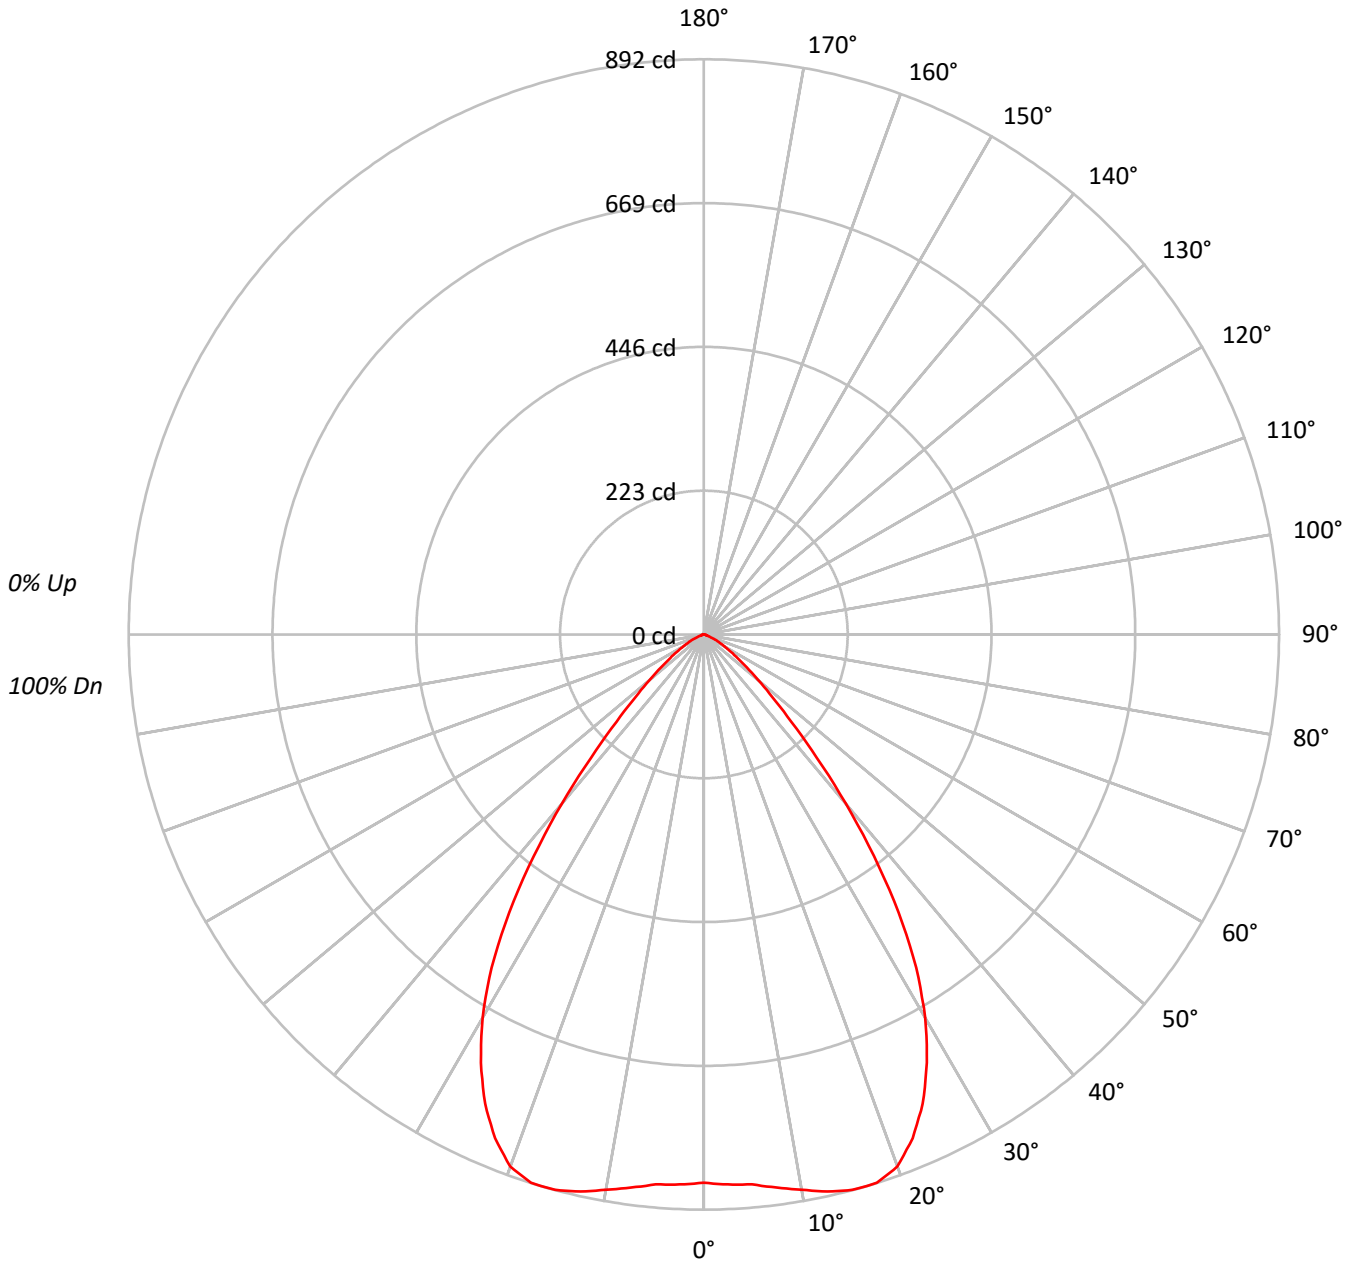



TEST NUMBER: P641573

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 696WB - 900LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	107	104	110	107	105	103	103	101	99	99	98	96	96	95	94	92			
2	106	100	96	92	104	99	94	91	95	92	89	92	89	87	90	87	85	83			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	77	76			
4	94	85	79	74	92	84	78	73	81	76	72	79	75	71	77	74	71	69			
5	88	78	72	67	86	77	71	66	75	70	66	74	69	65	72	68	65	63			
6	83	73	66	61	81	72	65	61	70	64	60	69	64	60	67	63	59	58			
7	78	67	60	56	76	67	60	55	65	59	55	64	59	55	63	58	55	53			
8	73	63	56	51	72	62	56	51	61	55	51	60	54	51	59	54	50	49			
9	69	58	52	47	68	58	52	47	57	51	47	56	51	47	55	50	47	45			
10	66	55	48	44	64	54	48	44	53	48	44	52	47	43	52	47	43	42			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	46614
5°	47105
10°	48680
15°	50608
20°	51215
25°	48571
30°	43469
35°	35235
40°	24489
45°	14831
50°	9433
55°	6060
60°	4046
65°	2685
70°	1298
75°	741
80°	726
85°	755

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 14831 cd/sqm



TEST NUMBER: P641573

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 696WB - 900LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	82.4	6.5
10°-20°	251.3	19.9
20°-30°	365.4	28.9
30°-40°	323.5	25.6
40°-50°	156.3	12.4
50°-60°	59.6	4.7
60°-70°	20.6	1.6
70°-80°	4.1	0.3
80°-90°	1.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	699.0	55.3
0°-40°	1022.5	80.9
0°-60°	1238.4	97.9
0°-90°	1264.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1264.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	850	
5°	856	82
15°	892	251
25°	803	365
35°	526	323
45°	191	156
55°	63	60
65°	21	21
75°	4	4
85°	1	2
90°	0	



TEST NUMBER: P641573

CATALOG NUMBER: ML5612LSVWFL7597FS1E - 696WB - 900LM - 3500K

CANDELA DISTRIBUTION (FULL):

	0°
0°	850.3
2.5°	853.7
5°	856.0
7.5°	865.2
10°	874.5
12.5°	884.8
15°	891.7
17.5°	891.7
20°	877.9
22.5°	845.7
25°	803.0
27.5°	748.9
30°	686.7
32.5°	612.9
35°	526.5
37.5°	433.2
40°	342.2
42.5°	259.2
45°	191.3
47.5°	142.9
50°	110.6
52.5°	84.1
55°	63.4
57.5°	47.2
60°	36.9
62.5°	27.7
65°	20.7
67.5°	12.7
70°	8.1
72.5°	4.6
75°	3.5
77.5°	2.3
80°	2.3
82.5°	2.3
85°	1.2
87.5°	1.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)