

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641593

Luminaire Tested: ML5612LSVWFL97FS1E - 592H - 1200LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641593
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-95)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL97FS1E - 592H - 1200LM - 3500K
Description: ML56 RR, MILKY OPTIC, 5" HAZE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1368.1 lumens
Efficiency: N/A
Efficacy: 82.9 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.97
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641593

CATALOG NUMBER: ML5612LSVWFL97FS1E - 592H - 1200LM - 3500K

Luminous Intensity Polar Plot

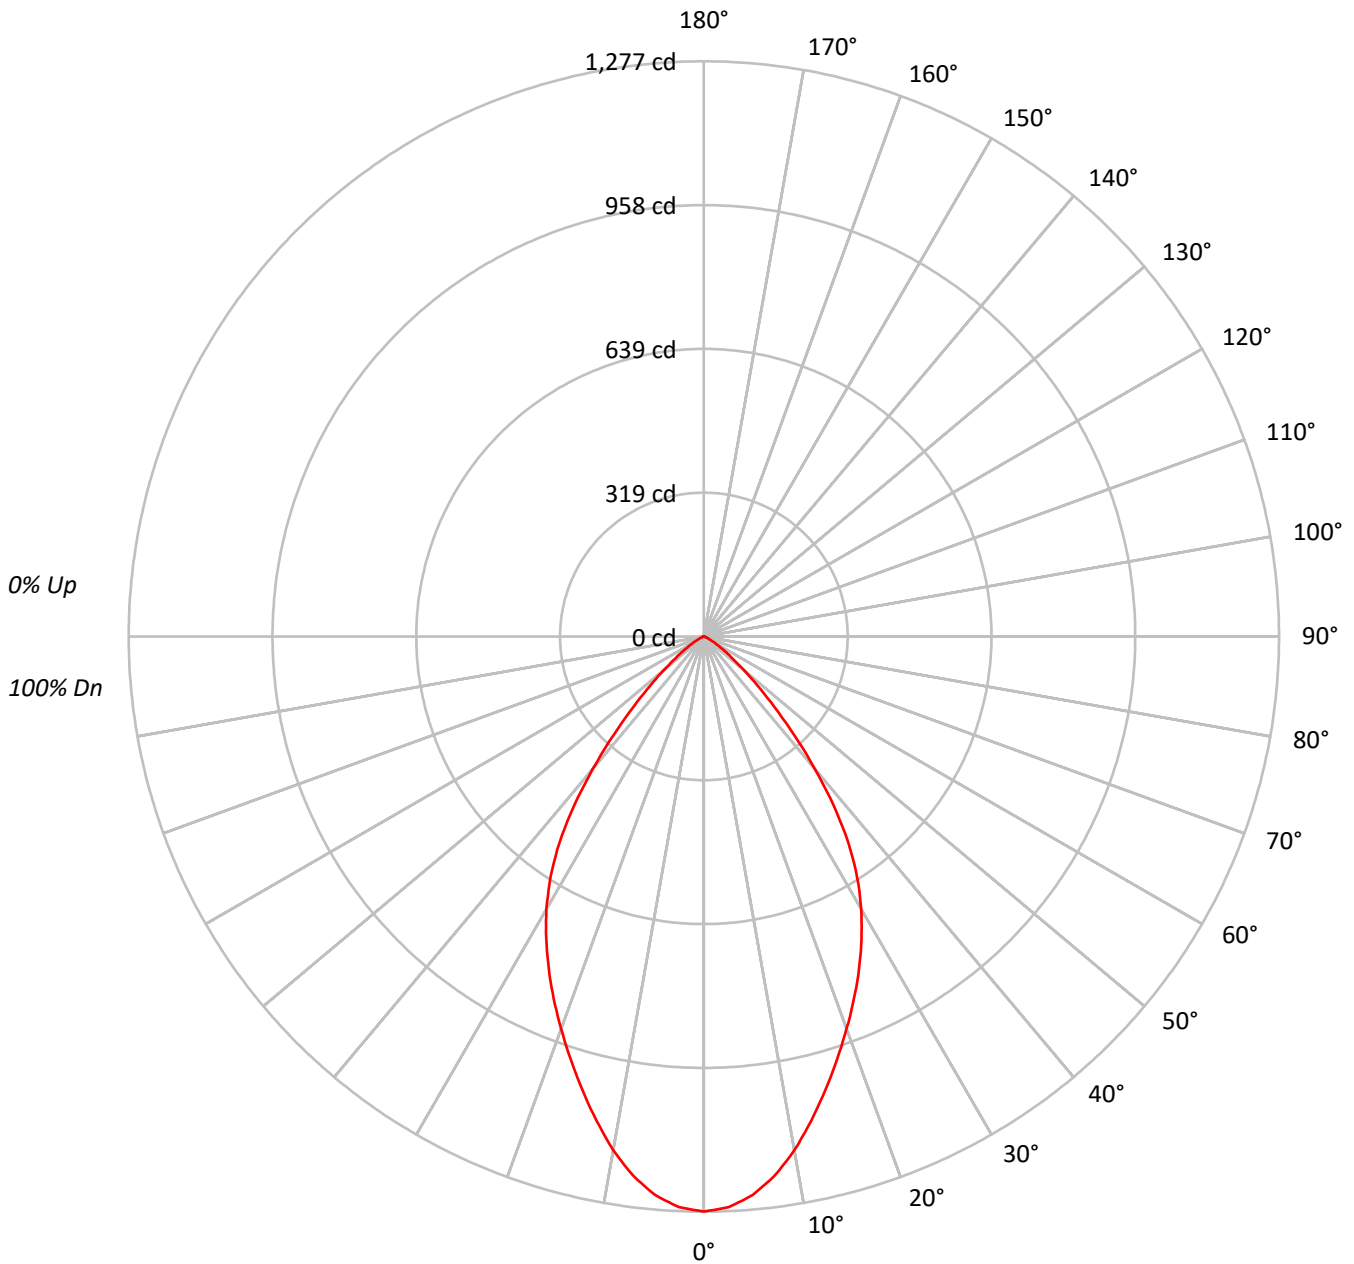



TEST NUMBER: P641593

CATALOG NUMBER: ML5612LSVWFL97FS1E - 592H - 1200LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	96	95	94	92	92	92	92
2	107	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84	84	84	84
3	100	93	88	83	98	92	87	83	89	85	81	87	83	80	84	81	79	77	77	77	77
4	95	86	80	75	93	85	79	75	83	78	74	81	76	73	79	75	72	71	71	71	71
5	89	80	73	68	87	79	73	68	77	72	68	75	71	67	74	70	66	65	65	65	65
6	84	74	67	63	82	73	67	62	72	66	62	70	65	62	69	64	61	60	60	60	60
7	79	69	62	58	78	68	62	57	67	61	57	66	61	57	64	60	56	55	55	55	55
8	75	64	58	53	73	64	57	53	63	57	53	61	56	53	60	56	52	51	51	51	51
9	71	60	54	49	70	60	53	49	59	53	49	58	53	49	57	52	49	47	47	47	47
10	67	56	50	46	66	56	50	46	55	50	46	54	49	46	54	49	45	44	44	44	44

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	100792
5°	98633
10°	92840
15°	85191
20°	77841
25°	70979
30°	63725
35°	53928
40°	39406
45°	24616
50°	14049
55°	7680
60°	3963
65°	1831
70°	969
75°	427
80°	636
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 24616 cd/sqm



TEST NUMBER: P641593

CATALOG NUMBER: ML5612LSVWFL97FS1E - 592H - 1200LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.0	8.5
10°-20°	292.1	21.4
20°-30°	373.7	27.3
30°-40°	342.7	25.0
40°-50°	176.3	12.9
50°-60°	53.7	3.9
60°-70°	11.1	0.8
70°-80°	2.2	0.2
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	781.9	57.2
0°-40°	1124.6	82.2
0°-60°	1354.6	99.0
0°-90°	1368.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1368.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1277	
5°	1245	116
15°	1042	292
25°	815	374
35°	560	343
45°	220	176
55°	56	54
65°	10	11
75°	1	2
85°	0	0
90°	0	



TEST NUMBER: P641593

CATALOG NUMBER: ML5612LSVWFL97FS1E - 592H - 1200LM - 3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1276.8
2.5°	1268.5
5°	1244.7
7.5°	1207.1
10°	1158.2
12.5°	1101.0
15°	1042.4
17.5°	983.8
20°	926.6
22.5°	870.8
25°	814.9
27.5°	757.7
30°	699.1
32.5°	633.5
35°	559.6
37.5°	473.1
40°	382.4
42.5°	295.8
45°	220.5
47.5°	160.5
50°	114.4
52.5°	79.5
55°	55.8
57.5°	37.7
60°	25.1
62.5°	15.3
65°	9.8
67.5°	5.6
70°	4.2
72.5°	2.8
75°	1.4
77.5°	1.4
80°	1.4
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)