

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641619

Luminaire Tested: ML5612LSVWFL97FS1E - 592SC - 900LM - 4000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641619
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-94)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL97FS1E - 592SC - 900LM - 4000K
Description: ML56 RR, MILKY OPTIC, 5" SPECULAR CLEAR TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1253.9 lumens
Efficiency: N/A
Efficacy: 94.3 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.95
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 13.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641619

CATALOG NUMBER: ML5612LSVWFL97FS1E - 592SC - 900LM - 4000K

Luminous Intensity Polar Plot

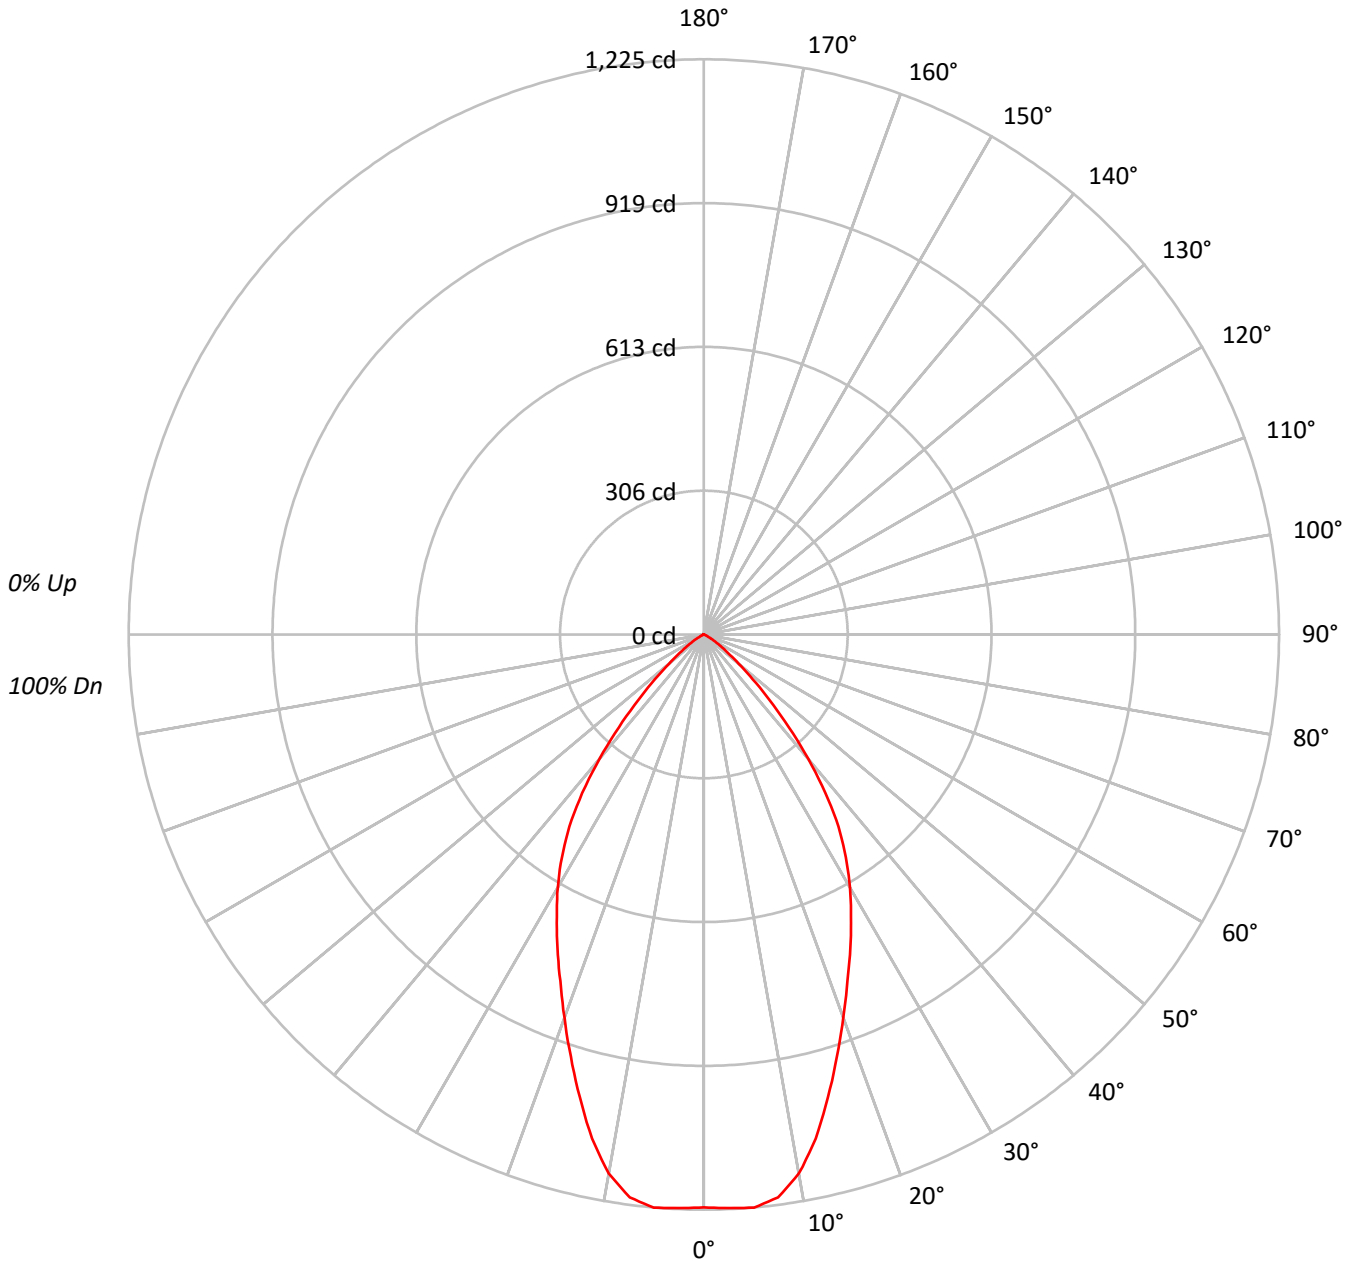



TEST NUMBER: P641619

CATALOG NUMBER: ML5612LSVWFL97FS1E - 592SC - 900LM - 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20																	
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR																																													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																											
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93																											
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85																											
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	79	78																											
4	95	87	81	76	93	86	80	76	83	79	75	81	77	74	79	76	73	71																											
5	90	81	74	69	88	80	74	69	78	73	69	76	71	68	74	70	67	66																											
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	65	62	61																											
7	80	70	63	59	79	69	63	59	68	62	58	67	62	58	65	61	58	56																											
8	76	65	59	54	74	65	59	54	64	58	54	63	57	54	62	57	54	52																											
9	72	61	55	51	70	61	55	50	60	54	50	59	54	50	58	53	50	48																											
10	68	58	51	47	67	57	51	47	56	51	47	55	50	47	55	50	47	45																											

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	96332
5°	97096
10°	93449
15°	83417
20°	72927
25°	64272
30°	56752
35°	48165
40°	35532
45°	22015
50°	11876
55°	5973
60°	2747
65°	1158
70°	577
75°	366
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 22015 cd/sqm



TEST NUMBER: P641619

CATALOG NUMBER: ML5612LSVWFL97FS1E - 592SC - 900LM - 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	115.1	9.2
10°-20°	284.8	22.7
20°-30°	339.3	27.1
30°-40°	306.3	24.4
40°-50°	157.5	12.6
50°-60°	42.7	3.4
60°-70°	7.0	0.6
70°-80°	1.3	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	739.1	58.9
0°-40°	1045.4	83.4
0°-60°	1245.7	99.3
0°-90°	1253.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1253.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1220	
5°	1225	115
15°	1021	285
25°	738	339
35°	500	306
45°	197	158
55°	43	43
65°	6	7
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P641619

CATALOG NUMBER: ML5612LSVWFL97FS1E - 592SC - 900LM - 4000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1220.3
2.5°	1222.8
5°	1225.3
7.5°	1209.2
10°	1165.8
12.5°	1100.0
15°	1020.7
17.5°	942.5
20°	868.1
22.5°	798.7
25°	737.9
27.5°	678.4
30°	622.6
32.5°	563.0
35°	499.8
37.5°	425.4
40°	344.8
42.5°	267.9
45°	197.2
47.5°	141.4
50°	96.7
52.5°	64.5
55°	43.4
57.5°	28.5
60°	17.4
62.5°	9.9
65°	6.2
67.5°	2.5
70°	2.5
72.5°	1.2
75°	1.2
77.5°	1.2
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)