

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641673

Luminaire Tested: ML5612LSVWFL97FS1E - 593TBZB - 600LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641673
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-100)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL97FS1E - 593TBZB - 600LM - 3500K
Description: ML56 RR, MILKY OPTIC, 5" TUSCON BRONZE BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 659.5 lumens
Efficiency: N/A
Efficacy: 64.0 lumens/watt
Spacing Criteria (0/90/45): 1.15 / 1.15 / 1.12
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641673
CATALOG NUMBER: ML5612LSVWFL97FS1E - 593TBZB - 600LM - 3500K

Luminous Intensity Polar Plot

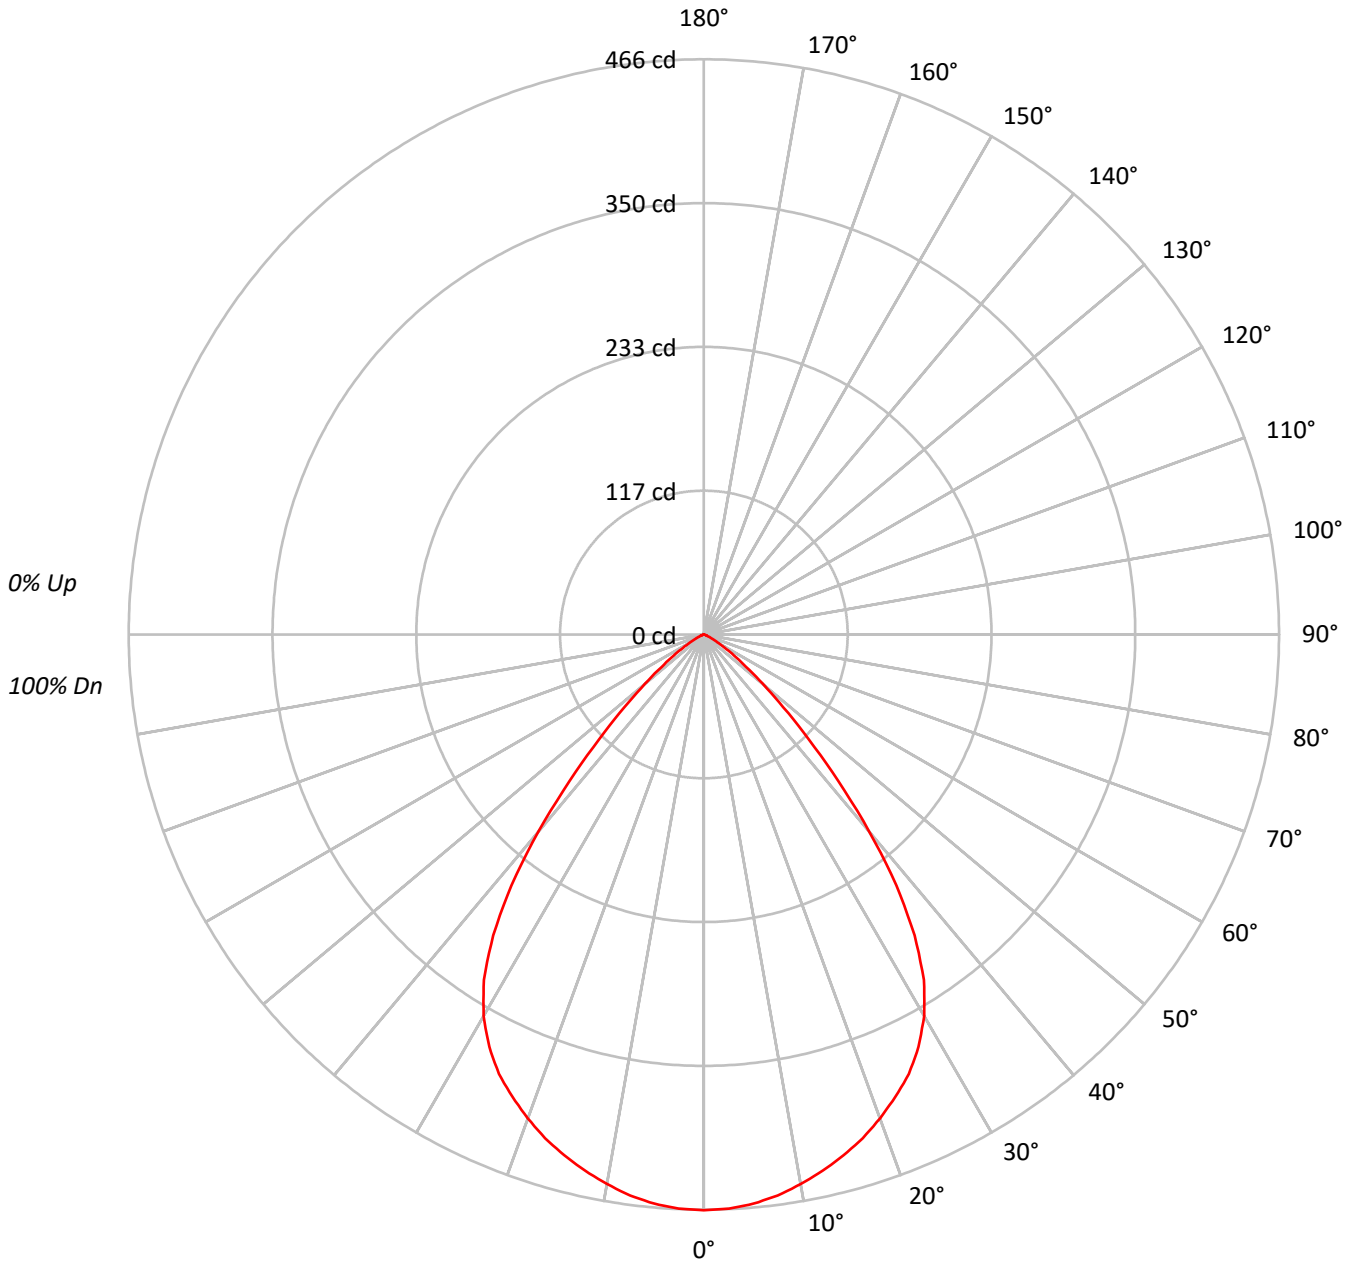



TEST NUMBER: P641673

CATALOG NUMBER: ML5612LSVWFL97FS1E - 593TBZB - 600LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	104	110	107	105	103	103	101	100	100	98	97	96	95	94	92	92	92	92
2	106	101	96	92	104	99	95	91	96	92	89	92	90	87	90	87	85	84	84	84	84
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76	76	76	76
4	94	85	79	74	92	84	78	73	81	76	72	79	75	71	77	74	71	69	69	69	69
5	88	78	72	67	86	77	71	66	75	70	66	74	69	65	72	68	64	63	63	63	63
6	83	72	65	61	81	71	65	60	70	64	60	68	63	59	67	62	59	57	57	57	57
7	78	67	60	55	76	66	60	55	65	59	55	64	58	54	62	58	54	53	53	53	53
8	73	62	55	51	72	62	55	51	60	55	50	59	54	50	58	53	50	48	48	48	48
9	69	58	51	47	68	57	51	47	56	51	46	55	50	46	55	50	46	45	45	45	45
10	65	54	48	43	64	54	47	43	53	47	43	52	47	43	51	46	43	41	41	41	41

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	36826
5°	36681
10°	36240
15°	35706
20°	35039
25°	34214
30°	32533
35°	28670
40°	21486
45°	13352
50°	7614
55°	4088
60°	1989
65°	841
70°	415
75°	275
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13352 cd/sqm



TEST NUMBER: P641673

CATALOG NUMBER: ML5612LSVWFL97FS1E - 593TBZB - 600LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	43.8	6.6
10°-20°	123.1	18.7
20°-30°	179.9	27.3
30°-40°	181.6	27.5
40°-50°	95.8	14.5
50°-60°	28.7	4.4
60°-70°	5.5	0.8
70°-80°	0.9	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	346.9	52.6
0°-40°	528.5	80.1
0°-60°	653.1	99.0
0°-90°	659.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	659.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	466	
5°	463	44
15°	437	123
25°	393	180
35°	298	182
45°	120	96
55°	30	29
65°	4	6
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P641673

CATALOG NUMBER: ML5612LSVWFL97FS1E - 593TBZB - 600LM - 3500K

CANDELA DISTRIBUTION (FULL):

	0°
0°	466.5
2.5°	465.6
5°	462.9
7.5°	458.4
10°	452.1
12.5°	445.0
15°	436.9
17.5°	427.9
20°	417.1
22.5°	405.4
25°	392.8
27.5°	376.6
30°	356.9
32.5°	331.7
35°	297.5
37.5°	256.2
40°	208.5
42.5°	160.9
45°	119.6
47.5°	87.2
50°	62.0
52.5°	43.1
55°	29.7
57.5°	19.8
60°	12.6
62.5°	8.1
65°	4.5
67.5°	2.7
70°	1.8
72.5°	0.9
75°	0.9
77.5°	0.9
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)