

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641774

Luminaire Tested: ML5612LSVWFL97FS1E - 692H - 1200LM - 4000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641774
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-107)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSVWFL97FS1E - 692H - 1200LM - 4000K
Description: ML56 RR, MILKY OPTIC, 6" HAZE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1463.9 lumens
Efficiency: N/A
Efficacy: 88.7 lumens/watt
Spacing Criteria (0/90/45): 1.01 / 1.01 / 1.1
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641774
CATALOG NUMBER: ML5612LSVWFL97FS1E - 692H - 1200LM - 4000K

Luminous Intensity Polar Plot

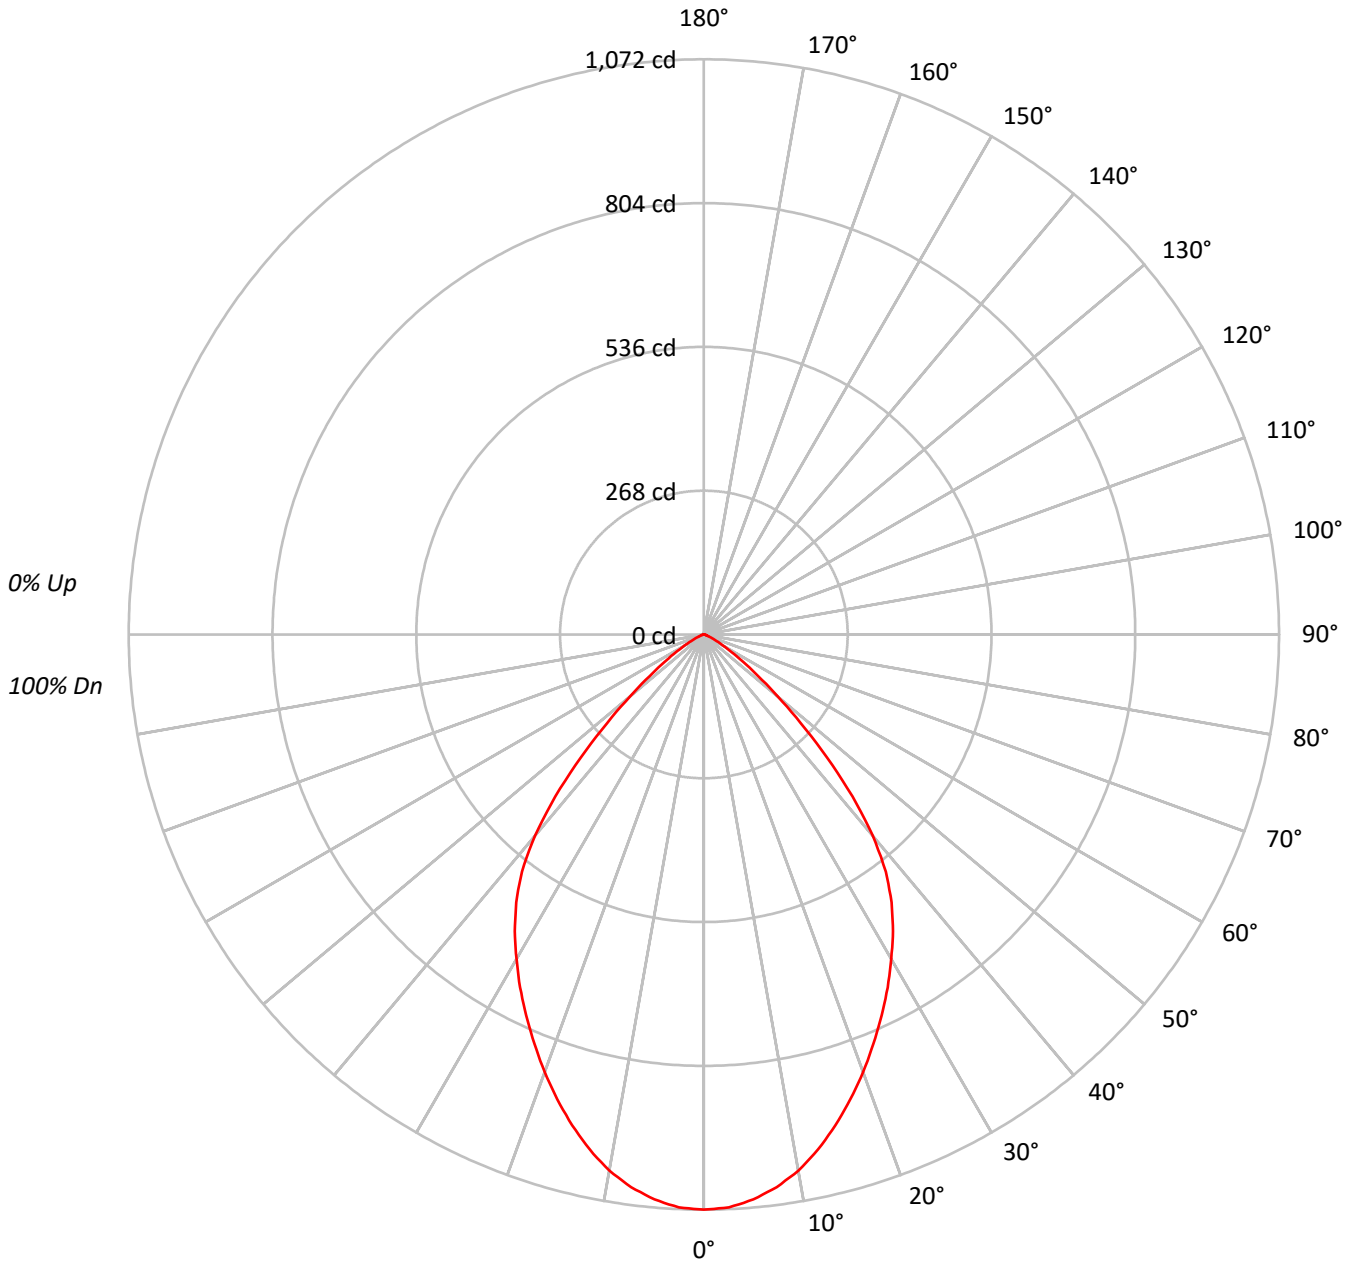



TEST NUMBER: P641774

CATALOG NUMBER: ML5612LSVWFL97FS1E - 692H - 1200LM - 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	104	110	107	105	102	103	101	99	99	98	96	96	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	84	83			
3	99	91	86	81	97	90	85	80	87	83	79	85	81	78	82	79	76	75			
4	93	84	77	72	91	83	77	72	80	75	71	78	74	70	76	72	69	67			
5	87	77	70	65	85	76	70	65	74	68	64	72	67	64	71	66	63	61			
6	81	71	64	59	80	70	64	59	69	63	58	67	62	58	66	61	57	56			
7	77	66	59	54	75	65	58	54	64	58	53	62	57	53	61	56	53	51			
8	72	61	54	49	71	60	54	49	59	53	49	58	53	49	57	52	48	47			
9	68	57	50	45	67	56	50	45	55	49	45	54	49	45	53	48	45	43			
10	64	53	46	42	63	52	46	42	52	46	42	51	45	41	50	45	41	40			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	58762
5°	58161
10°	56490
15°	53763
20°	50620
25°	47398
30°	44190
35°	40790
40°	35023
45°	25142
50°	15232
55°	8611
60°	4605
65°	2140
70°	1202
75°	953
80°	474
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 25142 cd/sqm



TEST NUMBER: P641774

CATALOG NUMBER: ML5612LSVWFL97FS1E - 692H - 1200LM - 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	99.6	6.8
10°-20°	265.7	18.2
20°-30°	360.3	24.6
30°-40°	377.0	25.8
40°-50°	250.8	17.1
50°-60°	86.2	5.9
60°-70°	19.3	1.3
70°-80°	4.3	0.3
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	725.6	49.6
0°-40°	1102.6	75.3
0°-60°	1439.6	98.3
0°-90°	1463.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1463.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1072	
5°	1057	100
15°	947	266
25°	784	360
35°	610	377
45°	324	251
55°	90	86
65°	16	19
75°	4	4
85°	0	1
90°	0	



TEST NUMBER: P641774

CATALOG NUMBER: ML5612LSVWFL97FS1E - 692H - 1200LM - 4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1071.9
2.5°	1068.9
5°	1056.9
7.5°	1038.8
10°	1014.8
12.5°	983.3
15°	947.3
17.5°	908.2
20°	867.7
22.5°	825.7
25°	783.6
27.5°	741.6
30°	698.1
32.5°	656.0
35°	609.5
37.5°	557.0
40°	489.4
42.5°	409.8
45°	324.3
47.5°	244.7
50°	178.6
52.5°	127.6
55°	90.1
57.5°	61.5
60°	42.0
62.5°	27.0
65°	16.5
67.5°	10.5
70°	7.5
72.5°	4.5
75°	4.5
77.5°	3.0
80°	1.5
82.5°	1.5
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)