

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641932

Luminaire Tested: ML5612LSWFL5597FS1E - 591WB - 900LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641932
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-47)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSWFL5597FS1E - 591WB - 900LM - 3000K
Description: ML56 RR, 55D TIR OPTIC, 5" DEADFRONT TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1265.9 lumens
Efficiency: N/A
Efficacy: 95.2 lumens/watt
Spacing Criteria (0/90/45): 0.86 / 0.86 / 0.89
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 13.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641932
CATALOG NUMBER: ML5612LSWFL5597FS1E - 591WB - 900LM - 3000K

Luminous Intensity Polar Plot

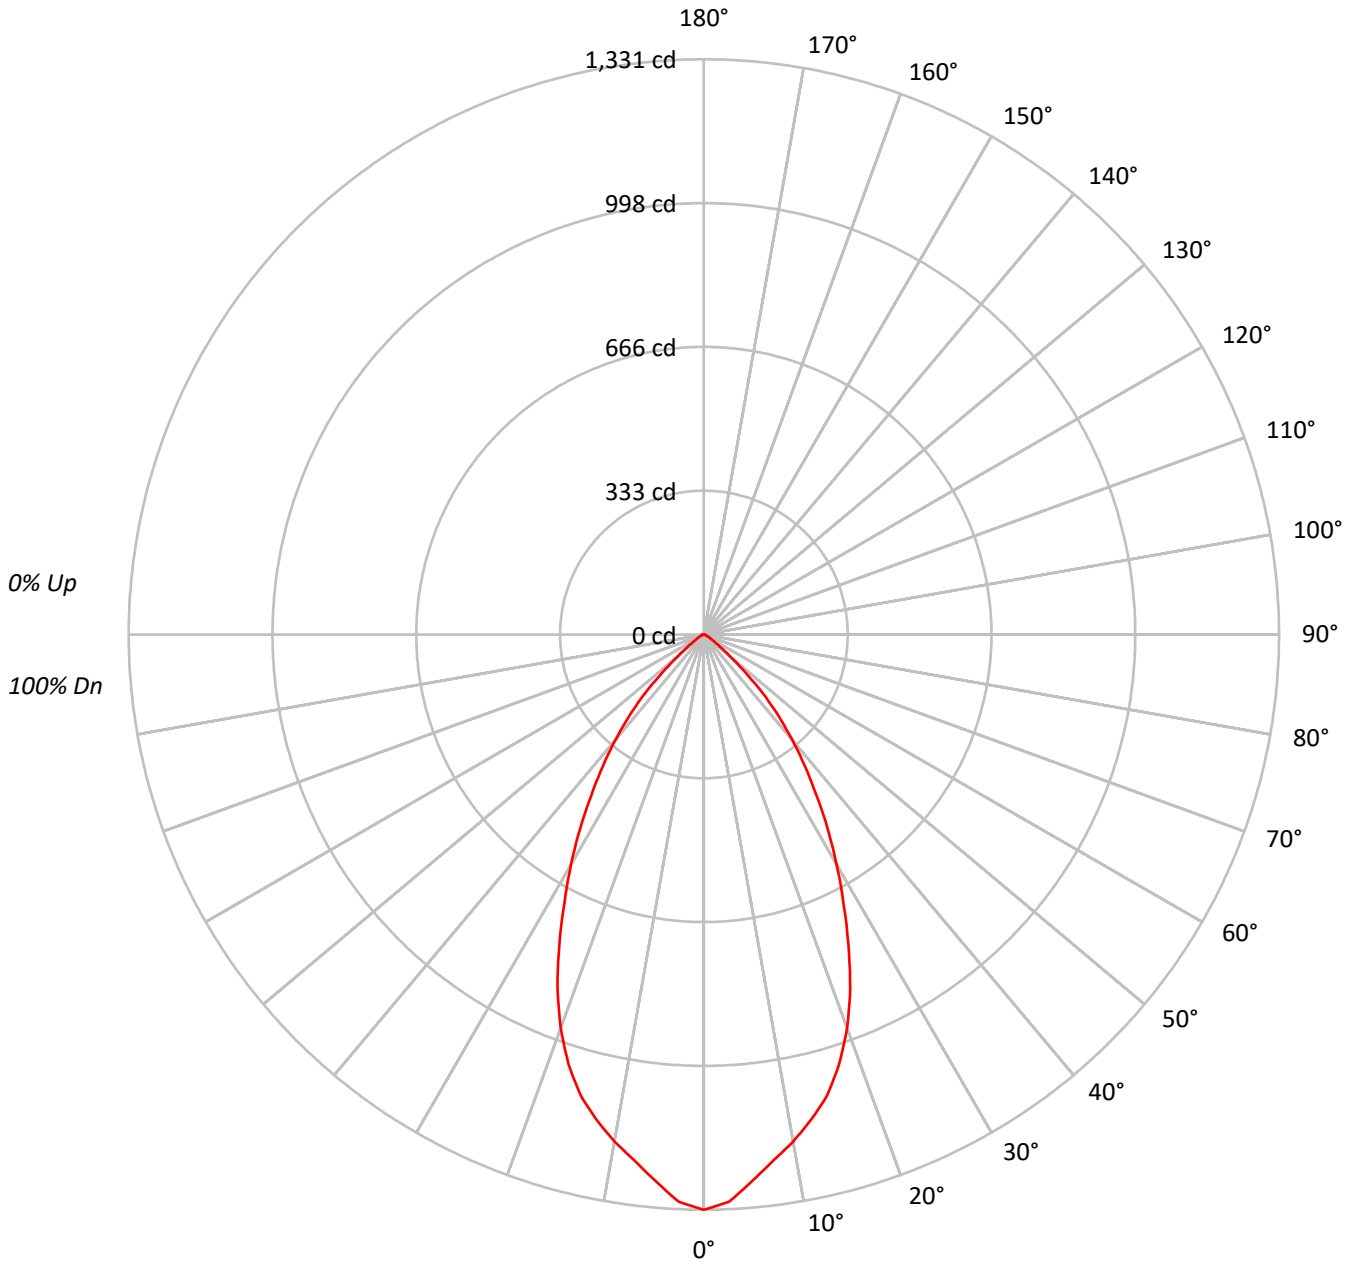



TEST NUMBER: P641932

CATALOG NUMBER: ML5612LSWFL5597FS1E - 591WB - 900LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	96	94	93			93
2	107	102	97	94	105	100	96	93	97	93	91	94	91	89	91	89	87	85			85
3	101	94	89	85	99	93	88	84	90	86	83	88	84	81	85	82	80	78			78
4	95	87	81	77	94	86	81	76	84	79	76	82	78	75	80	77	74	72			72
5	90	81	75	70	88	80	74	70	78	73	69	77	72	69	75	71	68	67			67
6	85	76	69	65	84	75	69	65	73	68	64	72	67	64	71	66	63	62			62
7	81	71	64	60	79	70	64	60	69	63	59	68	63	59	66	62	59	57			57
8	76	66	60	56	75	66	60	55	65	59	55	64	59	55	63	58	55	53			53
9	73	62	56	52	71	62	56	52	61	55	51	60	55	51	59	54	51	50			50
10	69	59	53	48	68	58	52	48	57	52	48	57	52	48	56	51	48	47			47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	105086
5°	100693
10°	95477
15°	90192
20°	81403
25°	68871
30°	56023
35°	43771
40°	32708
45°	21535
50°	10058
55°	4170
60°	2479
65°	1476
70°	1039
75°	1037
80°	1000
85°	996

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 21535 cd/sqm



TEST NUMBER: P641932

CATALOG NUMBER: ML5612LSWFL5597FS1E - 591WB - 900LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	118.8	9.4
10°-20°	306.9	24.2
20°-30°	361.5	28.6
30°-40°	284.8	22.5
40°-50°	147.5	11.7
50°-60°	32.8	2.6
60°-70°	8.6	0.7
70°-80°	3.6	0.3
80°-90°	1.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	787.2	62.2
0°-40°	1072.0	84.7
0°-60°	1252.2	98.9
0°-90°	1265.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1265.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1331	
5°	1271	119
15°	1104	307
25°	791	361
35°	454	285
45°	193	147
55°	30	33
65°	8	9
75°	3	4
85°	1	1
90°	0	



TEST NUMBER: P641932

CATALOG NUMBER: ML5612LSWFL5597FS1E - 591WB - 900LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1331.2
2.5°	1314.4
5°	1270.7
7.5°	1228.1
10°	1191.1
12.5°	1149.6
15°	1103.6
17.5°	1041.9
20°	969.0
22.5°	884.9
25°	790.7
27.5°	698.7
30°	614.6
32.5°	532.7
35°	454.2
37.5°	383.6
40°	317.4
42.5°	254.6
45°	192.9
47.5°	127.9
50°	81.9
52.5°	49.3
55°	30.3
57.5°	20.2
60°	15.7
62.5°	11.2
65°	7.9
67.5°	5.6
70°	4.5
72.5°	3.4
75°	3.4
77.5°	3.4
80°	2.2
82.5°	2.2
85°	1.1
87.5°	1.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)