

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641952

Luminaire Tested: ML5612LSWFL5597FS1E - 592SC - 1200LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641952
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-48)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSWFL5597FS1E - 592SC - 1200LM - 3000K
Description: ML56 RR, 55D TIR OPTIC, 5" SPECULAR CLEAR TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1531.0 lumens
Efficiency: N/A
Efficacy: 92.8 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.88
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641952
CATALOG NUMBER: ML5612LSWFL5597FS1E - 592SC - 1200LM - 3000K

Luminous Intensity Polar Plot

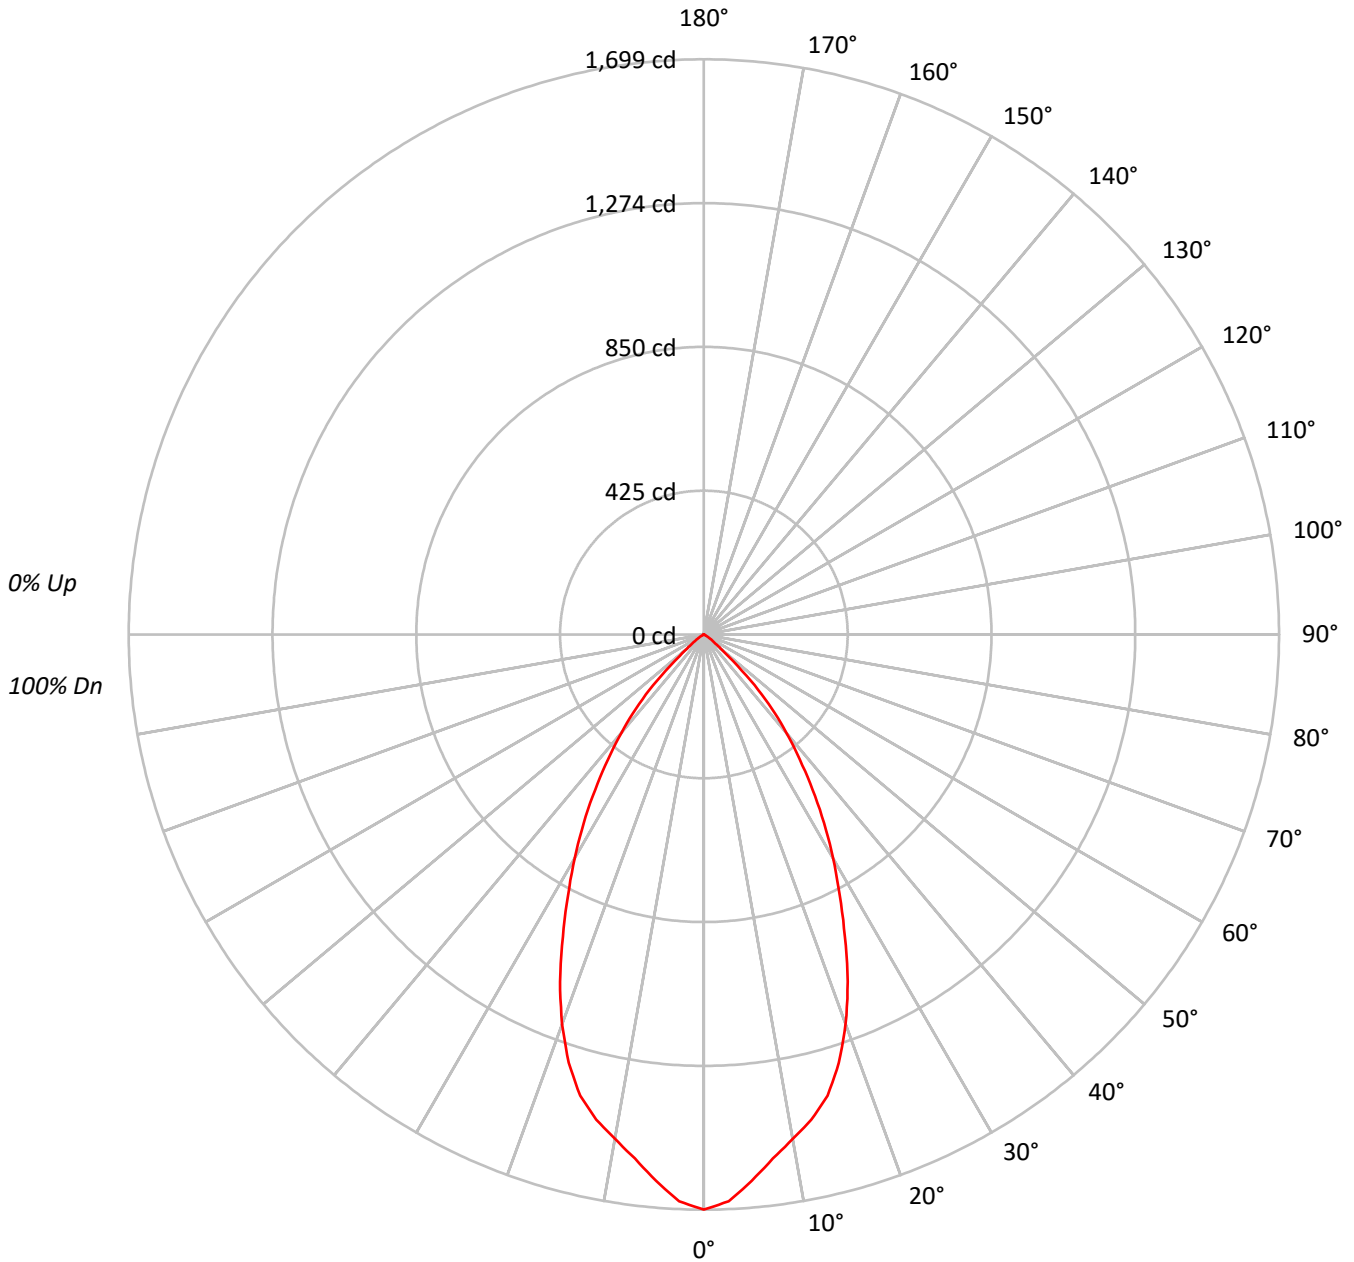



TEST NUMBER: P641952

CATALOG NUMBER: ML5612LSWFL5597FS1E - 592SC - 1200LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	102	101	101	99	98	97	96	95	93			
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			
3	102	95	90	86	100	94	89	85	91	87	84	89	85	82	86	84	81	80			
4	96	88	83	78	94	87	82	78	85	81	77	83	79	76	81	78	75	74			
5	91	82	76	72	89	82	76	72	80	75	71	78	74	70	76	73	70	68			
6	86	77	71	66	85	76	70	66	75	70	66	73	69	65	72	68	65	63			
7	82	72	66	62	80	71	66	61	70	65	61	69	64	61	68	64	60	59			
8	78	68	62	57	76	67	61	57	66	61	57	65	60	57	64	60	56	55			
9	74	64	58	53	73	63	57	53	62	57	53	61	56	53	60	56	53	51			
10	70	60	54	50	69	60	54	50	59	53	50	58	53	50	57	53	50	48			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	134097
5°	128365
10°	121240
15°	115282
20°	102858
25°	85813
30°	69495
35°	53957
40°	39066
45°	23668
50°	7848
55°	3551
60°	1074
65°	262
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 23668 cd/sqm



TEST NUMBER: P641952

CATALOG NUMBER: ML5612LSWFL5597FS1E - 592SC - 1200LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	151.2	9.9
10°-20°	390.8	25.5
20°-30°	451.5	29.5
30°-40°	349.5	22.8
40°-50°	160.7	10.5
50°-60°	25.4	1.7
60°-70°	1.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	993.6	64.9
0°-40°	1343.1	87.7
0°-60°	1529.2	99.9
0°-90°	1531.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1531.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1699	
5°	1620	151
15°	1411	391
25°	985	452
35°	560	350
45°	212	161
55°	26	25
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P641952
CATALOG NUMBER: ML5612LSWFL5597FS1E - 592SC - 1200LM - 3000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1698.7
2.5°	1675.6
5°	1619.9
7.5°	1561.4
10°	1512.5
12.5°	1467.7
15°	1410.6
17.5°	1326.3
20°	1224.4
22.5°	1110.3
25°	985.2
27.5°	868.4
30°	762.4
32.5°	660.4
35°	559.9
37.5°	464.8
40°	379.1
42.5°	297.6
45°	212.0
47.5°	116.9
50°	63.9
52.5°	39.4
55°	25.8
57.5°	14.9
60°	6.8
62.5°	2.7
65°	1.4
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)