

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641988

Luminaire Tested: ML5612LSWFL5597FS1E - 593BB - 600LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641988
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSWFL5597FS1E - 593BB - 600LM - 3500K
Description: ML56 RR, 55D TIR OPTIC, 5" BLACK BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 976.7 lumens
Efficiency: N/A
Efficacy: 94.8 lumens/watt
Spacing Criteria (0/90/45): 0.86 / 0.86 / 0.89
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641988
CATALOG NUMBER: ML5612LSWFL5597FS1E - 593BB - 600LM - 3500K

Luminous Intensity Polar Plot

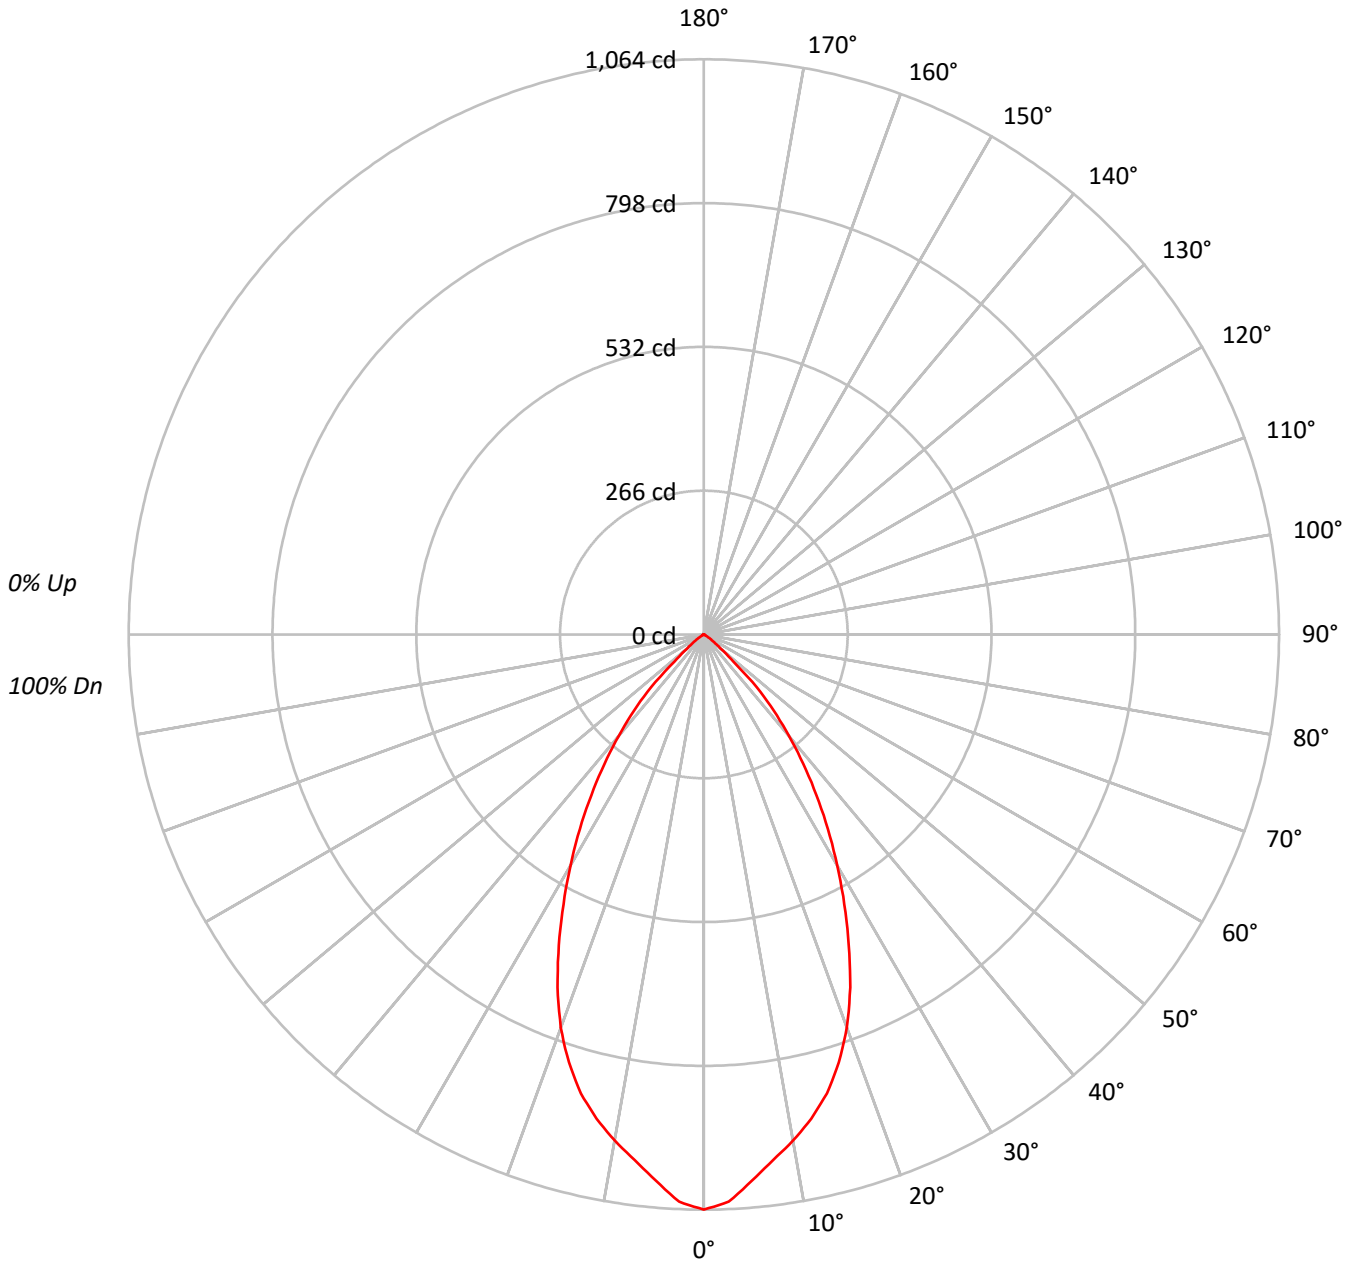



TEST NUMBER: P641988

CATALOG NUMBER: ML5612LSWFL5597FS1E - 593BB - 600LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	108	106	111	108	106	104	104	102	101	101	99	98	97	96	95	93			
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			
3	102	95	90	86	100	94	89	85	91	87	84	89	85	82	86	83	81	79			
4	96	88	83	78	94	87	82	78	85	80	77	83	79	76	81	78	75	73			
5	91	82	76	72	89	81	76	71	80	75	71	78	74	70	76	73	70	68			
6	86	77	71	66	85	76	70	66	75	69	65	73	69	65	72	68	65	63			
7	82	72	66	61	80	71	65	61	70	65	61	69	64	60	68	63	60	59			
8	77	68	61	57	76	67	61	57	66	60	57	65	60	56	64	59	56	55			
9	74	63	57	53	72	63	57	53	62	57	53	61	56	53	60	56	53	51			
10	70	60	54	50	69	59	54	50	59	53	50	58	53	49	57	53	49	48			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	83985
5°	80391
10°	76207
15°	71821
20°	64988
25°	55257
30°	44966
35°	34982
40°	25185
45°	15451
50°	5072
55°	2230
60°	568
65°	168
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 15451 cd/sqm



TEST NUMBER: P641988

CATALOG NUMBER: ML5612LSWFL5597FS1E - 593BB - 600LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	94.9	9.7
10°-20°	244.7	25.1
20°-30°	289.8	29.7
30°-40°	226.3	23.2
40°-50°	103.5	10.6
50°-60°	16.4	1.7
60°-70°	1.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	629.3	64.4
0°-40°	855.7	87.6
0°-60°	975.6	99.9
0°-90°	976.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	976.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1064	
5°	1014	95
15°	879	245
25°	634	290
35°	363	226
45°	138	103
55°	16	16
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P641988

CATALOG NUMBER: ML5612LSWFL5597FS1E - 593BB - 600LM - 3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1063.9
2.5°	1050.4
5°	1014.5
7.5°	980.3
10°	950.7
12.5°	917.4
15°	878.8
17.5°	830.3
20°	773.6
22.5°	707.2
25°	634.4
27.5°	562.5
30°	493.3
32.5°	426.8
35°	363.0
37.5°	301.9
40°	244.4
42.5°	191.4
45°	138.4
47.5°	73.7
50°	41.3
52.5°	26.1
55°	16.2
57.5°	9.9
60°	3.6
62.5°	1.8
65°	0.9
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)