

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P641997

Luminaire Tested: ML5612LSWFL5597FS1E - 593SNB - 1200LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P641997
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-53)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSWFL5597FS1E - 593SNB - 1200LM - 3000K
Description: ML56 RR, 55D TIR OPTIC, 5" SATIN NICKLE BAFFLE TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1502.5 lumens
Efficiency: N/A
Efficacy: 91.1 lumens/watt
Spacing Criteria (0/90/45): 0.86 / 0.86 / 0.89
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P641997

CATALOG NUMBER: ML5612LSWFL5597FS1E - 593SNB - 1200LM - 3000K

Luminous Intensity Polar Plot

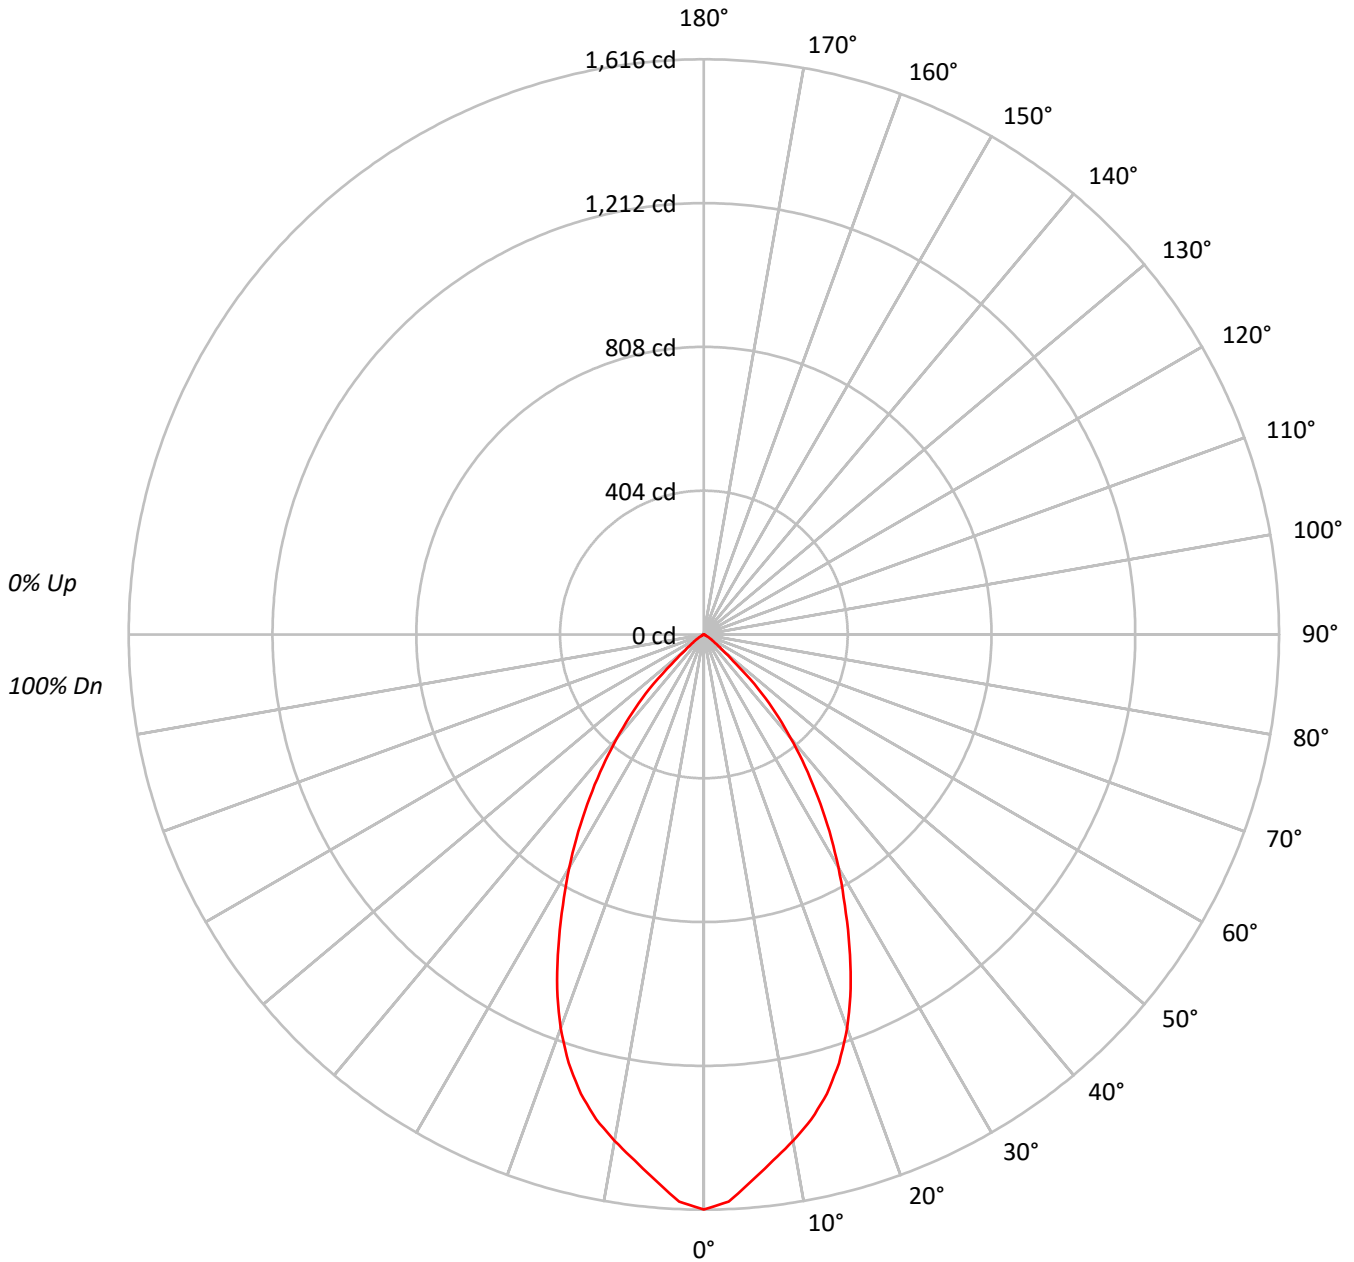



TEST NUMBER: P641997

CATALOG NUMBER: ML5612LSWFL5597FS1E - 593SNB - 1200LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	108	106	111	108	106	104	104	102	101	100	99	98	97	96	95	93			93
2	107	102	98	94	105	101	97	93	97	94	91	94	92	89	91	89	88	86			86
3	102	95	90	85	100	93	89	85	91	87	83	88	85	82	86	83	81	79			79
4	96	88	82	78	94	87	82	77	85	80	76	83	79	76	81	77	75	73			73
5	91	82	76	71	89	81	75	71	79	74	70	78	73	70	76	72	69	68			68
6	86	77	70	66	84	76	70	66	74	69	65	73	68	65	71	67	64	63			63
7	81	72	65	61	80	71	65	61	70	64	60	68	64	60	67	63	60	58			58
8	77	67	61	57	76	67	61	56	65	60	56	64	60	56	63	59	56	54			54
9	73	63	57	53	72	63	57	53	62	56	53	61	56	52	60	55	52	51			51
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48			48

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	127537
5°	122097
10°	115781
15°	109161
20°	98851
25°	84262
30°	68866
35°	53812
40°	39066
45°	24270
50°	8339
55°	3922
60°	1500
65°	504
70°	323
75°	427
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 24270 cd/sqm



TEST NUMBER: P641997

CATALOG NUMBER: ML5612LSWFL5597FS1E - 593SNB - 1200LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	144.1	9.6
10°-20°	372.0	24.8
20°-30°	441.8	29.4
30°-40°	348.4	23.2
40°-50°	163.2	10.9
50°-60°	28.3	1.9
60°-70°	3.7	0.2
70°-80°	0.9	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	958.0	63.8
0°-40°	1306.4	86.9
0°-60°	1498.0	99.7
0°-90°	1502.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1502.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1616	
5°	1541	144
15°	1336	372
25°	967	442
35°	558	348
45°	217	163
55°	28	28
65°	3	4
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P641997

CATALOG NUMBER: ML5612LSWFL5597FS1E - 593SNB - 1200LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1615.6
2.5°	1595.2
5°	1540.8
7.5°	1490.6
10°	1444.4
12.5°	1395.4
15°	1335.7
17.5°	1262.3
20°	1176.7
22.5°	1077.5
25°	967.4
27.5°	857.4
30°	755.5
32.5°	656.3
35°	558.4
37.5°	466.1
40°	379.1
42.5°	297.6
45°	217.4
47.5°	122.3
50°	67.9
52.5°	43.5
55°	28.5
57.5°	17.7
60°	9.5
62.5°	5.4
65°	2.7
67.5°	1.4
70°	1.4
72.5°	1.4
75°	1.4
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)