

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642133

Luminaire Tested: ML5612LSWFL5597FS1E - 692SC - 1200LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642133
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5612LSWFL5597FS1E - 692SC - 1200LM - 3500K
Description: ML56 RR, 55D TIR OPTIC, 6" SPECULAR CLEAR TRIM
Light Source: (1) HCL SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1579.7 lumens
Efficiency: N/A
Efficacy: 95.7 lumens/watt
Spacing Criteria (0/90/45): 0.72 / 0.72 / 0.81
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642133

CATALOG NUMBER: ML5612LSWFL5597FS1E - 692SC - 1200LM - 3500K

Luminous Intensity Polar Plot

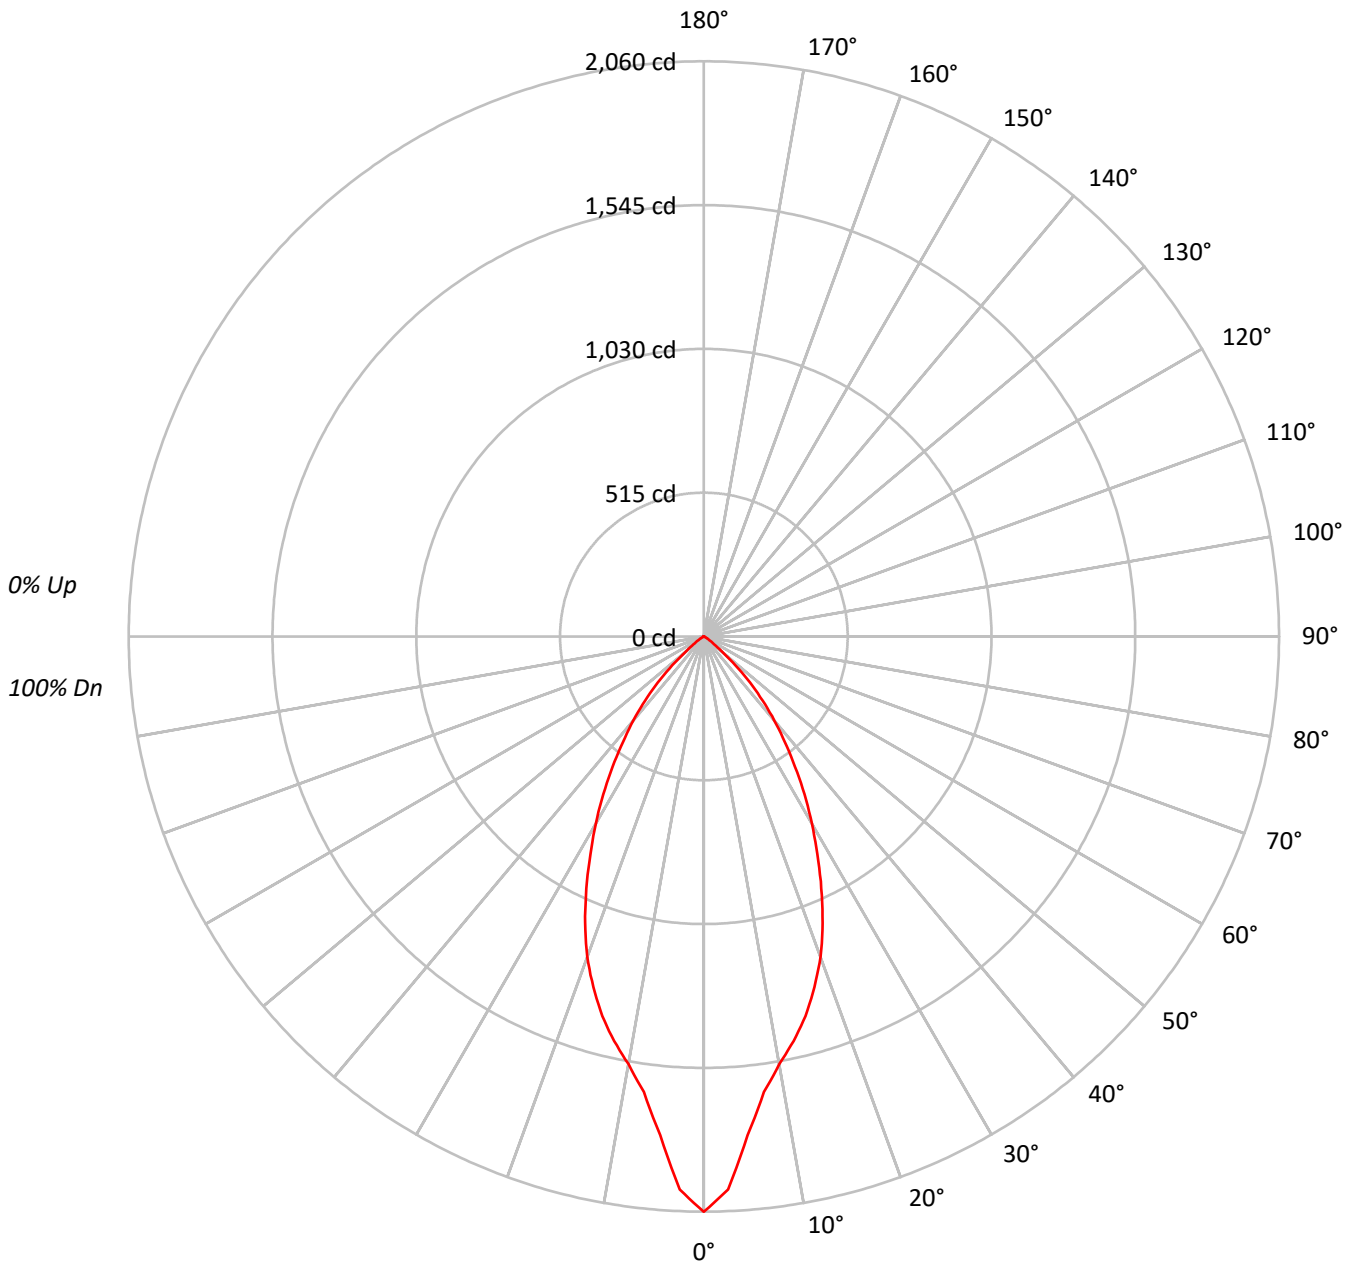



TEST NUMBER: P642133

CATALOG NUMBER: ML5612LSWFL5597FS1E - 692SC - 1200LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	108	106	111	108	106	104	104	102	101	101	99	98	97	96	95	93			
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			
3	102	95	90	86	100	94	89	85	91	87	84	88	85	82	86	83	81	79			
4	96	88	83	78	94	87	82	78	85	80	77	83	79	76	81	78	75	73			
5	91	82	76	72	89	81	76	71	79	74	71	78	73	70	76	72	69	68			
6	86	77	71	66	85	76	70	66	74	69	65	73	68	65	72	68	64	63			
7	82	72	66	61	80	71	65	61	70	65	61	69	64	60	68	63	60	59			
8	77	67	61	57	76	67	61	57	66	60	57	65	60	56	64	59	56	55			
9	74	63	57	53	72	63	57	53	62	57	53	61	56	53	60	56	53	51			
10	70	60	54	50	69	59	54	50	59	53	50	58	53	49	57	53	49	48			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	112951
5°	98635
10°	86566
15°	79859
20°	71260
25°	60203
30°	48957
35°	38113
40°	28074
45°	18180
50°	7497
55°	2800
60°	1228
65°	363
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 18180 cd/sqm



TEST NUMBER: P642133

CATALOG NUMBER: ML5612LSWFL5597FS1E - 692SC - 1200LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	164.0	10.4
10°-20°	391.7	24.8
20°-30°	454.8	28.8
30°-40°	356.3	22.6
40°-50°	178.4	11.3
50°-60°	31.5	2.0
60°-70°	3.1	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1010.5	64.0
0°-40°	1366.8	86.5
0°-60°	1576.6	99.8
0°-90°	1579.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1579.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2060	
5°	1792	164
15°	1407	392
25°	995	455
35°	570	356
45°	234	178
55°	29	31
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P642133

CATALOG NUMBER: ML5612LSWFL5597FS1E - 692SC - 1200LM - 3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	2060.4
2.5°	1982.3
5°	1792.4
7.5°	1645.8
10°	1555.1
12.5°	1483.9
15°	1407.1
17.5°	1316.4
20°	1221.5
22.5°	1111.2
25°	995.3
27.5°	879.5
30°	773.4
32.5°	670.1
35°	569.5
37.5°	476.0
40°	392.3
42.5°	311.3
45°	234.5
47.5°	152.2
50°	87.9
52.5°	46.1
55°	29.3
57.5°	18.1
60°	11.2
62.5°	4.2
65°	2.8
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)