

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642364

Luminaire Tested: ML5615LSFL409FS1E - 591WB - 1500LM - 4000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642364
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-24)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSFL409FS1E - 591WB - 1500LM - 4000K
Description: ML56 RR, 40D TIR OPTIC, 5" DEADFRONT TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2015.1 lumens
Efficiency: N/A
Efficacy: 117.8 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 17.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642364

CATALOG NUMBER: ML5615LSFL409FS1E - 591WB - 1500LM - 4000K

Luminous Intensity Polar Plot

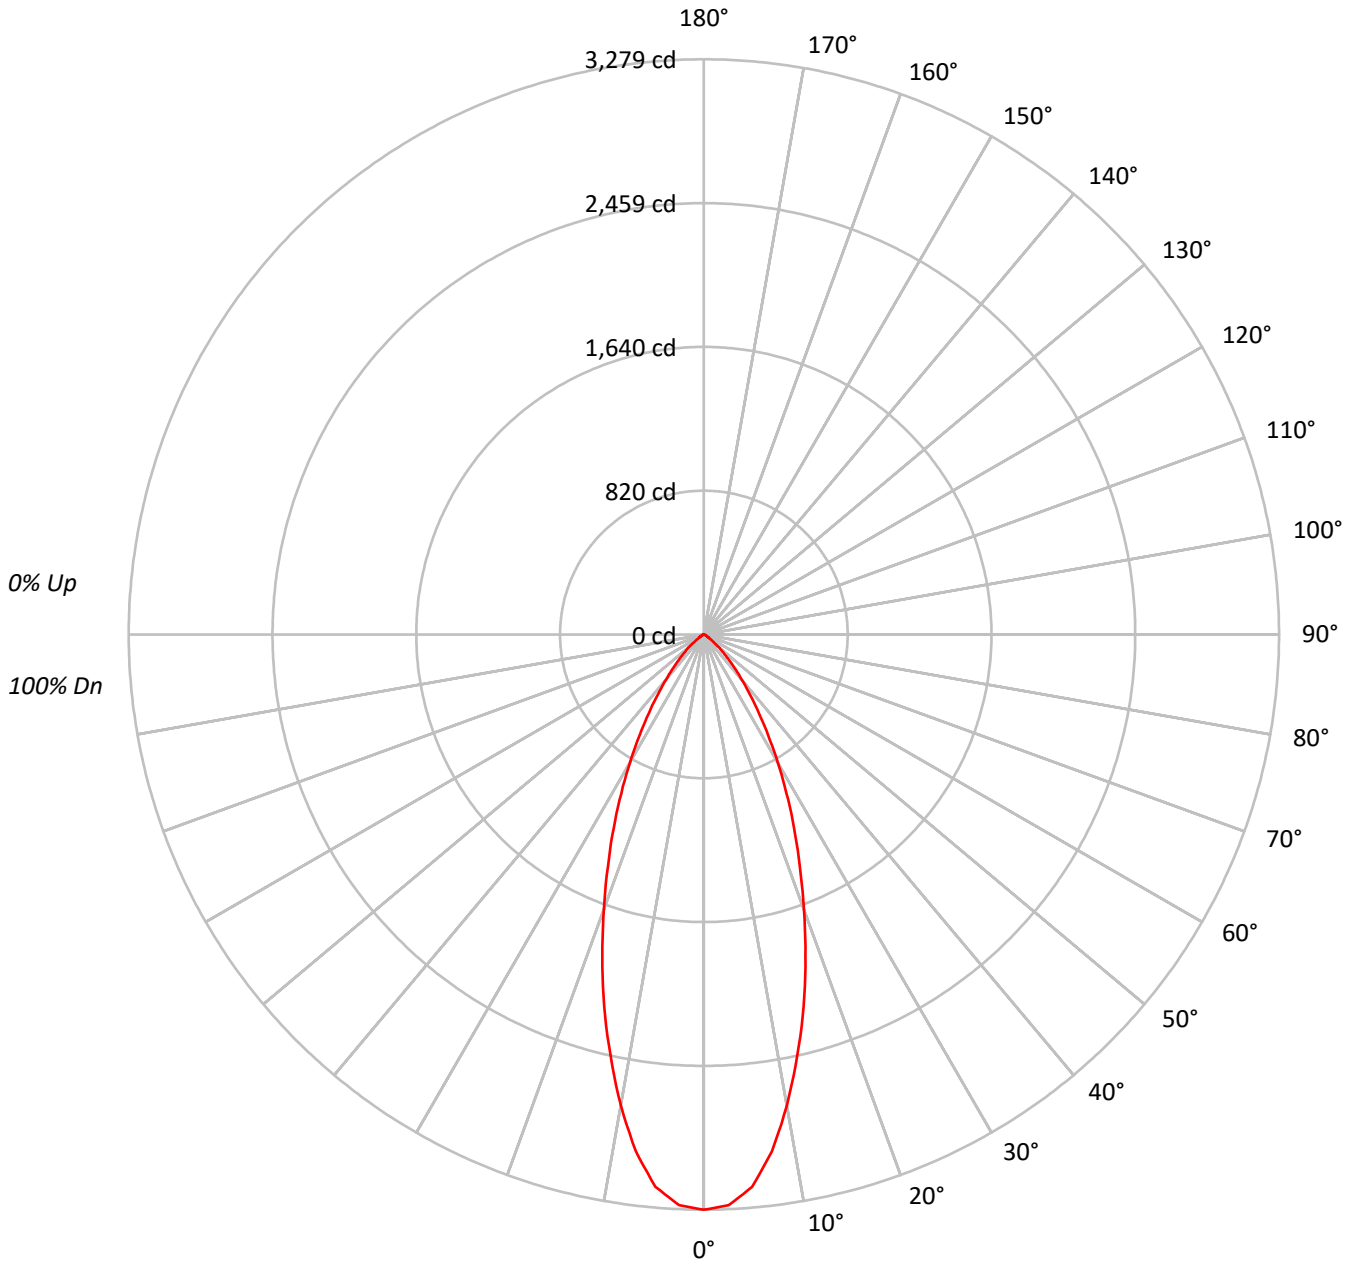



TEST NUMBER: P642364

CATALOG NUMBER: ML5615LSFL409FS1E - 591WB - 1500LM - 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	93	91	89	87			
3	103	96	91	88	101	95	90	87	92	89	85	90	87	84	88	85	83	81			
4	98	90	85	81	96	89	84	80	87	83	79	85	81	78	83	80	77	76			
5	93	85	79	75	91	84	78	74	82	77	74	80	76	73	79	75	72	71			
6	88	80	74	70	87	79	73	69	77	73	69	76	72	69	75	71	68	67			
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63			
8	80	71	65	61	79	71	65	61	70	65	61	69	64	61	68	63	60	59			
9	77	67	62	58	76	67	62	58	66	61	58	65	61	57	64	60	57	56			
10	74	64	59	55	73	64	58	55	63	58	55	62	58	54	61	57	54	53			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	258847
5°	250446
10°	218489
15°	179568
20°	139880
25°	105924
30°	76696
35°	52637
40°	34429
45°	21703
50°	12588
55°	5354
60°	3631
65°	2316
70°	1223
75°	1068
80°	1591
85°	1630

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 21703 cd/sqm



TEST NUMBER: P642364

CATALOG NUMBER: ML5615LSFL409FS1E - 591WB - 1500LM - 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	287.4	14.3
10°-20°	606.6	30.1
20°-30°	557.7	27.7
30°-40°	346.2	17.2
40°-50°	155.2	7.7
50°-60°	43.1	2.1
60°-70°	13.1	0.6
70°-80°	3.9	0.2
80°-90°	1.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1451.7	72.0
0°-40°	1797.9	89.2
0°-60°	1996.2	99.1
0°-90°	2015.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2015.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3279	
5°	3160	287
15°	2197	607
25°	1216	558
35°	546	346
45°	194	155
55°	39	43
65°	12	13
75°	4	4
85°	2	2
90°	0	



TEST NUMBER: P642364

CATALOG NUMBER: ML5615LSFL409FS1E - 591WB - 1500LM - 4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	3279.0
2.5°	3256.0
5°	3160.5
7.5°	2971.4
10°	2725.7
12.5°	2458.8
15°	2197.2
17.5°	1925.0
20°	1665.1
22.5°	1428.3
25°	1216.1
27.5°	1018.2
30°	841.4
32.5°	680.5
35°	546.2
37.5°	429.5
40°	334.1
42.5°	258.1
45°	194.4
47.5°	143.2
50°	102.5
52.5°	63.6
55°	38.9
57.5°	30.0
60°	23.0
62.5°	17.7
65°	12.4
67.5°	8.8
70°	5.3
72.5°	3.5
75°	3.5
77.5°	3.5
80°	3.5
82.5°	1.8
85°	1.8
87.5°	1.8
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)