

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642458

Luminaire Tested: ML5615LSFL409FS1E - 593TBZB - 900LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642458
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-31)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSFL409FS1E - 593TBZB - 900LM - 3500K
Description: ML56 RR, 40D TIR OPTIC, 5" TUSCON BRONZE BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1173.9 lumens
Efficiency: N/A
Efficacy: 111.8 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642458

CATALOG NUMBER: ML5615LSFL409FS1E - 593TBZB - 900LM - 3500K

Luminous Intensity Polar Plot

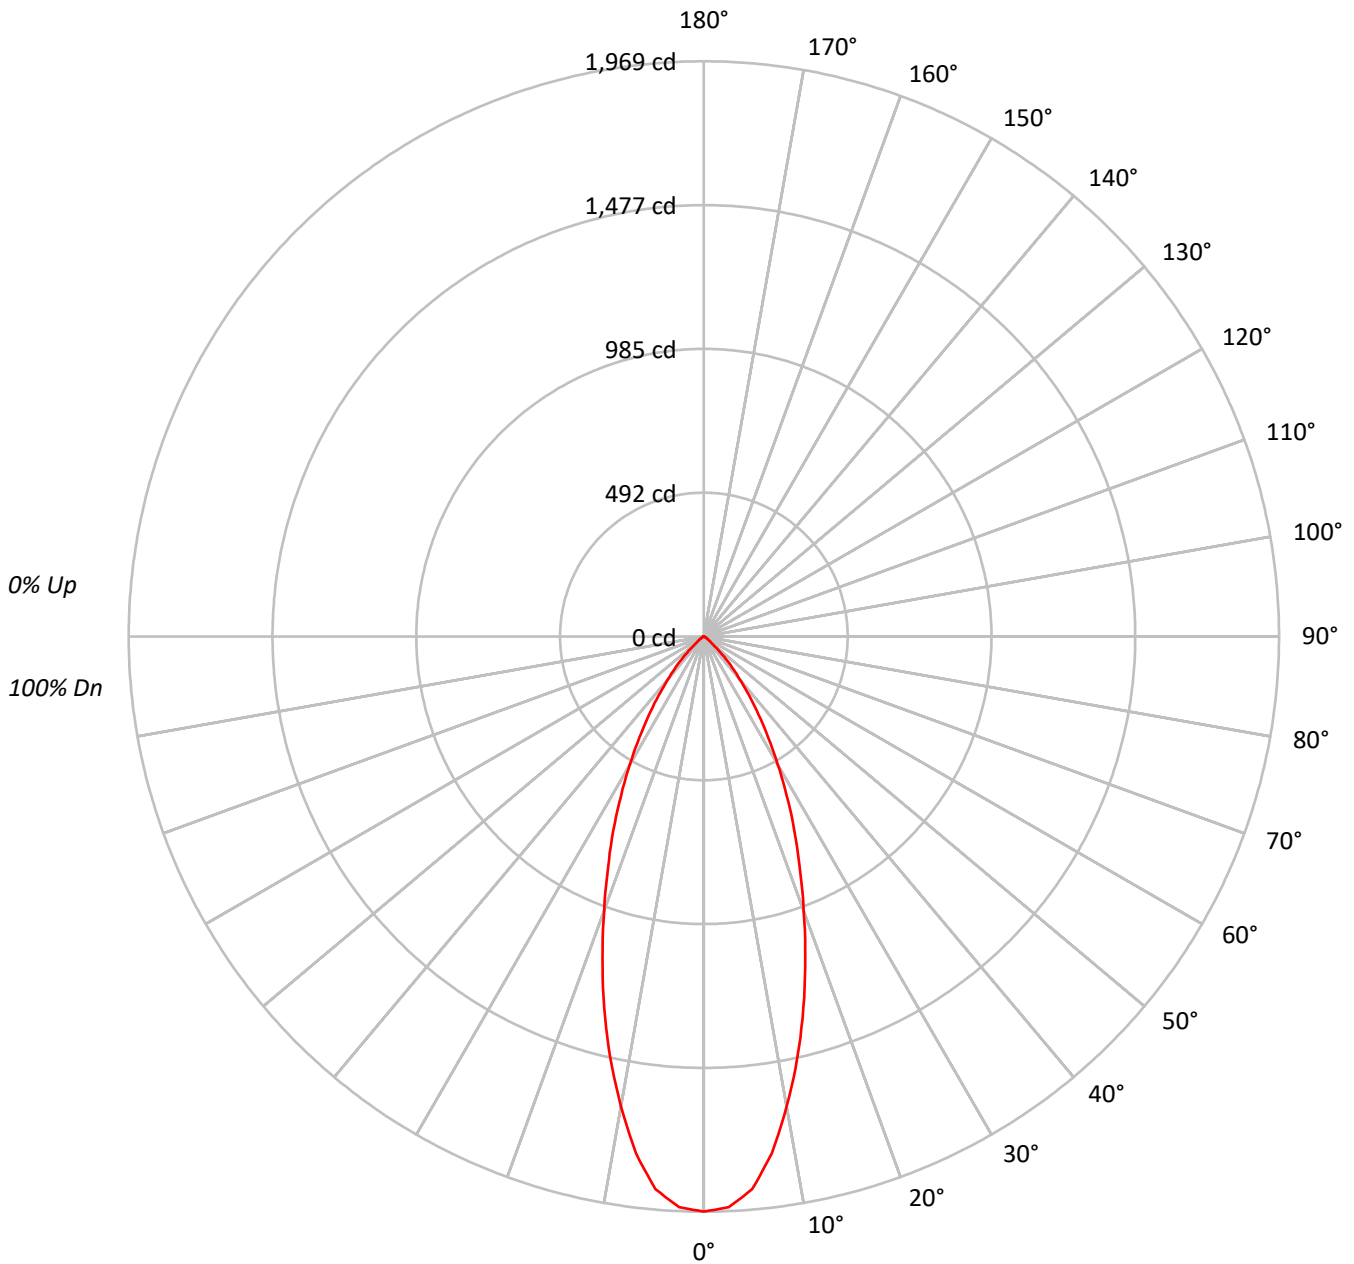



TEST NUMBER: P642458

CATALOG NUMBER: ML5615LSFL409FS1E - 593TBZB - 900LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	108	104	100	97	106	102	99	96	99	96	93	96	94	91	93	91	90	88			
3	103	97	92	89	101	96	91	88	93	89	86	91	88	85	89	86	84	82			
4	98	91	86	82	97	90	85	81	88	84	80	86	82	79	84	81	79	77			
5	94	86	80	76	92	85	80	76	83	79	75	81	77	74	80	76	74	72			
6	89	81	75	71	88	80	75	71	79	74	70	77	73	70	76	72	69	68			
7	85	76	71	67	84	76	70	66	74	70	66	73	69	66	72	68	65	64			
8	81	72	67	63	80	72	66	63	71	66	62	70	65	62	69	65	62	61			
9	78	69	63	59	77	68	63	59	67	62	59	66	62	59	66	62	59	57			
10	75	65	60	56	74	65	60	56	64	59	56	63	59	56	63	59	56	54			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	155419
5°	150489
10°	130963
15°	107616
20°	83898
25°	63880
30°	46142
35°	31474
40°	19497
45°	10974
50°	4028
55°	2326
60°	1342
65°	392
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 10974 cd/sqm



TEST NUMBER: P642458

CATALOG NUMBER: ML5615LSFL409FS1E - 593TBZB - 900LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.5	14.7
10°-20°	363.9	31.0
20°-30°	335.5	28.6
30°-40°	206.4	17.6
40°-50°	76.6	6.5
50°-60°	16.0	1.4
60°-70°	2.8	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	871.9	74.3
0°-40°	1078.4	91.9
0°-60°	1171.0	99.8
0°-90°	1173.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1173.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1969	
5°	1899	173
15°	1317	364
25°	733	336
35°	327	206
45°	98	77
55°	17	16
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P642458

CATALOG NUMBER: ML5615LSFL409FS1E - 593TBZB - 900LM - 3500K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1968.8
2.5°	1955.1
5°	1899.1
7.5°	1783.9
10°	1633.8
12.5°	1478.5
15°	1316.8
17.5°	1154.0
20°	998.7
22.5°	857.1
25°	733.4
27.5°	614.0
30°	506.2
32.5°	410.0
35°	326.6
37.5°	254.7
40°	189.2
42.5°	142.7
45°	98.3
47.5°	52.8
50°	32.8
52.5°	23.2
55°	16.9
57.5°	11.6
60°	8.5
62.5°	5.3
65°	2.1
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)