

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642559

Luminaire Tested: ML5615LSFL409FS1E - 692H - 1500LM - 4000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642559
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-38)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSFL409FS1E - 692H - 1500LM - 4000K
Description: ML56 RR, 40D TIR OPTIC, 6" HAZE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2018.7 lumens
Efficiency: N/A
Efficacy: 118.1 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 17.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642559
CATALOG NUMBER: ML5615LSFL409FS1E - 692H - 1500LM - 4000K

Luminous Intensity Polar Plot

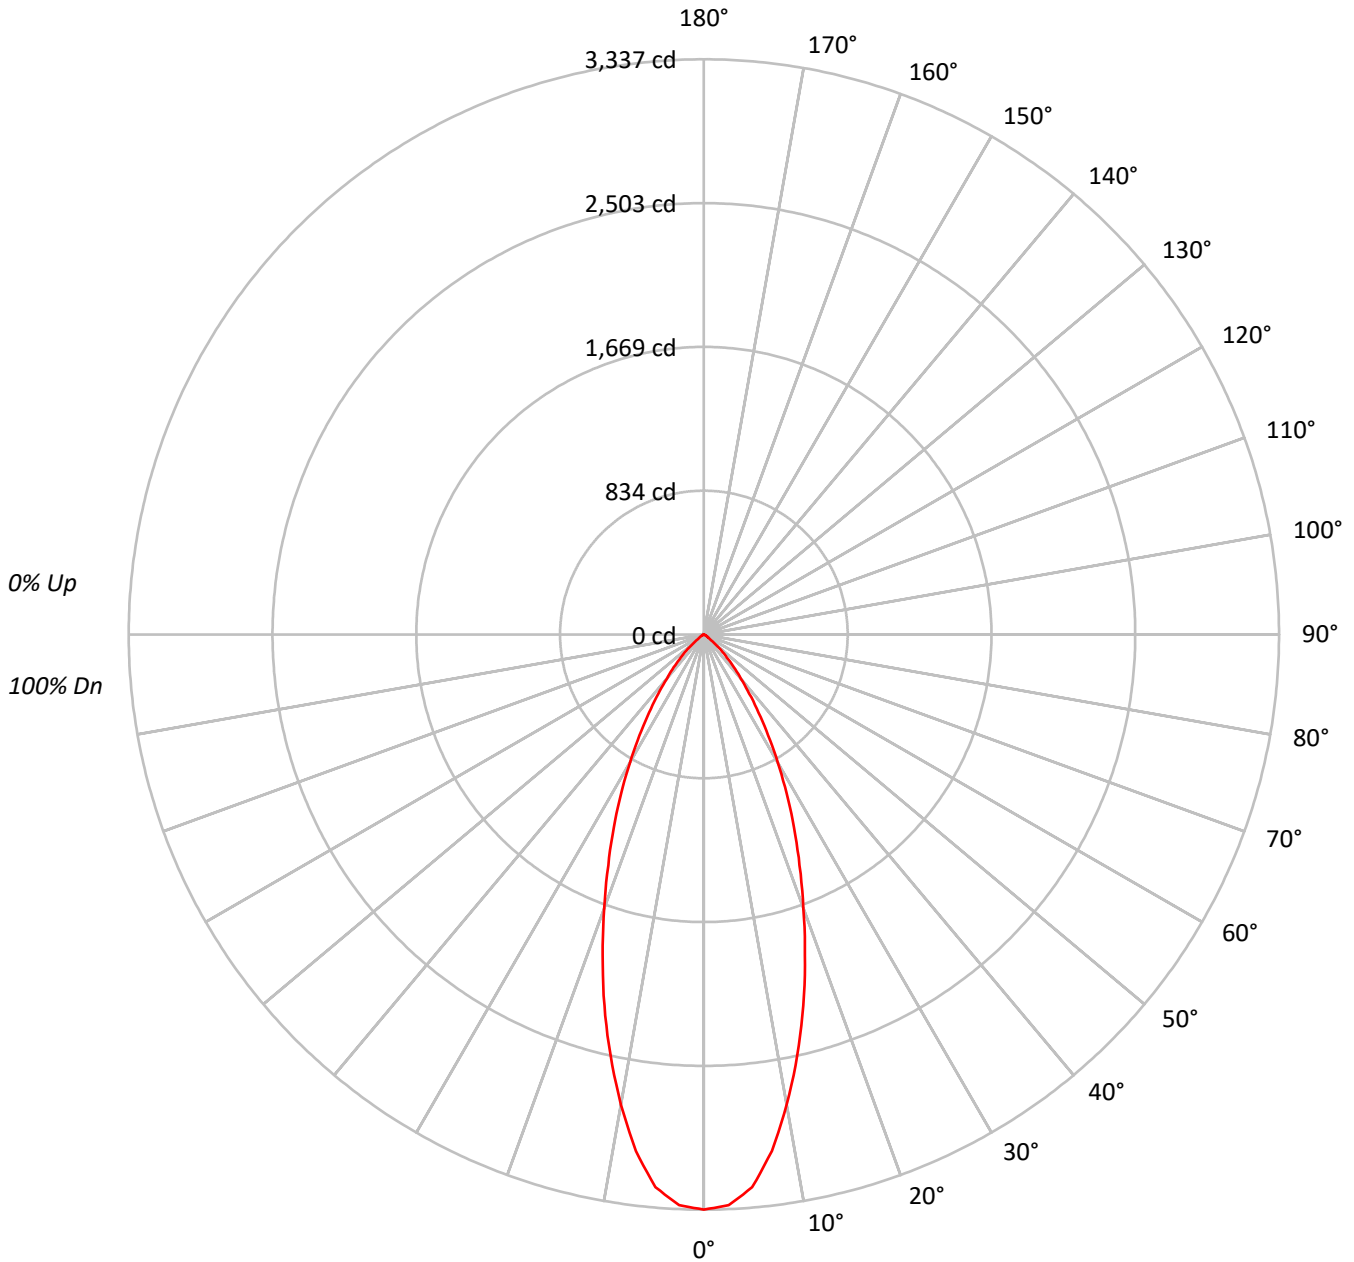



TEST NUMBER: P642559

CATALOG NUMBER: ML5615LSFL409FS1E - 692H - 1500LM - 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	109	106	111	109	107	105	105	103	102	101	100	98	98	97	96	94		
2	108	104	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88		
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	86	83	82		
4	98	91	85	81	96	90	85	81	87	83	80	86	82	79	84	81	78	77		
5	93	85	80	75	92	84	79	75	83	78	74	81	77	74	79	76	73	72		
6	89	80	75	70	87	80	74	70	78	73	70	77	72	69	75	72	69	67		
7	85	76	70	66	83	75	70	66	74	69	65	73	68	65	72	68	65	63		
8	81	72	66	62	80	71	66	62	70	65	62	69	65	61	68	64	61	60		
9	77	68	62	59	76	68	62	58	67	62	58	66	61	58	65	61	58	57		
10	74	65	59	55	73	64	59	55	64	59	55	63	58	55	62	58	55	54		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	182924
5°	177102
10°	154150
15°	126550
20°	98516
25°	74762
30°	54179
35°	37042
40°	23916
45°	14668
50°	7386
55°	3039
60°	1941
65°	687
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 14668 cd/sqm



TEST NUMBER: P642559

CATALOG NUMBER: ML5615LSFL409FS1E - 692H - 1500LM - 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	292.3	14.5
10°-20°	615.8	30.5
20°-30°	566.9	28.1
30°-40°	351.1	17.4
40°-50°	151.8	7.5
50°-60°	34.2	1.7
60°-70°	6.5	0.3
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1475.0	73.1
0°-40°	1826.2	90.5
0°-60°	2012.2	99.7
0°-90°	2018.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2018.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3337	
5°	3218	292
15°	2230	616
25°	1236	567
35°	554	351
45°	189	152
55°	32	34
65°	5	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P642559

CATALOG NUMBER: ML5615LSFL409FS1E - 692H - 1500LM - 4000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	3336.8
2.5°	3313.8
5°	3218.3
7.5°	3022.0
10°	2769.2
12.5°	2502.1
15°	2229.8
17.5°	1950.4
20°	1688.7
22.5°	1450.0
25°	1236.0
27.5°	1038.0
30°	855.9
32.5°	694.9
35°	553.5
37.5°	433.2
40°	334.2
42.5°	258.2
45°	189.2
47.5°	139.7
50°	86.6
52.5°	46.0
55°	31.8
57.5°	24.8
60°	17.7
62.5°	10.6
65°	5.3
67.5°	1.8
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)