

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642603

Luminaire Tested: ML5615LSFL409FS1E - 693BB - 1500LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642603
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-41)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSFL409FS1E - 693BB - 1500LM - 3500K
Description: ML56 RR, 40D TIR OPTIC, 6" BLACK BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1849.9 lumens
Efficiency: N/A
Efficacy: 108.2 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 17.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642603
CATALOG NUMBER: ML5615LSFL409FS1E - 693BB - 1500LM - 3500K

Luminous Intensity Polar Plot

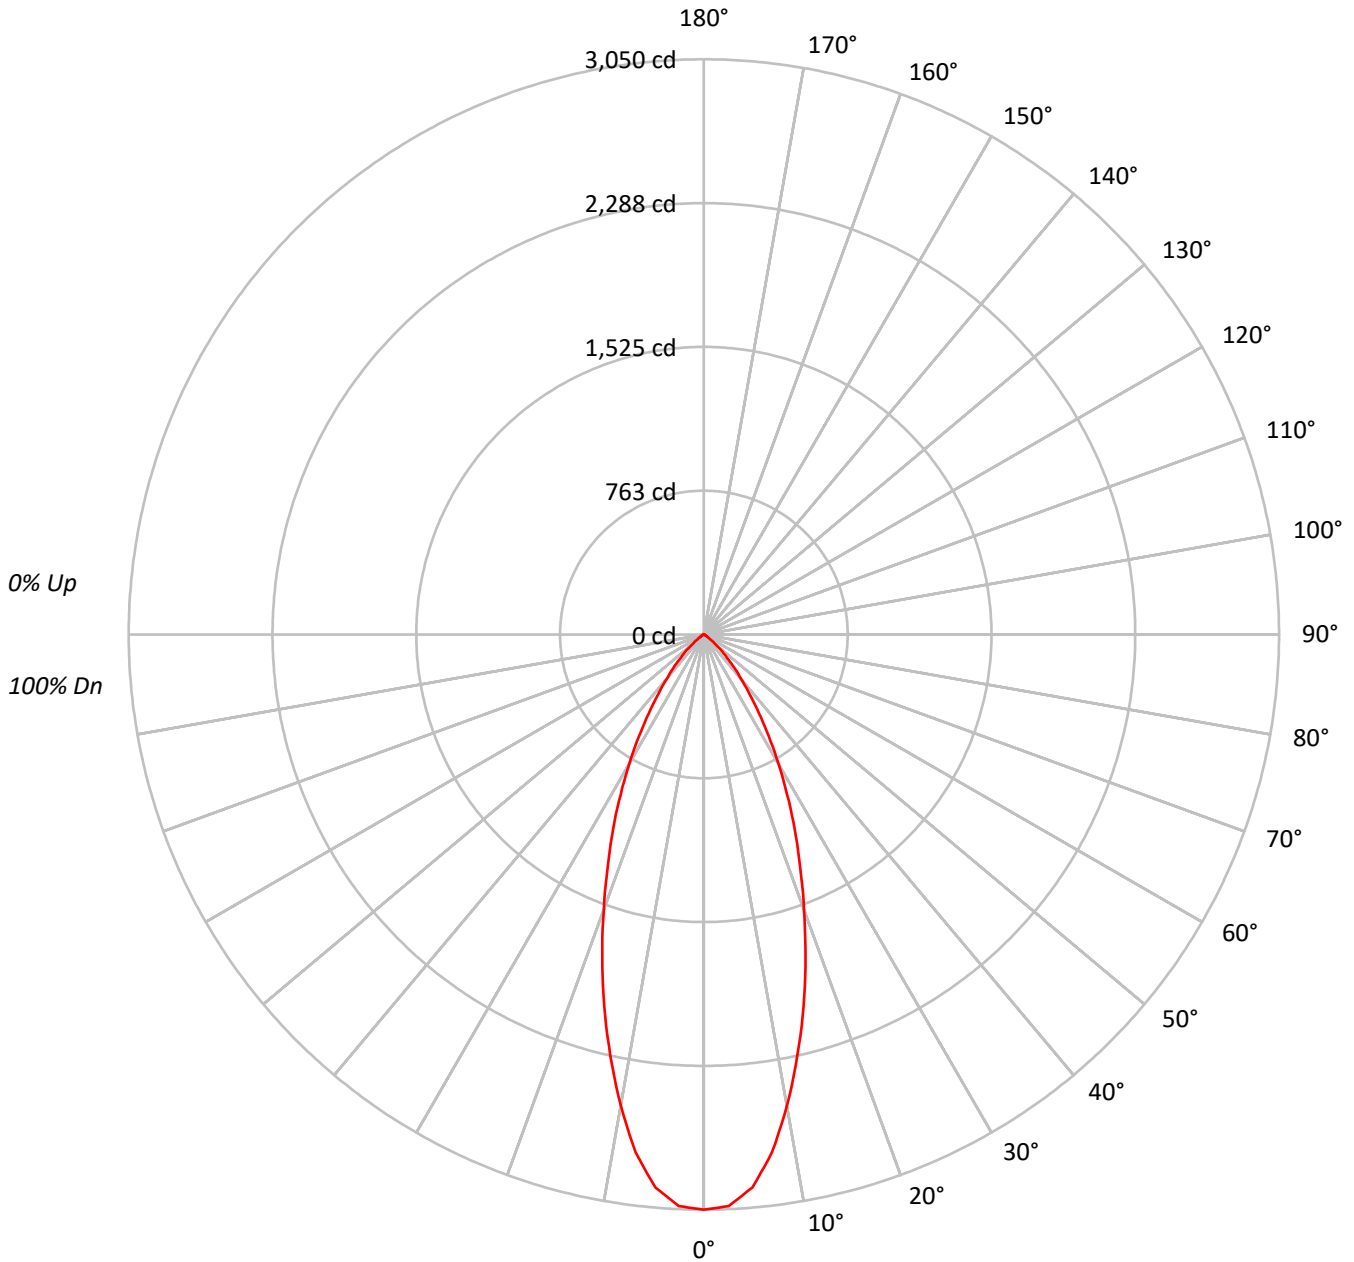



TEST NUMBER: P642603

CATALOG NUMBER: ML5615LSFL409FS1E - 693BB - 1500LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	111	109	106	111	109	107	105	105	103	102	101	100	99	98	97	96	94	94	94	94
2	108	104	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88	88	88	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	86	83	82	82	82	82
4	98	91	85	81	96	90	85	81	88	83	80	86	82	79	84	81	78	77	77	77	77
5	93	85	80	76	92	84	79	75	83	78	75	81	77	74	79	76	73	72	72	72	72
6	89	80	75	70	88	80	74	70	78	73	70	77	73	69	75	72	69	67	67	67	67
7	85	76	70	66	84	75	70	66	74	69	66	73	68	65	72	68	65	63	63	63	63
8	81	72	66	62	80	71	66	62	70	65	62	69	65	61	68	64	61	60	60	60	60
9	77	68	62	59	76	68	62	59	67	62	58	66	61	58	65	61	58	57	57	57	57
10	74	65	59	55	73	64	59	55	64	59	55	63	58	55	62	58	55	54	54	54	54

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	167196
5°	161958
10°	141235
15°	115829
20°	90495
25°	68780
30°	49932
35°	33984
40°	21870
45°	13373
50°	6729
55°	2667
60°	1623
65°	636
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13373 cd/sqm



TEST NUMBER: P642603

CATALOG NUMBER: ML5615LSFL409FS1E - 693BB - 1500LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	267.6	14.5
10°-20°	564.4	30.5
20°-30°	521.4	28.2
30°-40°	322.6	17.4
40°-50°	138.5	7.5
50°-60°	29.9	1.6
60°-70°	5.4	0.3
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1353.4	73.2
0°-40°	1676.0	90.6
0°-60°	1844.5	99.7
0°-90°	1849.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1849.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3050	
5°	2943	268
15°	2041	564
25°	1137	521
35°	508	323
45°	172	139
55°	28	30
65°	5	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P642603

CATALOG NUMBER: ML5615LSFL409FS1E - 693BB - 1500LM - 3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	3049.9
2.5°	3033.5
5°	2943.1
7.5°	2768.9
10°	2537.2
12.5°	2289.1
15°	2040.9
17.5°	1791.2
20°	1551.2
22.5°	1332.7
25°	1137.1
27.5°	954.7
30°	788.8
32.5°	639.2
35°	507.8
37.5°	397.7
40°	305.6
42.5°	236.6
45°	172.5
47.5°	126.5
50°	78.9
52.5°	41.1
55°	27.9
57.5°	19.7
60°	14.8
62.5°	9.9
65°	4.9
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)