

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642609

Luminaire Tested: ML5615LSFL409FS1E - 693BB - 900LM - 4000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642609
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-41)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSFL409FS1E - 693BB - 900LM - 4000K
Description: ML56 RR, 40D TIR OPTIC, 6" BLACK BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1280.1 lumens
Efficiency: N/A
Efficacy: 121.9 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642609
CATALOG NUMBER: ML5615LSFL409FS1E - 693BB - 900LM - 4000K

Luminous Intensity Polar Plot

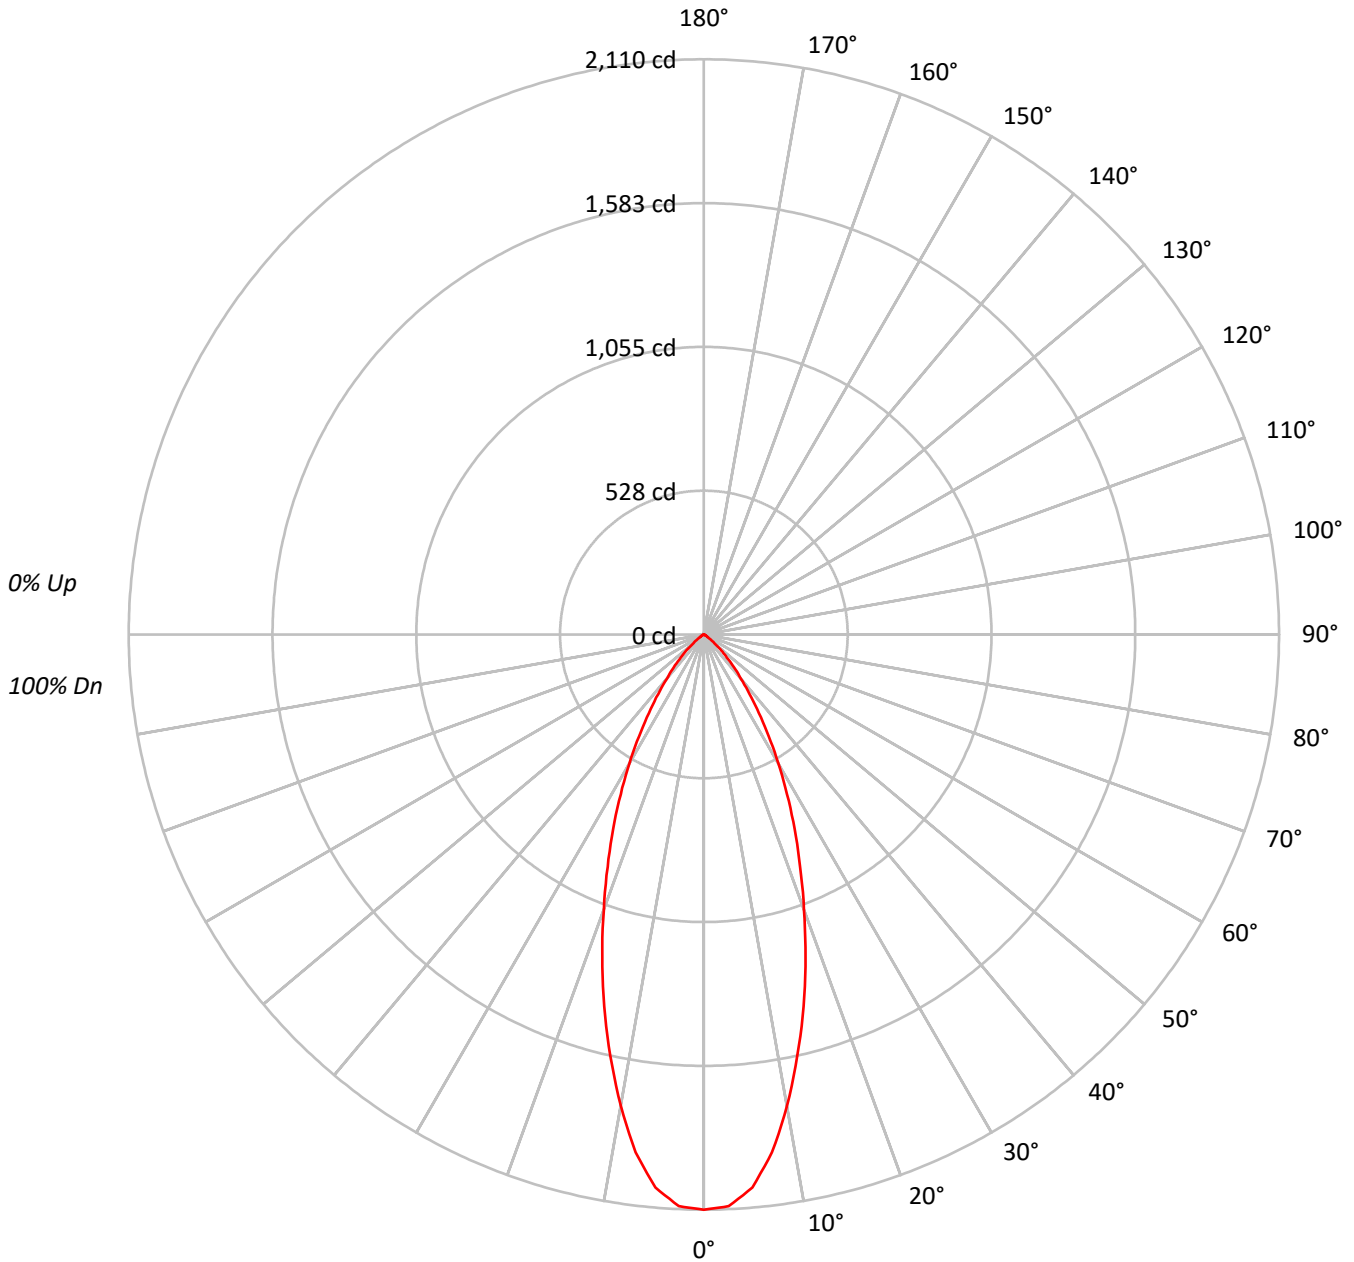



TEST NUMBER: P642609

CATALOG NUMBER: ML5615LSFL409FS1E - 693BB - 900LM - 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	106	111	109	107	105	105	103	102	101	100	99	98	97	96	94			
2	108	104	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88			
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	86	83	82			
4	98	91	85	81	96	90	85	81	88	83	80	86	82	79	84	81	78	77			
5	93	85	80	76	92	84	79	75	83	78	75	81	77	74	79	76	73	72			
6	89	80	75	70	88	80	74	70	78	73	70	77	73	69	75	72	69	67			
7	85	76	70	66	84	75	70	66	74	69	66	73	68	65	72	68	65	63			
8	81	72	66	62	80	71	66	62	70	65	62	69	65	61	68	64	61	60			
9	77	68	62	59	76	68	62	59	67	62	58	66	61	58	65	61	58	57			
10	74	65	59	55	73	64	59	55	64	59	55	63	58	55	62	58	55	54			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	115692
5°	112068
10°	97733
15°	80154
20°	62620
25°	47598
30°	34550
35°	23517
40°	15136
45°	9257
50°	4657
55°	1845
60°	1118
65°	441
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9257 cd/sqm



TEST NUMBER: P642609

CATALOG NUMBER: ML5615LSFL409FS1E - 693BB - 900LM - 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	185.2	14.5
10°-20°	390.5	30.5
20°-30°	360.8	28.2
30°-40°	223.2	17.4
40°-50°	95.9	7.5
50°-60°	20.7	1.6
60°-70°	3.7	0.3
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	936.5	73.2
0°-40°	1159.8	90.6
0°-60°	1276.3	99.7
0°-90°	1280.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1280.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2110	
5°	2036	185
15°	1412	391
25°	787	361
35°	351	223
45°	119	96
55°	19	21
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P642609

CATALOG NUMBER: ML5615LSFL409FS1E - 693BB - 900LM - 4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	2110.4
2.5°	2099.1
5°	2036.5
7.5°	1916.0
10°	1755.7
12.5°	1584.0
15°	1412.3
17.5°	1239.4
20°	1073.4
22.5°	922.2
25°	786.9
27.5°	660.7
30°	545.8
32.5°	442.3
35°	351.4
37.5°	275.2
40°	211.5
42.5°	163.7
45°	119.4
47.5°	87.6
50°	54.6
52.5°	28.4
55°	19.3
57.5°	13.6
60°	10.2
62.5°	6.8
65°	3.4
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)