

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642659

Luminaire Tested: ML5615LSFL409FS1E - 694TBZB - 1200LM - 4000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642659
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-45)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSFL409FS1E - 694TBZB - 1200LM - 4000K
Description: ML56 RR, 40D TIR OPTIC, 6" TUSCON BRONZE GIMBAL TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1660.7 lumens
Efficiency: N/A
Efficacy: 123.9 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642659
CATALOG NUMBER: ML5615LSFL409FS1E - 694TBZB - 1200LM - 4000K

Luminous Intensity Polar Plot

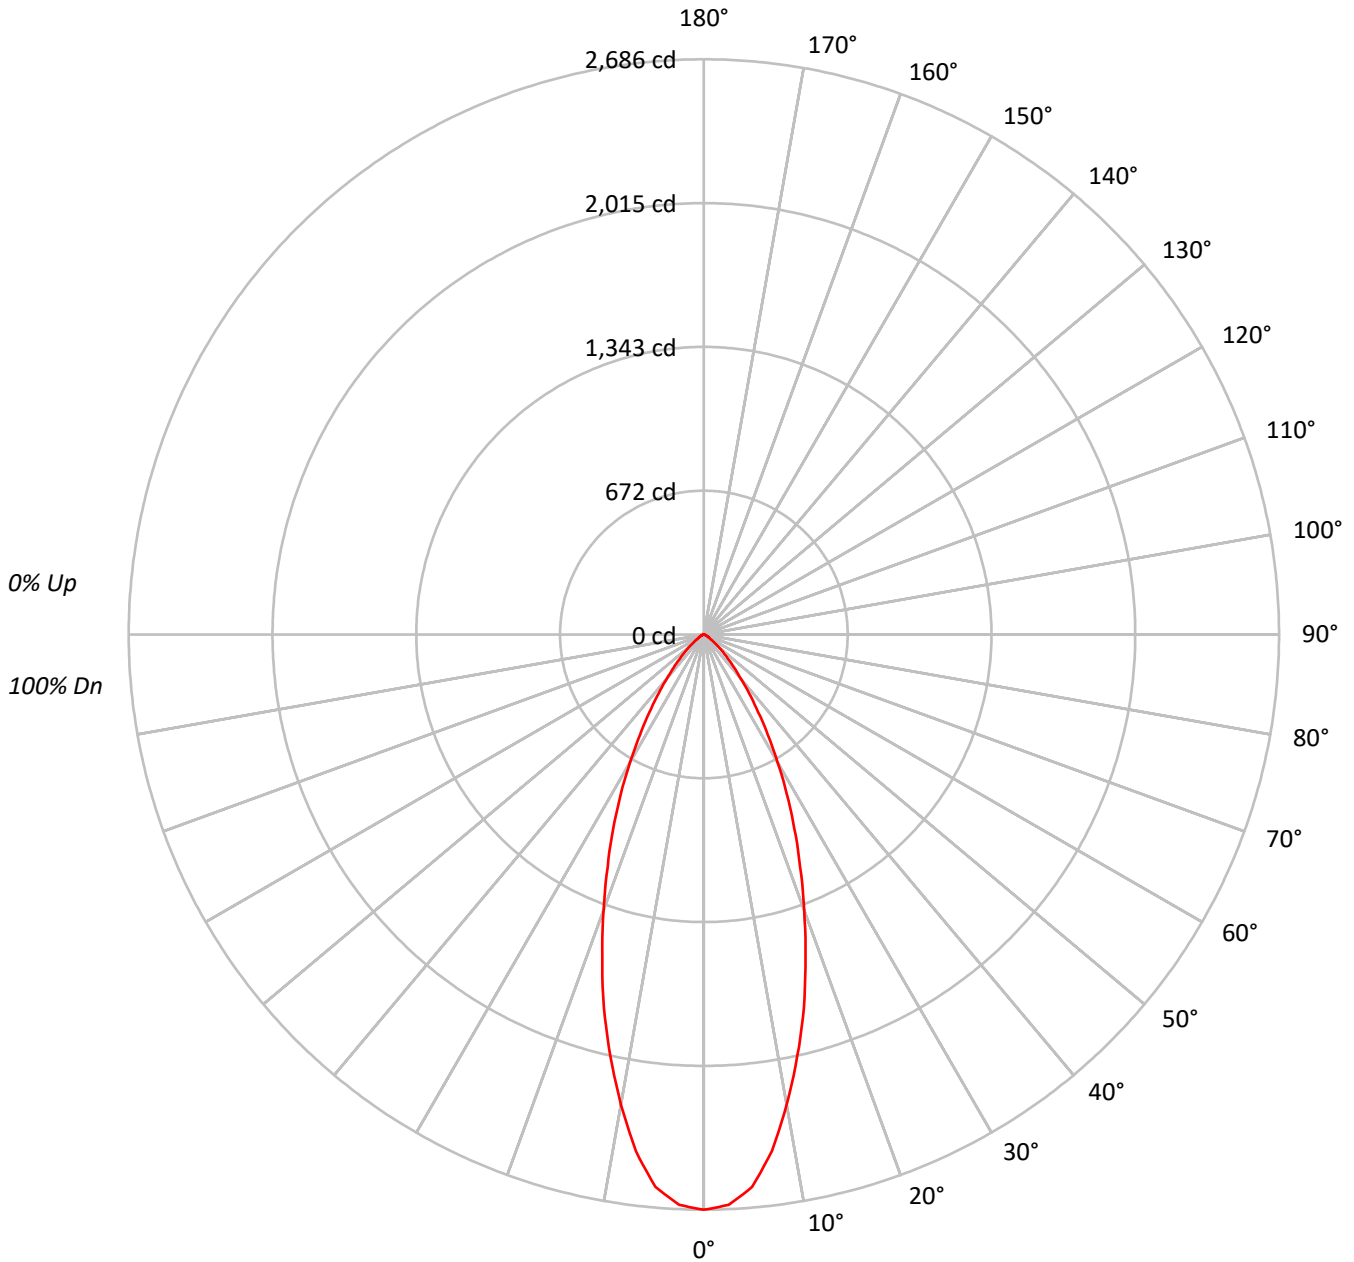



TEST NUMBER: P642659

CATALOG NUMBER: ML5615LSFL409FS1E - 694TBZB - 1200LM - 4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	93			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	91	92	90	89	87			
3	103	96	91	87	101	95	90	87	92	88	85	90	87	84	87	85	83	81			
4	97	90	85	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76			
5	93	84	79	74	91	84	78	74	82	77	73	80	76	73	79	75	72	71			
6	88	79	74	69	87	79	73	69	77	72	69	76	71	68	74	71	68	66			
7	84	75	69	65	83	74	69	65	73	68	64	72	67	64	71	67	64	62			
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59			
9	77	67	61	58	76	67	61	57	66	61	57	65	60	57	64	60	57	56			
10	73	64	58	54	72	63	58	54	63	58	54	62	57	54	61	57	54	53			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	147258
5°	142521
10°	124074
15°	102424
20°	79865
25°	60542
30°	43513
35°	29640
40°	19143
45°	12265
50°	7232
55°	3986
60°	2675
65°	1868
70°	1378
75°	911
80°	442
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12265 cd/sqm



TEST NUMBER: P642659

CATALOG NUMBER: ML5615LSFL409FS1E - 694TBZB - 1200LM - 4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	235.3	14.2
10°-20°	497.5	30.0
20°-30°	458.6	27.6
30°-40°	281.0	16.9
40°-50°	125.7	7.6
50°-60°	41.4	2.5
60°-70°	15.4	0.9
70°-80°	5.1	0.3
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1191.4	71.7
0°-40°	1472.4	88.7
0°-60°	1639.6	98.7
0°-90°	1660.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1660.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2686	
5°	2590	235
15°	1805	498
25°	1001	459
35°	443	281
45°	158	126
55°	42	41
65°	14	15
75°	4	5
85°	0	1
90°	0	



TEST NUMBER: P642659

CATALOG NUMBER: ML5615LSFL409FS1E - 694TBZB - 1200LM - 4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	2686.2
2.5°	2666.1
5°	2589.9
7.5°	2433.1
10°	2228.9
12.5°	2016.1
15°	1804.7
17.5°	1577.5
20°	1369.0
22.5°	1174.9
25°	1000.9
27.5°	838.4
30°	687.4
32.5°	555.1
35°	442.9
37.5°	346.6
40°	267.5
42.5°	207.1
45°	158.2
47.5°	117.9
50°	84.8
52.5°	59.0
55°	41.7
57.5°	31.6
60°	24.4
62.5°	20.1
65°	14.4
67.5°	11.5
70°	8.6
72.5°	7.2
75°	4.3
77.5°	2.9
80°	1.4
82.5°	1.4
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)