

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642686

Luminaire Tested: ML5615LSFL409FS1E - 696WB - 1200LM - 2700K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642686
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-46)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSFL409FS1E - 696WB - 1200LM - 2700K
Description: ML56 RR, 40D TIR OPTIC, 6" SHALLOW WHITE BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1459.6 lumens
Efficiency: N/A
Efficacy: 108.9 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642686
CATALOG NUMBER: ML5615LSFL409FS1E - 696WB - 1200LM - 2700K

Luminous Intensity Polar Plot

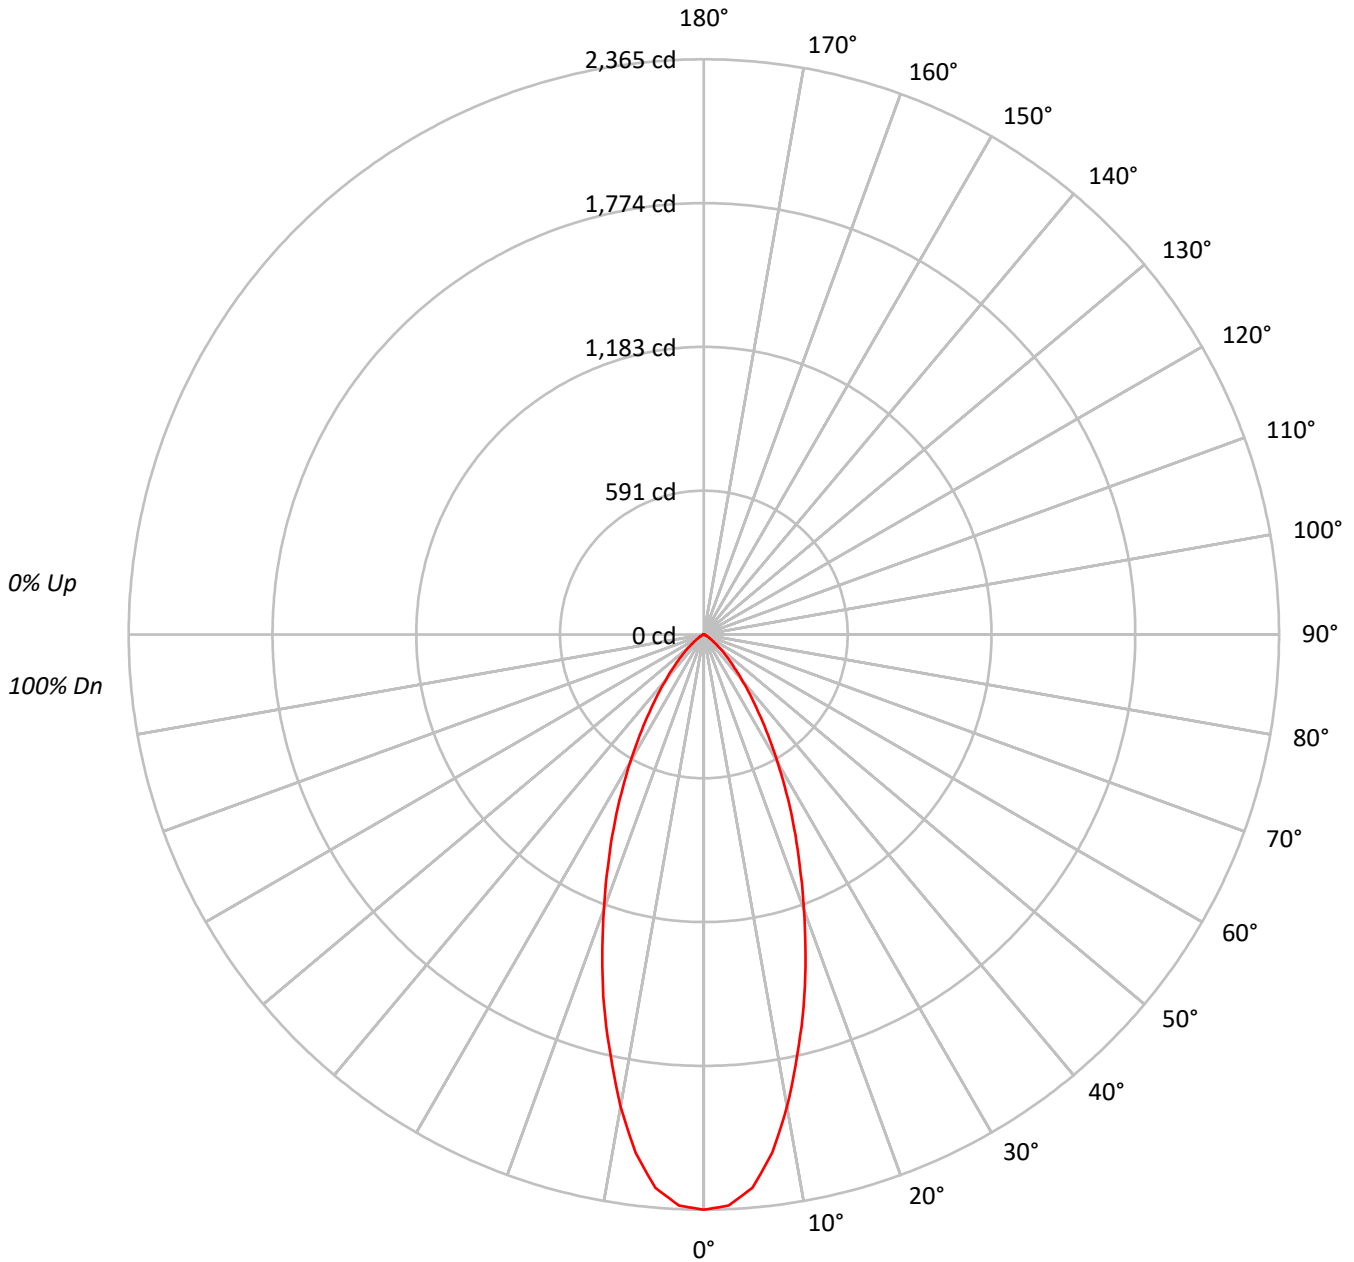



TEST NUMBER: P642686

CATALOG NUMBER: ML5615LSFL409FS1E - 696WB - 1200LM - 2700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	100	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	93	91	89	87			
3	103	96	91	87	101	95	90	87	92	89	85	90	87	84	88	85	83	81			
4	98	90	85	81	96	89	84	80	87	83	79	85	81	78	83	80	77	76			
5	93	85	79	75	91	84	78	74	82	77	74	80	76	73	79	75	72	71			
6	88	80	74	70	87	79	73	69	77	72	69	76	72	68	75	71	68	66			
7	84	75	69	65	83	74	69	65	73	68	65	72	68	64	71	67	64	63			
8	80	71	65	61	79	70	65	61	69	64	61	68	64	61	67	63	60	59			
9	77	67	62	58	76	67	61	58	66	61	57	65	60	57	64	60	57	56			
10	73	64	58	55	72	64	58	55	63	58	54	62	57	54	61	57	54	53			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	129661
5°	125704
10°	109706
15°	89966
20°	70134
25°	53066
30°	38253
35°	26227
40°	17189
45°	11172
50°	6575
55°	3622
60°	2083
65°	1141
70°	609
75°	275
80°	410
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11172 cd/sqm



TEST NUMBER: P642686

CATALOG NUMBER: ML5615LSFL409FS1E - 696WB - 1200LM - 2700K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.7	14.2
10°-20°	437.6	30.0
20°-30°	402.2	27.6
30°-40°	249.1	17.1
40°-50°	113.9	7.8
50°-60°	36.9	2.5
60°-70°	9.6	0.7
70°-80°	2.0	0.1
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1047.5	71.8
0°-40°	1296.5	88.8
0°-60°	1447.4	99.2
0°-90°	1459.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1459.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2365	
5°	2284	208
15°	1585	438
25°	877	402
35°	392	249
45°	144	114
55°	38	37
65°	9	10
75°	1	2
85°	0	1
90°	0	



TEST NUMBER: P642686

CATALOG NUMBER: ML5615LSFL409FS1E - 696WB - 1200LM - 2700K

CANDELA DISTRIBUTION (FULL):

0°	
0°	2365.2
2.5°	2350.0
5°	2284.3
7.5°	2149.0
10°	1970.8
12.5°	1771.1
15°	1585.2
17.5°	1388.0
20°	1202.2
22.5°	1030.3
25°	877.3
27.5°	734.5
30°	604.3
32.5°	490.5
35°	391.9
37.5°	309.7
40°	240.2
42.5°	187.1
45°	144.1
47.5°	107.5
50°	77.1
52.5°	54.4
55°	37.9
57.5°	26.5
60°	19.0
62.5°	13.9
65°	8.8
67.5°	5.1
70°	3.8
72.5°	2.5
75°	1.3
77.5°	1.3
80°	1.3
82.5°	1.3
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)