

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642687

Luminaire Tested: ML5615LSFL409FS1E - 696WB - 1200LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642687
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-46)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSFL409FS1E - 696WB - 1200LM - 3000K
Description: ML56 RR, 40D TIR OPTIC, 6" SHALLOW WHITE BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1501.2 lumens
Efficiency: N/A
Efficacy: 112.0 lumens/watt
Spacing Criteria (0/90/45): 0.64 / 0.64 / 0.69
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642687
CATALOG NUMBER: ML5615LSFL409FS1E - 696WB - 1200LM - 3000K

Luminous Intensity Polar Plot

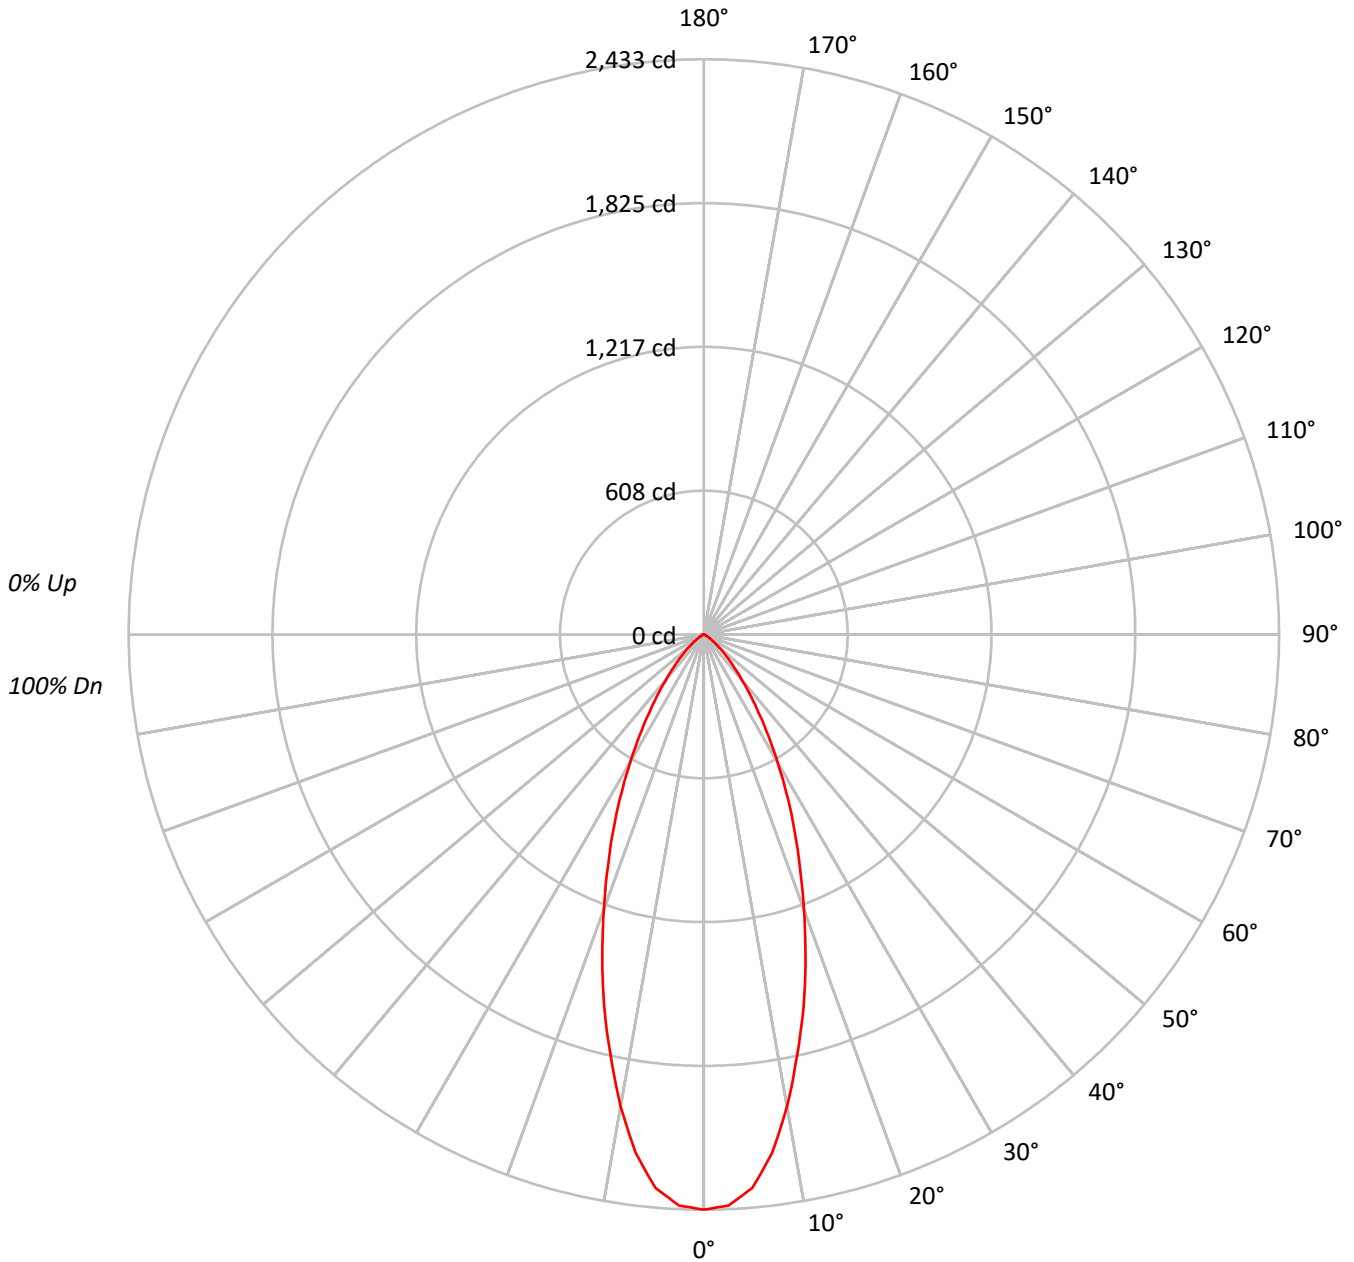



TEST NUMBER: P642687

CATALOG NUMBER: ML5615LSFL409FS1E - 696WB - 1200LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	114	111	108	106	111	109	106	104	105	103	101	101	100	98	97	96	95	94			94
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	93	91	89	87			87
3	103	96	91	87	101	95	90	87	92	89	85	90	87	84	88	85	83	81			81
4	98	90	85	81	96	89	84	80	87	83	79	85	81	78	83	80	77	76			76
5	93	85	79	75	91	84	78	74	82	77	74	80	76	73	79	75	72	71			71
6	88	80	74	70	87	79	73	69	77	72	69	76	72	68	75	71	68	66			66
7	84	75	69	65	83	74	69	65	73	68	65	72	68	64	71	67	64	63			63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	61	67	63	60	59			59
9	77	67	62	58	76	67	61	58	66	61	57	65	60	57	64	60	57	56			56
10	73	64	58	55	72	64	58	55	63	58	54	62	57	54	61	57	54	53			53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	133367
5°	129297
10°	112840
15°	92537
20°	72135
25°	54584
30°	39341
35°	26977
40°	17676
45°	11490
50°	6763
55°	3727
60°	2138
65°	1180
70°	625
75°	275
80°	410
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11490 cd/sqm



TEST NUMBER: P642687

CATALOG NUMBER: ML5615LSFL409FS1E - 696WB - 1200LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	213.6	14.2
10°-20°	450.1	30.0
20°-30°	413.7	27.6
30°-40°	256.2	17.1
40°-50°	117.2	7.8
50°-60°	38.0	2.5
60°-70°	9.9	0.7
70°-80°	2.1	0.1
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1077.4	71.8
0°-40°	1333.6	88.8
0°-60°	1488.7	99.2
0°-90°	1501.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1501.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2433	
5°	2350	214
15°	1630	450
25°	902	414
35°	403	256
45°	148	117
55°	39	38
65°	9	10
75°	1	2
85°	0	1
90°	0	



TEST NUMBER: P642687

CATALOG NUMBER: ML5615LSFL409FS1E - 696WB - 1200LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	2432.8
2.5°	2417.2
5°	2349.6
7.5°	2210.4
10°	2027.1
12.5°	1821.7
15°	1630.5
17.5°	1427.7
20°	1236.5
22.5°	1059.7
25°	902.4
27.5°	755.4
30°	621.5
32.5°	504.5
35°	403.1
37.5°	318.6
40°	247.0
42.5°	192.4
45°	148.2
47.5°	110.5
50°	79.3
52.5°	55.9
55°	39.0
57.5°	27.3
60°	19.5
62.5°	14.3
65°	9.1
67.5°	5.2
70°	3.9
72.5°	2.6
75°	1.3
77.5°	1.3
80°	1.3
82.5°	1.3
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)