

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642757

Luminaire Tested: ML5615LSNFL259FS1E - 592W - 900LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642757
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSNFL259FS1E - 592W - 900LM - 3000K
Description: ML56 RR, 25D TIR OPTIC, 5" WHITE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1074.9 lumens
Efficiency: N/A
Efficacy: 102.4 lumens/watt
Spacing Criteria (0/90/45): 0.43 / 0.43 / 0.44
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642757
CATALOG NUMBER: ML5615LSNFL259FS1E - 592W - 900LM - 3000K

Luminous Intensity Polar Plot

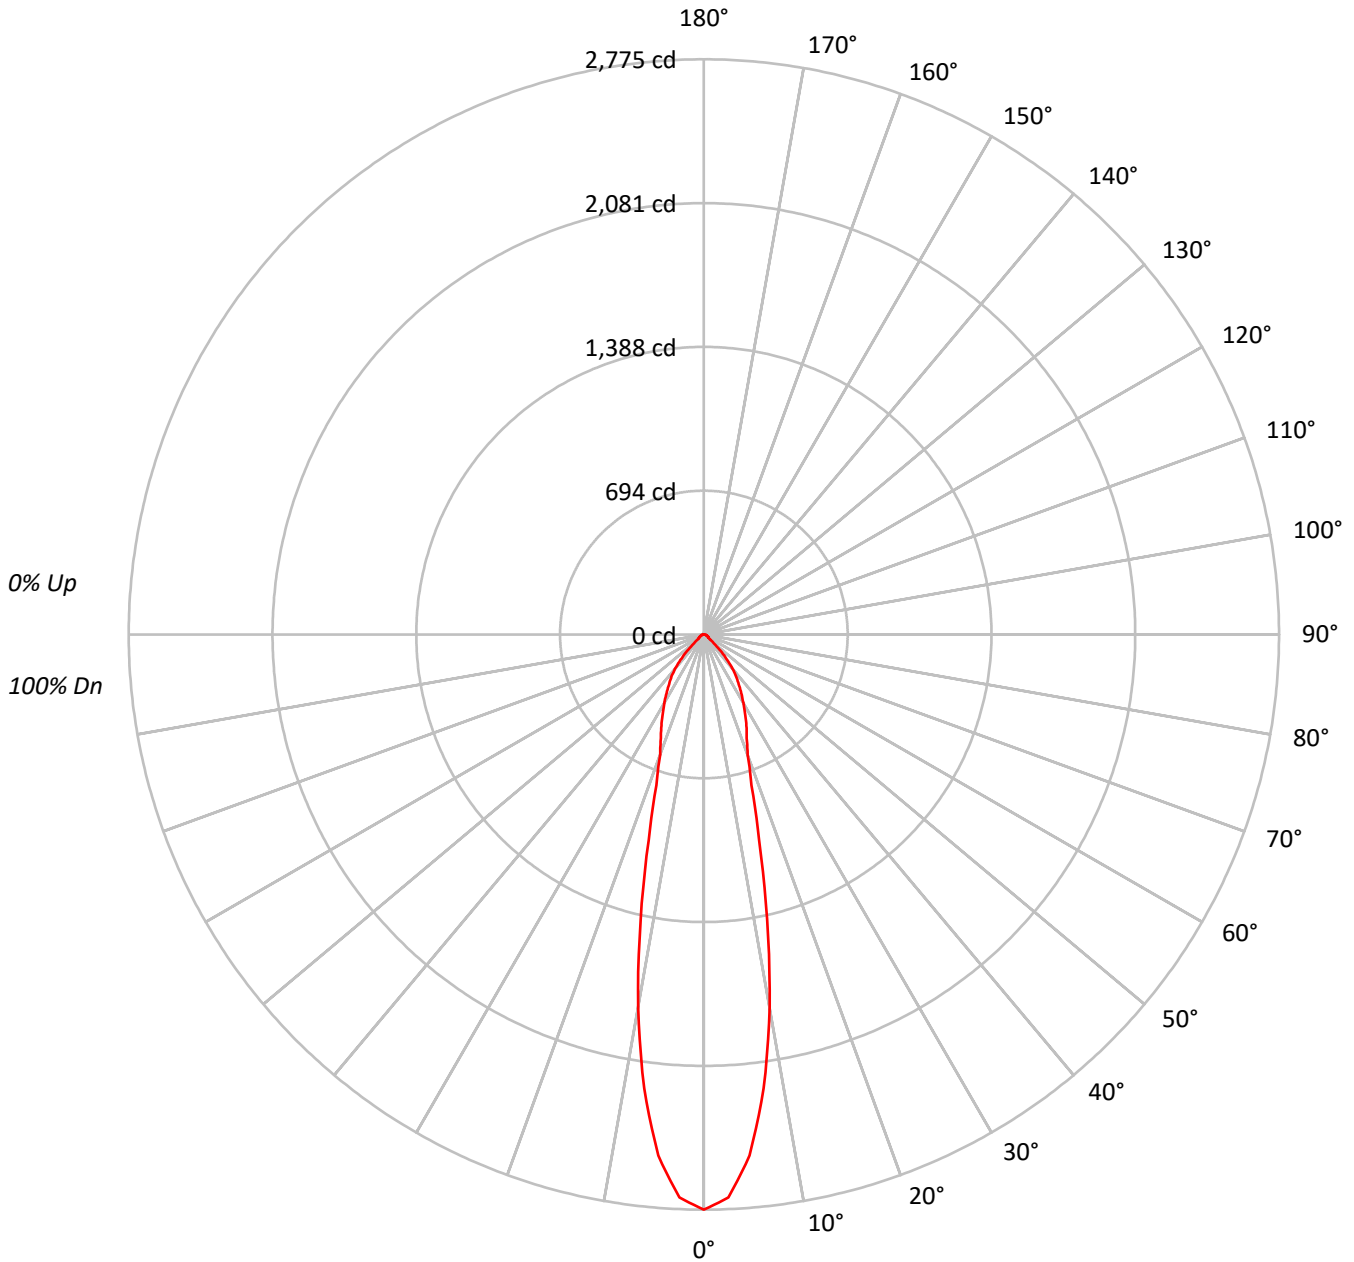



TEST NUMBER: P642757

CATALOG NUMBER: ML5615LSNFL259FS1E - 592W - 900LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	106	111	108	106	104	104	102	101	100	99	98	97	96	95	93	93	93	93
2	108	103	99	95	105	101	97	94	98	95	92	95	92	90	92	90	88	86	86	86	86
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	81	81	81	81
4	97	90	84	80	96	89	84	80	87	82	79	85	81	78	83	79	77	75	75	75	75
5	93	84	79	74	91	84	78	74	82	77	73	80	76	73	79	75	72	71	71	71	71
6	88	80	74	70	87	79	73	69	77	73	69	76	72	69	75	71	68	67	67	67	67
7	85	76	70	66	83	75	69	65	74	69	65	72	68	65	71	67	64	63	63	63	63
8	81	72	66	62	80	71	66	62	70	65	62	69	65	61	68	64	61	60	60	60	60
9	78	68	63	59	76	68	62	59	67	62	59	66	62	58	65	61	58	57	57	57	57
10	74	65	60	56	73	65	59	56	64	59	56	63	59	56	63	58	55	54	54	54	54

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	219053
5°	200000
10°	146418
15°	84055
20°	51757
25°	42279
30°	34684
35°	28246
40°	22259
45°	13776
50°	5183
55°	3964
60°	3742
65°	3456
70°	3324
75°	3447
80°	3273
85°	2808

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13776 cd/sqm



TEST NUMBER: P642757

CATALOG NUMBER: ML5615LSNFL259FS1E - 592W - 900LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	218.2	20.3
10°-20°	295.2	27.5
20°-30°	223.1	20.8
30°-40°	183.8	17.1
40°-50°	94.0	8.7
50°-60°	26.8	2.5
60°-70°	18.5	1.7
70°-80°	11.8	1.1
80°-90°	3.5	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	736.5	68.5
0°-40°	920.3	85.6
0°-60°	1041.1	96.9
0°-90°	1074.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1074.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2775	
5°	2524	218
15°	1028	295
25°	485	223
35°	293	184
45°	123	94
55°	29	27
65°	18	18
75°	11	12
85°	3	3
90°	0	



TEST NUMBER: P642757

CATALOG NUMBER: ML5615LSNFL259FS1E - 592W - 900LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	2774.9
2.5°	2719.3
5°	2523.9
7.5°	2209.2
10°	1826.6
12.5°	1407.0
15°	1028.5
17.5°	762.1
20°	616.1
22.5°	541.0
25°	485.4
27.5°	429.9
30°	380.5
32.5°	335.3
35°	293.1
37.5°	256.1
40°	216.0
42.5°	166.6
45°	123.4
47.5°	76.1
50°	42.2
52.5°	32.9
55°	28.8
57.5°	25.7
60°	23.7
62.5°	20.6
65°	18.5
67.5°	16.5
70°	14.4
72.5°	13.4
75°	11.3
77.5°	9.3
80°	7.2
82.5°	5.1
85°	3.1
87.5°	1.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)