

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P642970

Luminaire Tested: ML5615LSNFL259FS1E - 693SNB - 900LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P642970
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-19)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSNFL259FS1E - 693SNB - 900LM - 5000K
Description: ML56 RR, 25D TIR OPTIC, 6" SATIN NICKLE BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1183.8 lumens
Efficiency: N/A
Efficacy: 112.7 lumens/watt
Spacing Criteria (0/90/45): 0.43 / 0.43 / 0.44
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P642970
CATALOG NUMBER: ML5615LSNFL259FS1E - 693SNB - 900LM - 5000K

Luminous Intensity Polar Plot

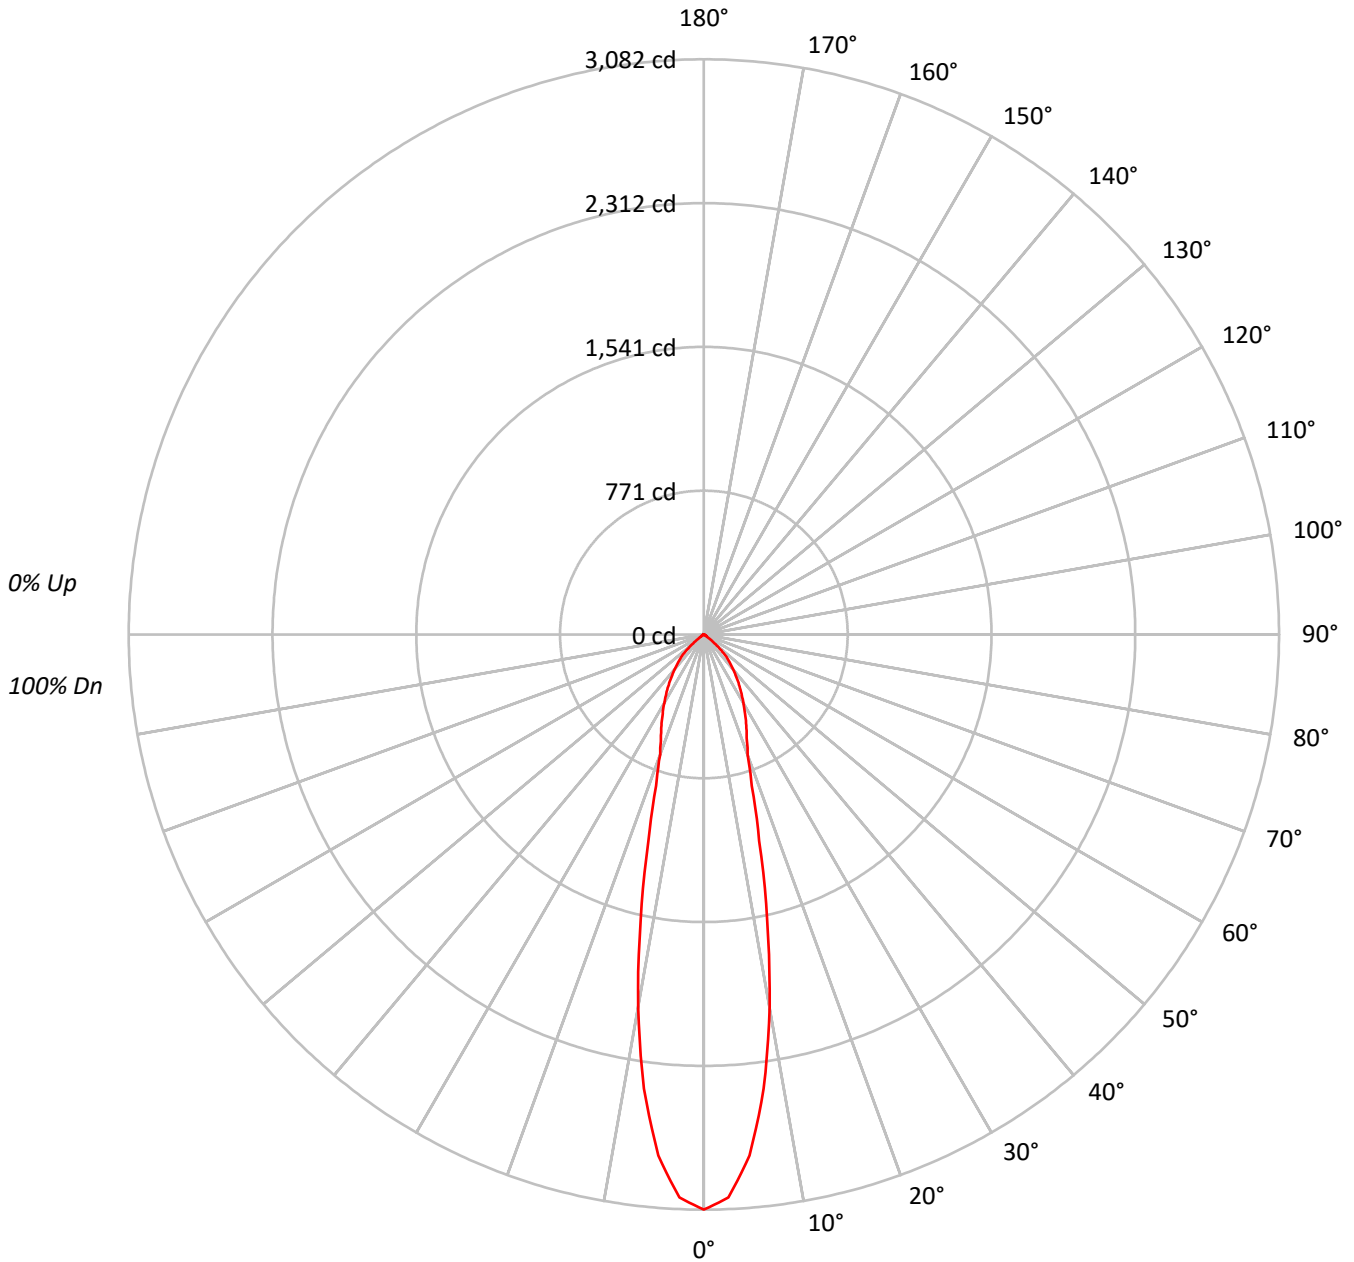



TEST NUMBER: P642970

CATALOG NUMBER: ML5615LSNFL259FS1E - 693SNB - 900LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100	
1	114	111	109	106	111	109	107	105	105	103	102	101	100	99	98	97	96	94			94	
2	108	104	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88			88	
3	103	97	92	88	101	96	91	88	93	89	86	91	87	85	88	86	84	82			82	
4	98	91	86	82	96	90	85	81	88	83	80	86	82	79	84	81	78	77			77	
5	94	86	80	76	92	85	79	75	83	78	75	81	77	74	80	76	73	72			72	
6	89	81	75	71	88	80	75	71	78	74	70	77	73	70	76	72	69	68			68	
7	85	76	71	67	84	76	70	66	74	70	66	73	69	66	72	68	65	64			64	
8	82	73	67	63	80	72	67	63	71	66	63	70	66	62	69	65	62	61			61	
9	78	69	63	60	77	69	63	60	68	63	59	67	62	59	66	62	59	58			58	
10	75	66	60	57	74	65	60	57	65	60	57	64	59	56	63	59	56	55			55	

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	168928
5°	154187
10°	112879
15°	65029
20°	39985
25°	32518
30°	26840
35°	21984
40°	17490
45°	13482
50°	7172
55°	1845
60°	1118
65°	584
70°	176
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13482 cd/sqm



TEST NUMBER: P642970

CATALOG NUMBER: ML5615LSNFL259FS1E - 693SNB - 900LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	242.4	20.5
10°-20°	328.6	27.8
20°-30°	247.8	20.9
30°-40°	205.0	17.3
40°-50°	128.3	10.8
50°-60°	26.3	2.2
60°-70°	4.7	0.4
70°-80°	0.7	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	818.8	69.2
0°-40°	1023.8	86.5
0°-60°	1178.4	99.5
0°-90°	1183.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1183.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3082	
5°	2802	242
15°	1146	329
25°	538	248
35°	328	205
45°	174	128
55°	19	26
65°	4	5
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P642970

CATALOG NUMBER: ML5615LSNFL259FS1E - 693SNB - 900LM - 5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	3081.5
2.5°	3020.1
5°	2801.9
7.5°	2455.2
10°	2027.8
12.5°	1564.0
15°	1145.8
17.5°	851.4
20°	685.4
22.5°	600.2
25°	537.6
27.5°	478.5
30°	424.0
32.5°	374.0
35°	328.5
37.5°	283.0
40°	244.4
42.5°	206.9
45°	173.9
47.5°	126.2
50°	84.1
52.5°	39.8
55°	19.3
57.5°	13.6
60°	10.2
62.5°	6.8
65°	4.5
67.5°	2.3
70°	1.1
72.5°	1.1
75°	0.0
77.5°	1.1
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)