

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643062

Luminaire Tested: ML5615LSVWFL759FS1E - 592H - 1200LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643062
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-72)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL759FS1E - 592H - 1200LM - 3000K
Description: ML56 RR, 75D TIR OPTIC, 5" HAZE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1404.9 lumens
Efficiency: N/A
Efficacy: 104.8 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.07
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct

Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643062
CATALOG NUMBER: ML5615LSVWFL759FS1E - 592H - 1200LM - 3000K

Luminous Intensity Polar Plot

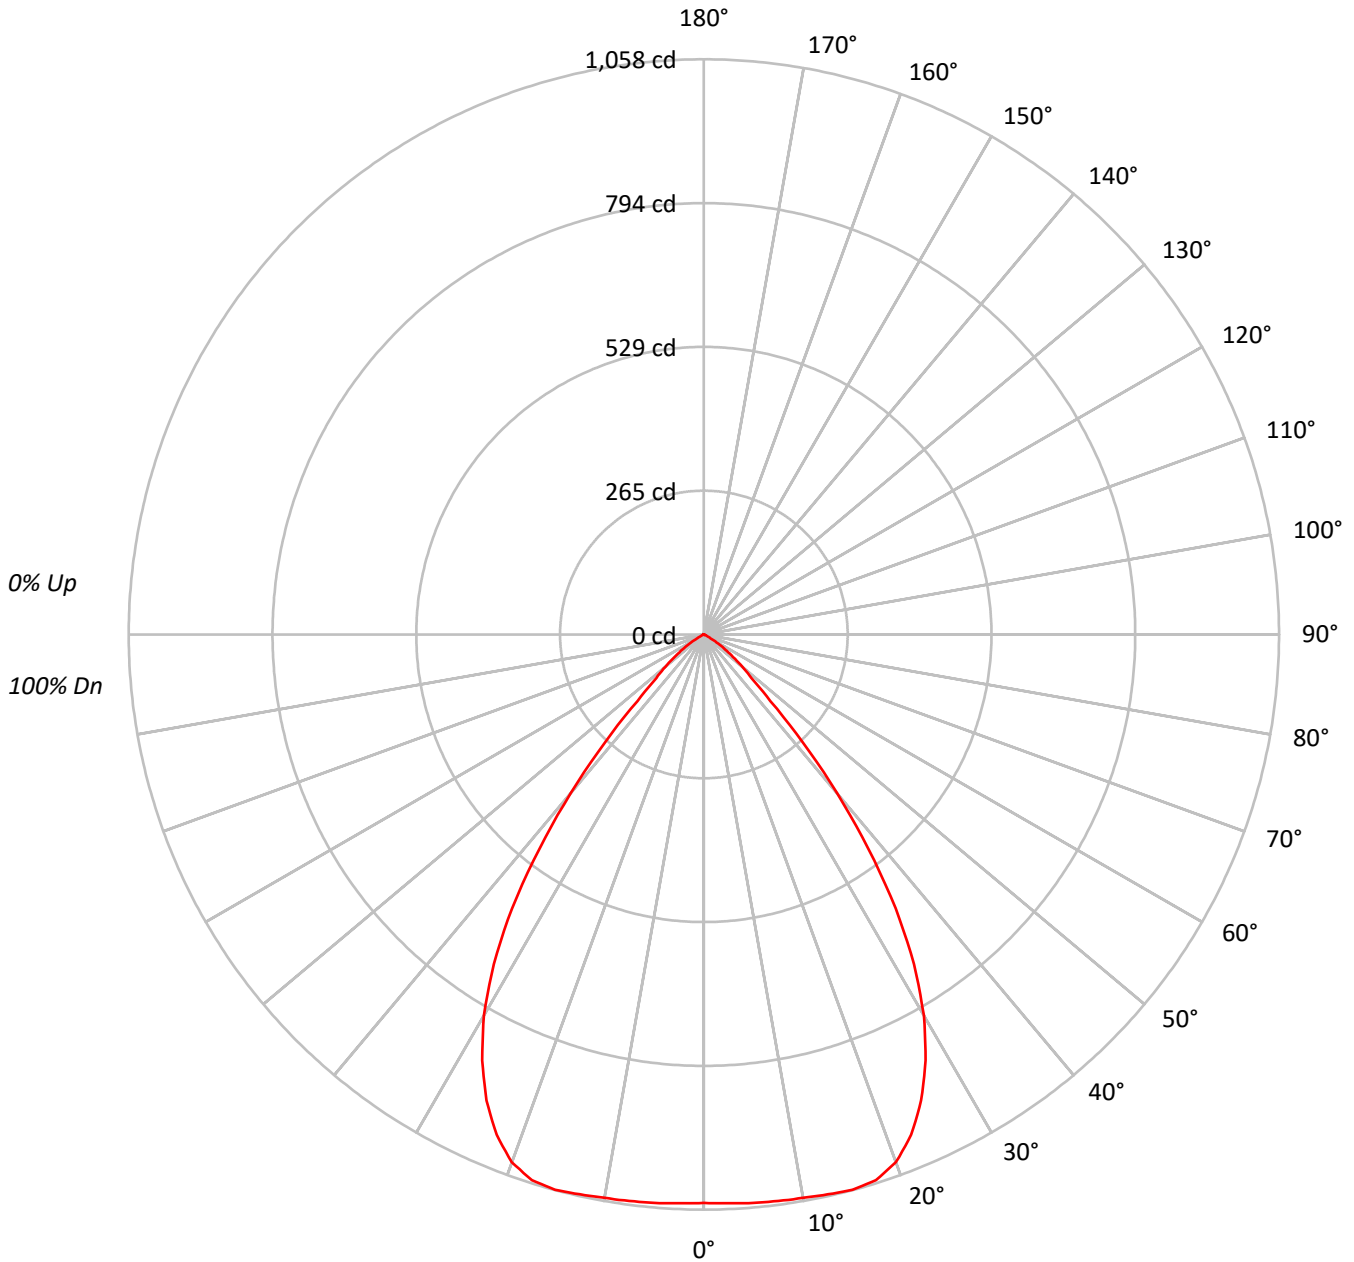



TEST NUMBER: P643062

CATALOG NUMBER: ML5615LSVWFL759FS1E - 592H - 1200LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93	93	93	93
2	107	101	97	93	105	100	96	92	96	93	90	93	91	88	91	88	87	85	85	85	85
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78	78	78	78
4	95	87	81	76	93	85	80	75	83	78	75	81	77	74	79	76	73	71	71	71	71
5	89	80	74	69	88	79	73	69	77	72	68	76	71	68	74	70	67	65	65	65	65
6	84	74	68	63	83	74	67	63	72	67	63	71	66	62	69	65	62	60	60	60	60
7	79	69	63	58	78	69	62	58	67	62	58	66	61	57	65	60	57	55	55	55	55
8	75	65	58	54	74	64	58	53	63	57	53	62	57	53	61	56	53	51	51	51	51
9	71	60	54	50	70	60	54	50	59	53	49	58	53	49	57	52	49	48	48	48	48
10	67	57	50	46	66	56	50	46	55	50	46	55	49	46	54	49	46	44	44	44	44

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	82556
5°	83181
10°	84351
15°	86425
20°	86763
25°	82363
30°	73743
35°	59286
40°	39272
45°	19314
50°	11348
55°	6620
60°	2258
65°	486
70°	300
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 19314 cd/sqm



TEST NUMBER: P643062

CATALOG NUMBER: ML5615LSVWFL759FS1E - 592H - 1200LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	100.3	7.1
10°-20°	298.0	21.2
20°-30°	430.4	30.6
30°-40°	375.8	26.7
40°-50°	151.0	10.7
50°-60°	44.3	3.2
60°-70°	4.8	0.3
70°-80°	0.5	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	828.6	59.0
0°-40°	1204.4	85.7
0°-60°	1399.7	99.6
0°-90°	1404.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1404.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1046	
5°	1050	100
15°	1058	298
25°	946	430
35°	615	376
45°	173	151
55°	48	44
65°	3	5
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P643062

CATALOG NUMBER: ML5615LSVWFL759FS1E - 592H - 1200LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1045.8
2.5°	1047.1
5°	1049.7
7.5°	1051.0
10°	1052.3
12.5°	1054.9
15°	1057.5
17.5°	1052.3
20°	1032.8
22.5°	996.3
25°	945.6
27.5°	883.2
30°	809.0
32.5°	719.3
35°	615.2
37.5°	496.9
40°	381.1
42.5°	267.9
45°	173.0
47.5°	118.4
50°	92.4
52.5°	67.6
55°	48.1
57.5°	31.2
60°	14.3
62.5°	7.8
65°	2.6
67.5°	1.3
70°	1.3
72.5°	1.3
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)