

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643168

Luminaire Tested: ML5615LSVWFL759FS1E - 594SNB - 1200LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643168
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-79)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL759FS1E - 594SNB - 1200LM - 3500K
Description: ML56 RR, 75D TIR OPTIC, 5" SATIN NICKLE GIMBAL TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1465.9 lumens
Efficiency: N/A
Efficacy: 109.4 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643168

CATALOG NUMBER: ML5615LSVWFL759FS1E - 594SNB - 1200LM - 3500K

Luminous Intensity Polar Plot

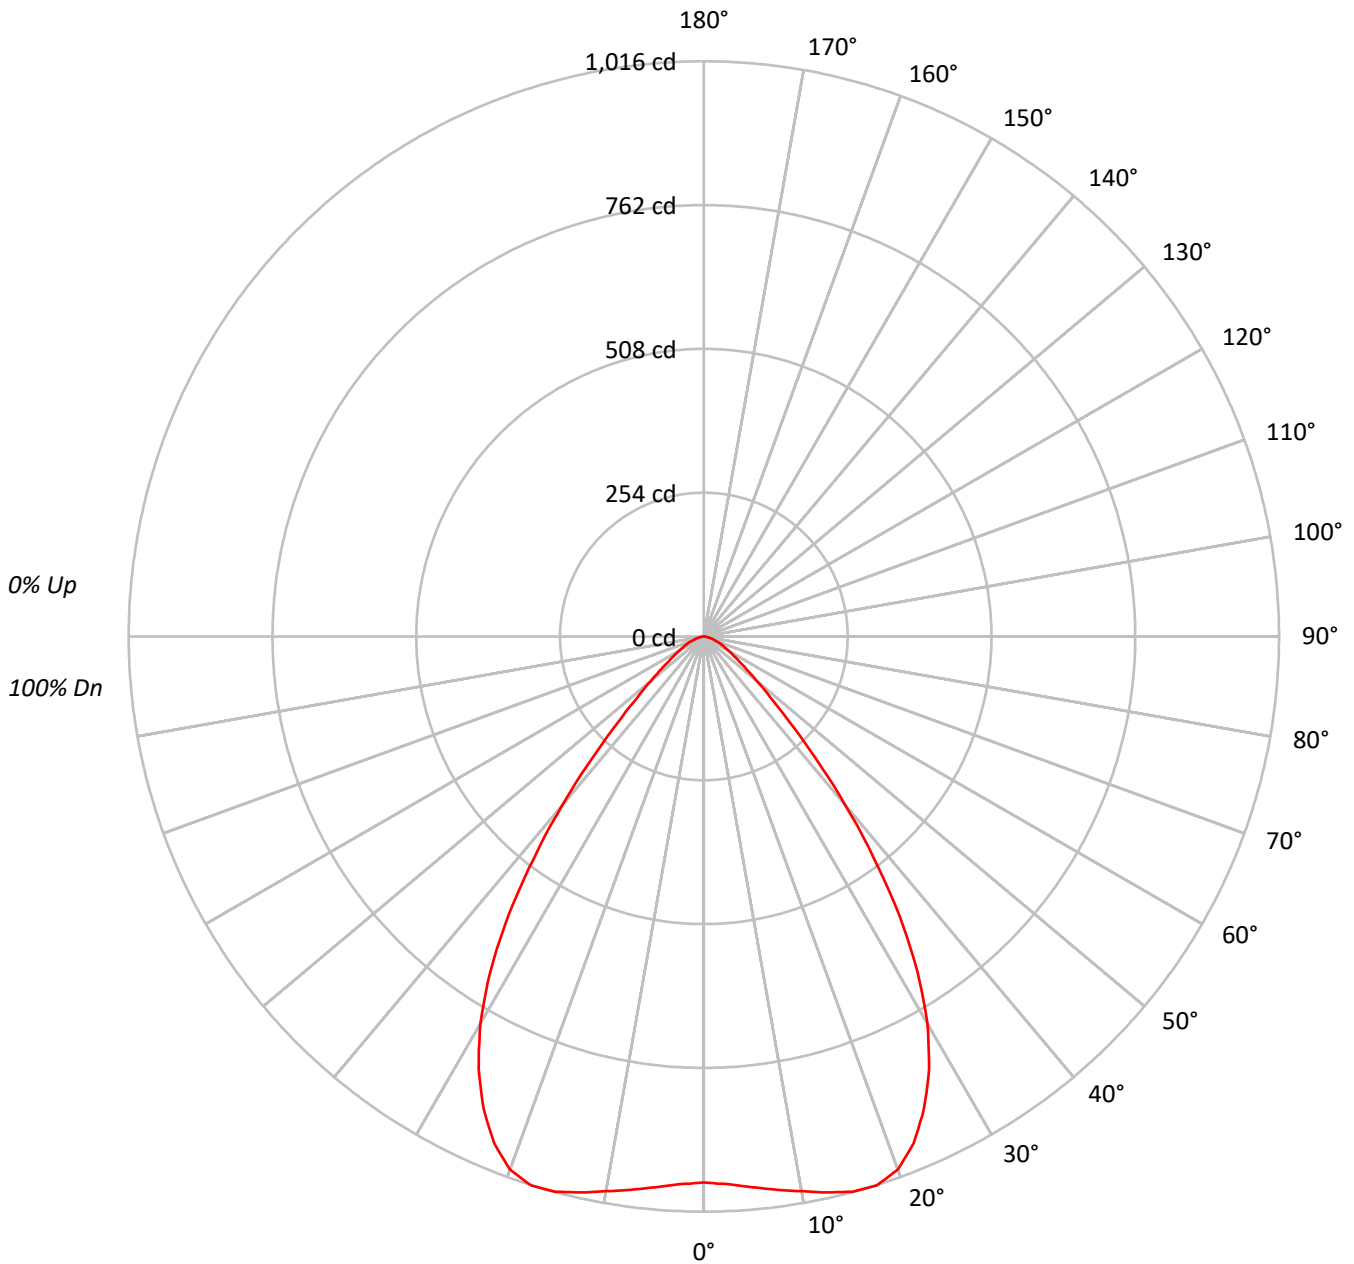



TEST NUMBER: P643168

CATALOG NUMBER: ML5615LSVWFL759FS1E - 594SNB - 1200LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	104	110	107	104	102	103	101	99	99	98	96	96	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	84	83			
3	99	92	86	81	97	90	85	80	87	83	79	85	81	78	83	79	77	75			
4	93	84	78	73	91	83	77	72	81	76	72	79	74	71	77	73	70	68			
5	87	78	71	66	86	77	70	66	75	69	65	73	68	64	71	67	64	62			
6	82	72	65	60	81	71	64	60	69	64	59	68	63	59	67	62	58	57			
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52			
8	73	62	55	50	72	61	55	50	60	54	50	59	54	50	58	53	50	48			
9	69	58	51	47	68	57	51	47	56	50	46	55	50	46	54	50	46	44			
10	65	54	48	43	64	54	47	43	53	47	43	52	47	43	51	46	43	41			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	76131
5°	77372
10°	79766
15°	82968
20°	84158
25°	80160
30°	71956
35°	58053
40°	40056
45°	23857
50°	15093
55°	10295
60°	8020
65°	6482
70°	5239
75°	4087
80°	2409
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 23857 cd/sqm



TEST NUMBER: P643168

CATALOG NUMBER: ML5615LSVWFL759FS1E - 594SNB - 1200LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	93.8	6.4
10°-20°	286.2	19.5
20°-30°	419.0	28.6
30°-40°	369.9	25.2
40°-50°	175.5	12.0
50°-60°	70.7	4.8
60°-70°	35.1	2.4
70°-80°	14.3	1.0
80°-90°	1.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	799.0	54.5
0°-40°	1168.9	79.7
0°-60°	1415.1	96.5
0°-90°	1465.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1465.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	964	
5°	976	94
15°	1015	286
25°	920	419
35°	602	370
45°	214	175
55°	75	71
65°	35	35
75°	13	14
85°	0	1
90°	0	



TEST NUMBER: P643168

CATALOG NUMBER: ML5615LSVWFL759FS1E - 594SNB - 1200LM - 3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	964.4
2.5°	968.4
5°	976.4
7.5°	985.8
10°	995.1
12.5°	1005.8
15°	1015.2
17.5°	1016.5
20°	1001.8
22.5°	968.4
25°	920.3
27.5°	861.6
30°	789.4
32.5°	702.6
35°	602.4
37.5°	492.9
40°	388.7
42.5°	292.5
45°	213.7
47.5°	159.0
50°	122.9
52.5°	94.8
55°	74.8
57.5°	61.4
60°	50.8
62.5°	41.4
65°	34.7
67.5°	29.4
70°	22.7
72.5°	17.4
75°	13.4
77.5°	9.4
80°	5.3
82.5°	2.7
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)