

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643215

Luminaire Tested: ML5615LSVWFL759FS1E - 596WB - 1200LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643215
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-81)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL759FS1E - 596WB - 1200LM - 5000K
Description: ML56 RR, 75D TIR OPTIC, 5" SHALLOW WHITE BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1575.0 lumens
Efficiency: N/A
Efficacy: 117.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.1
Luminous Opening: Circular (Dia: 0.42' x H: 0')
CIE Type: Direct


Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643215

CATALOG NUMBER: ML5615LSVWFL759FS1E - 596WB - 1200LM - 5000K

Luminous Intensity Polar Plot

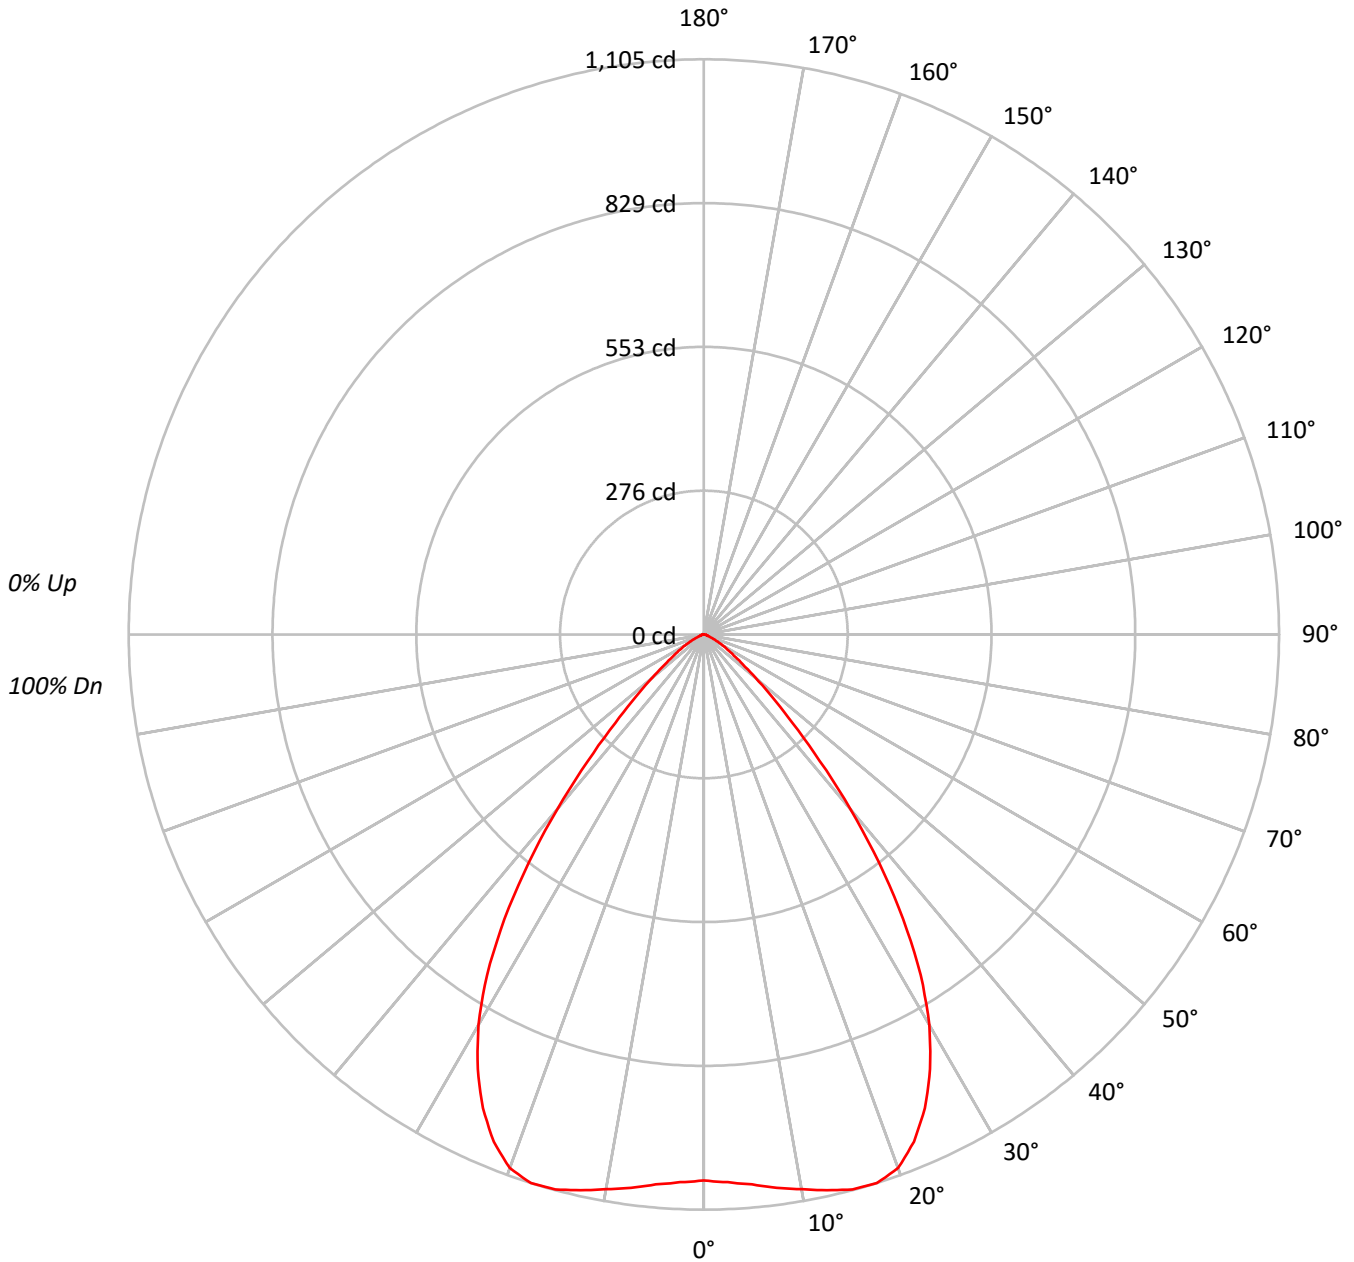



TEST NUMBER: P643215

CATALOG NUMBER: ML5615LSVWFL759FS1E - 596WB - 1200LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	104	110	107	105	103	103	101	99	100	98	96	96	95	94	92			92
2	106	101	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83			83
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76			76
4	94	85	79	74	92	84	78	73	82	77	73	80	75	72	78	74	71	69			69
5	88	78	72	67	86	77	71	67	76	70	66	74	69	65	72	68	65	63			63
6	83	73	66	61	81	72	65	61	70	65	60	69	64	60	67	63	59	58			58
7	78	67	61	56	76	67	60	56	65	60	55	64	59	55	63	58	55	53			53
8	73	63	56	51	72	62	56	51	61	55	51	60	55	51	59	54	50	49			49
9	69	59	52	47	68	58	52	47	57	51	47	56	51	47	55	50	47	45			45
10	66	55	48	44	65	54	48	44	53	48	44	53	47	44	52	47	43	42			42

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	82809
5°	84037
10°	86740
15°	90201
20°	91627
25°	87485
30°	78966
35°	64346
40°	45084
45°	26827
50°	15904
55°	9703
60°	6584
65°	3754
70°	1985
75°	1769
80°	1955
85°	1268

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 26827 cd/sqm



TEST NUMBER: P643215

CATALOG NUMBER: ML5615LSVWFL759FS1E - 596WB - 1200LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	102.0	6.5
10°-20°	311.2	19.8
20°-30°	457.4	29.0
30°-40°	410.5	26.1
40°-50°	196.2	12.5
50°-60°	67.5	4.3
60°-70°	21.7	1.4
70°-80°	6.3	0.4
80°-90°	2.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	870.6	55.3
0°-40°	1281.1	81.3
0°-60°	1544.8	98.1
0°-90°	1575.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1575.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1049	
5°	1060	102
15°	1104	311
25°	1004	457
35°	668	411
45°	240	196
55°	70	68
65°	20	22
75°	6	6
85°	1	2
90°	0	



TEST NUMBER: P643215

CATALOG NUMBER: ML5615LSVWFL759FS1E - 596WB - 1200LM - 5000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1049.0
2.5°	1053.3
5°	1060.5
7.5°	1072.0
10°	1082.1
12.5°	1093.6
15°	1103.7
17.5°	1105.1
20°	1090.7
22.5°	1054.8
25°	1004.4
27.5°	941.1
30°	866.3
32.5°	775.6
35°	667.7
37.5°	552.6
40°	437.5
42.5°	329.5
45°	240.3
47.5°	177.0
50°	129.5
52.5°	93.5
55°	70.5
57.5°	54.7
60°	41.7
62.5°	30.2
65°	20.1
67.5°	13.0
70°	8.6
72.5°	7.2
75°	5.8
77.5°	4.3
80°	4.3
82.5°	2.9
85°	1.4
87.5°	1.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)