

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643230

Luminaire Tested: ML5615LSVWFL759FS1E - 691WB - 1200LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643230
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-82)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL759FS1E - 691WB - 1200LM - 5000K
Description: ML56 RR, 75D TIR OPTIC, 6" DEADFRONT TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1572.1 lumens
Efficiency: N/A
Efficacy: 117.3 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.09
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643230

CATALOG NUMBER: ML5615LSVWFL759FS1E - 691WB - 1200LM - 5000K

Luminous Intensity Polar Plot

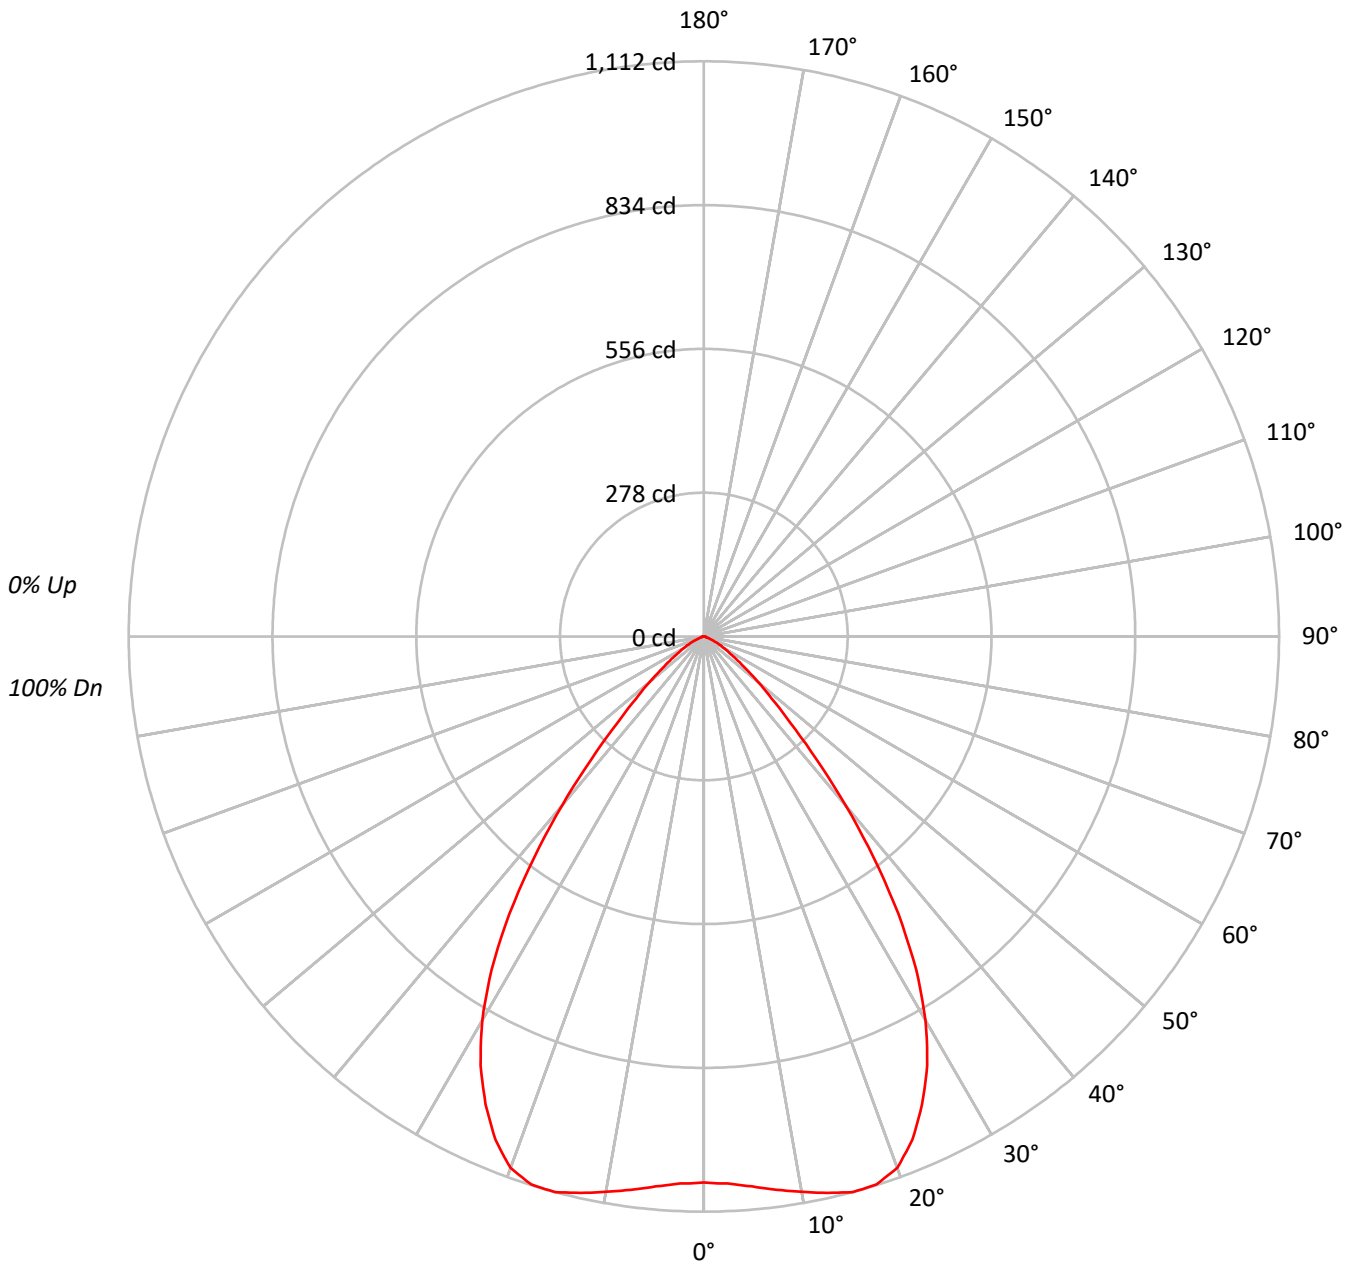



TEST NUMBER: P643230

CATALOG NUMBER: ML5615LSVWFL759FS1E - 691WB - 1200LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	107	104	110	107	105	103	103	101	99	100	98	96	96	95	94	92			
2	106	100	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76			
4	94	85	79	74	92	84	78	73	82	76	72	79	75	72	78	74	71	69			
5	88	78	72	67	86	77	71	67	76	70	66	74	69	65	72	68	65	63			
6	83	73	66	61	81	72	65	61	70	64	60	69	64	60	67	63	59	58			
7	78	67	61	56	76	67	60	56	65	59	55	64	59	55	63	58	55	53			
8	73	63	56	51	72	62	56	51	61	55	51	60	55	51	59	54	50	49			
9	69	58	52	47	68	58	52	47	57	51	47	56	51	47	55	50	47	45			
10	66	55	48	44	65	54	48	44	53	48	44	53	47	44	52	47	43	42			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	57885
5°	58739
10°	60698
15°	63110
20°	63781
25°	60385
30°	54268
35°	43902
40°	30471
45°	18289
50°	11658
55°	7283
60°	4890
65°	3178
70°	1619
75°	911
80°	916
85°	881

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 18289 cd/sqm



TEST NUMBER: P643230

CATALOG NUMBER: ML5615LSVWFL759FS1E - 691WB - 1200LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	102.6	6.5
10°-20°	313.1	19.9
20°-30°	455.2	29.0
30°-40°	403.1	25.6
40°-50°	193.7	12.3
50°-60°	72.1	4.6
60°-70°	24.8	1.6
70°-80°	5.5	0.4
80°-90°	1.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	871.0	55.4
0°-40°	1274.0	81.0
0°-60°	1539.9	98.0
0°-90°	1572.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1572.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1056	
5°	1067	103
15°	1112	313
25°	998	455
35°	656	403
45°	236	194
55°	76	72
65°	24	25
75°	4	6
85°	1	2
90°	0	



TEST NUMBER: P643230

CATALOG NUMBER: ML5615LSVWFL759FS1E - 691WB - 1200LM - 5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1055.9
2.5°	1058.7
5°	1067.4
7.5°	1078.9
10°	1090.4
12.5°	1101.9
15°	1112.0
17.5°	1110.5
20°	1093.3
22.5°	1053.0
25°	998.3
27.5°	935.0
30°	857.3
32.5°	763.8
35°	656.0
37.5°	539.4
40°	425.8
42.5°	320.8
45°	235.9
47.5°	178.4
50°	136.7
52.5°	100.7
55°	76.2
57.5°	57.5
60°	44.6
62.5°	34.5
65°	24.5
67.5°	14.4
70°	10.1
72.5°	5.8
75°	4.3
77.5°	4.3
80°	2.9
82.5°	2.9
85°	1.4
87.5°	1.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)