

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643267

Luminaire Tested: ML5615LSVWFL759FS1E - 692SC - 900LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643267
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-83)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL759FS1E - 692SC - 900LM - 3000K
Description: ML56 RR, 75D TIR OPTIC, 6" SPECULAR CLEAR TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1125.2 lumens
Efficiency: N/A
Efficacy: 107.2 lumens/watt
Spacing Criteria (0/90/45): 1.02 / 1.02 / 1.01
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643267

CATALOG NUMBER: ML5615LSVWFL759FS1E - 692SC - 900LM - 3000K

Luminous Intensity Polar Plot

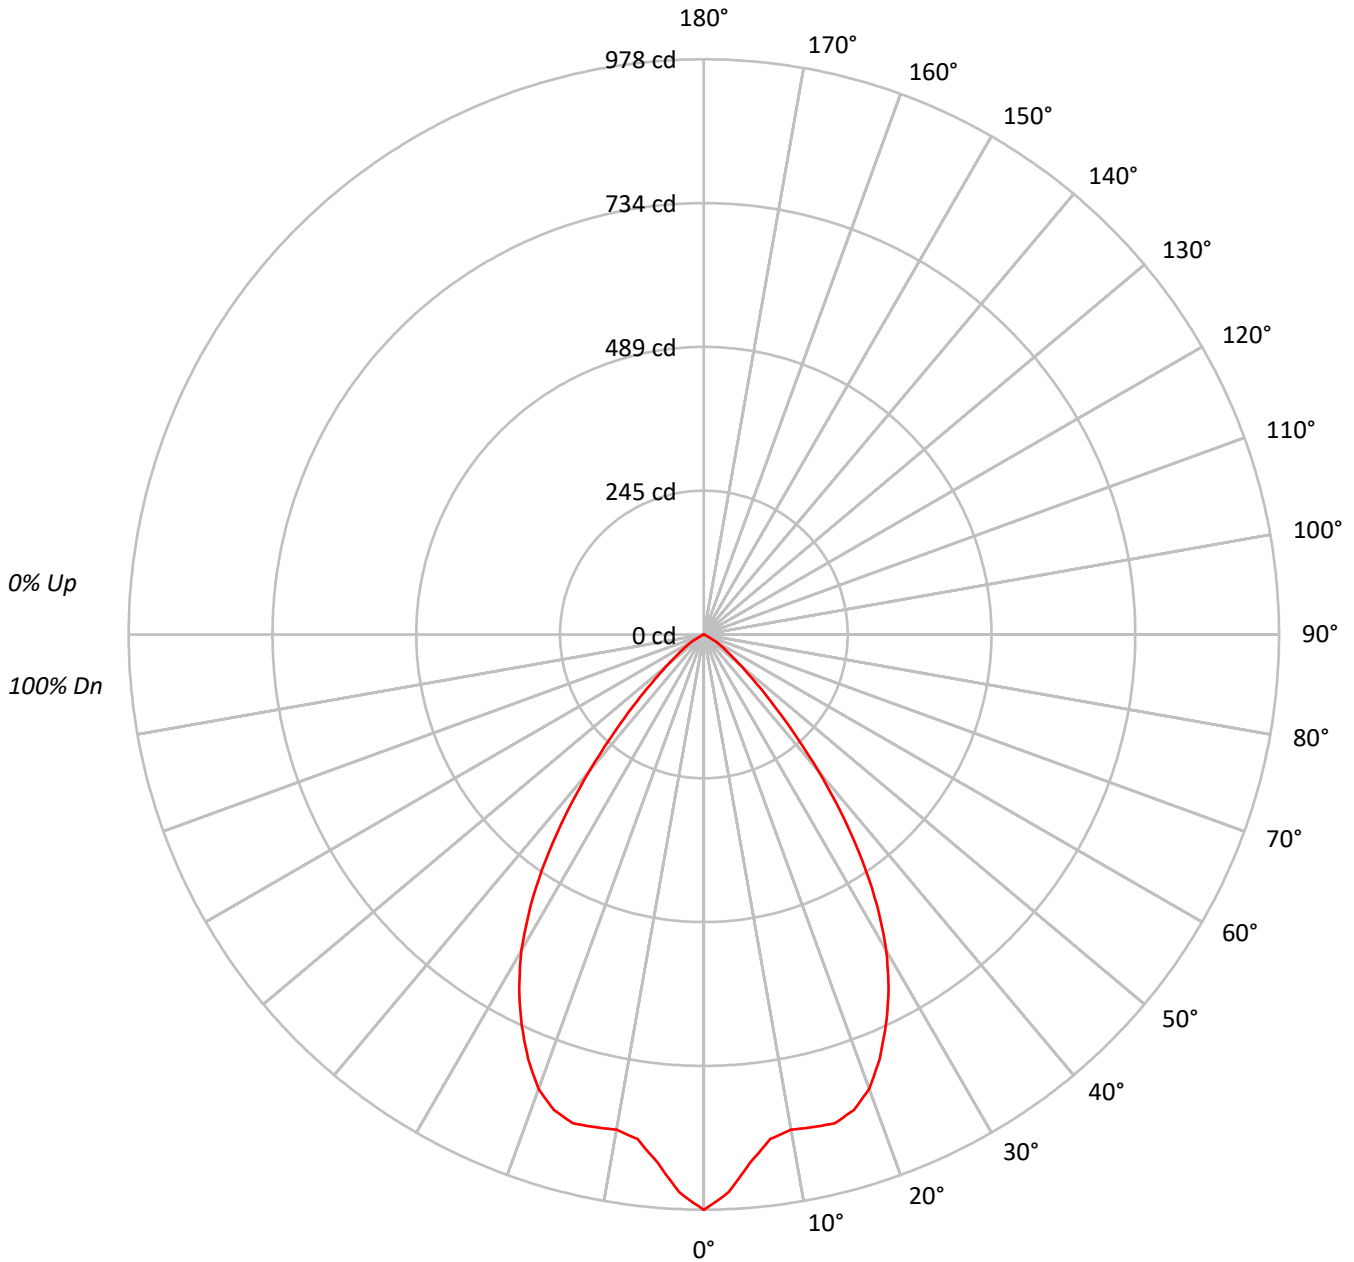



TEST NUMBER: P643267

CATALOG NUMBER: ML5615LSVWFL759FS1E - 692SC - 900LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92	92	92	92
2	107	101	97	93	104	100	96	92	96	93	90	93	91	88	91	88	86	85	85	85	85
3	101	94	88	84	99	92	87	83	89	85	82	87	83	80	85	82	79	78	78	78	78
4	95	86	80	76	93	85	80	75	83	78	74	81	77	73	79	76	73	71	71	71	71
5	89	80	74	69	88	79	73	69	77	72	68	76	71	67	74	70	67	65	65	65	65
6	84	74	68	63	83	74	67	63	72	66	62	70	66	62	69	65	61	60	60	60	60
7	79	69	63	58	78	68	62	58	67	62	57	66	61	57	65	60	57	55	55	55	55
8	75	65	58	53	74	64	58	53	63	57	53	62	57	53	61	56	53	51	51	51	51
9	71	60	54	50	70	60	54	49	59	53	49	58	53	49	57	52	49	47	47	47	47
10	67	57	50	46	66	56	50	46	55	50	46	54	49	46	54	49	46	44	44	44	44

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	53642
5°	49598
10°	47594
15°	48820
20°	47960
25°	44313
30°	39272
35°	31467
40°	21576
45°	12443
50°	6755
55°	4033
60°	2138
65°	532
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12443 cd/sqm



TEST NUMBER: P643267

CATALOG NUMBER: ML5615LSVWFL759FS1E - 692SC - 900LM - 3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	84.6	7.5
10°-20°	240.9	21.4
20°-30°	334.6	29.7
30°-40°	289.2	25.7
40°-50°	130.7	11.6
50°-60°	39.4	3.5
60°-70°	5.9	0.5
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	660.0	58.7
0°-40°	949.2	84.4
0°-60°	1119.4	99.5
0°-90°	1125.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1125.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	978	
5°	901	85
15°	860	241
25°	733	335
35°	470	289
45°	160	131
55°	42	39
65°	4	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P643267

CATALOG NUMBER: ML5615LSVWFL759FS1E - 692SC - 900LM - 3000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	978.5
2.5°	949.7
5°	901.3
7.5°	865.3
10°	855.0
12.5°	858.1
15°	860.2
17.5°	847.8
20°	822.1
22.5°	780.9
25°	732.6
27.5°	680.1
30°	620.4
32.5°	549.4
35°	470.2
37.5°	385.8
40°	301.5
42.5°	223.3
45°	160.5
47.5°	113.2
50°	79.2
52.5°	56.6
55°	42.2
57.5°	29.8
60°	19.5
62.5°	9.3
65°	4.1
67.5°	1.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)