

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643268

Luminaire Tested: ML5615LSVWFL759FS1E - 692SC - 900LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643268
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-83)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL759FS1E - 692SC - 900LM - 3500K
Description: ML56 RR, 75D TIR OPTIC, 6" SPECULAR CLEAR TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1155.9 lumens
Efficiency: N/A
Efficacy: 110.1 lumens/watt
Spacing Criteria (0/90/45): 1.02 / 1.02 / 1.01
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643268
CATALOG NUMBER: ML5615LSVWFL759FS1E - 692SC - 900LM - 3500K

Luminous Intensity Polar Plot

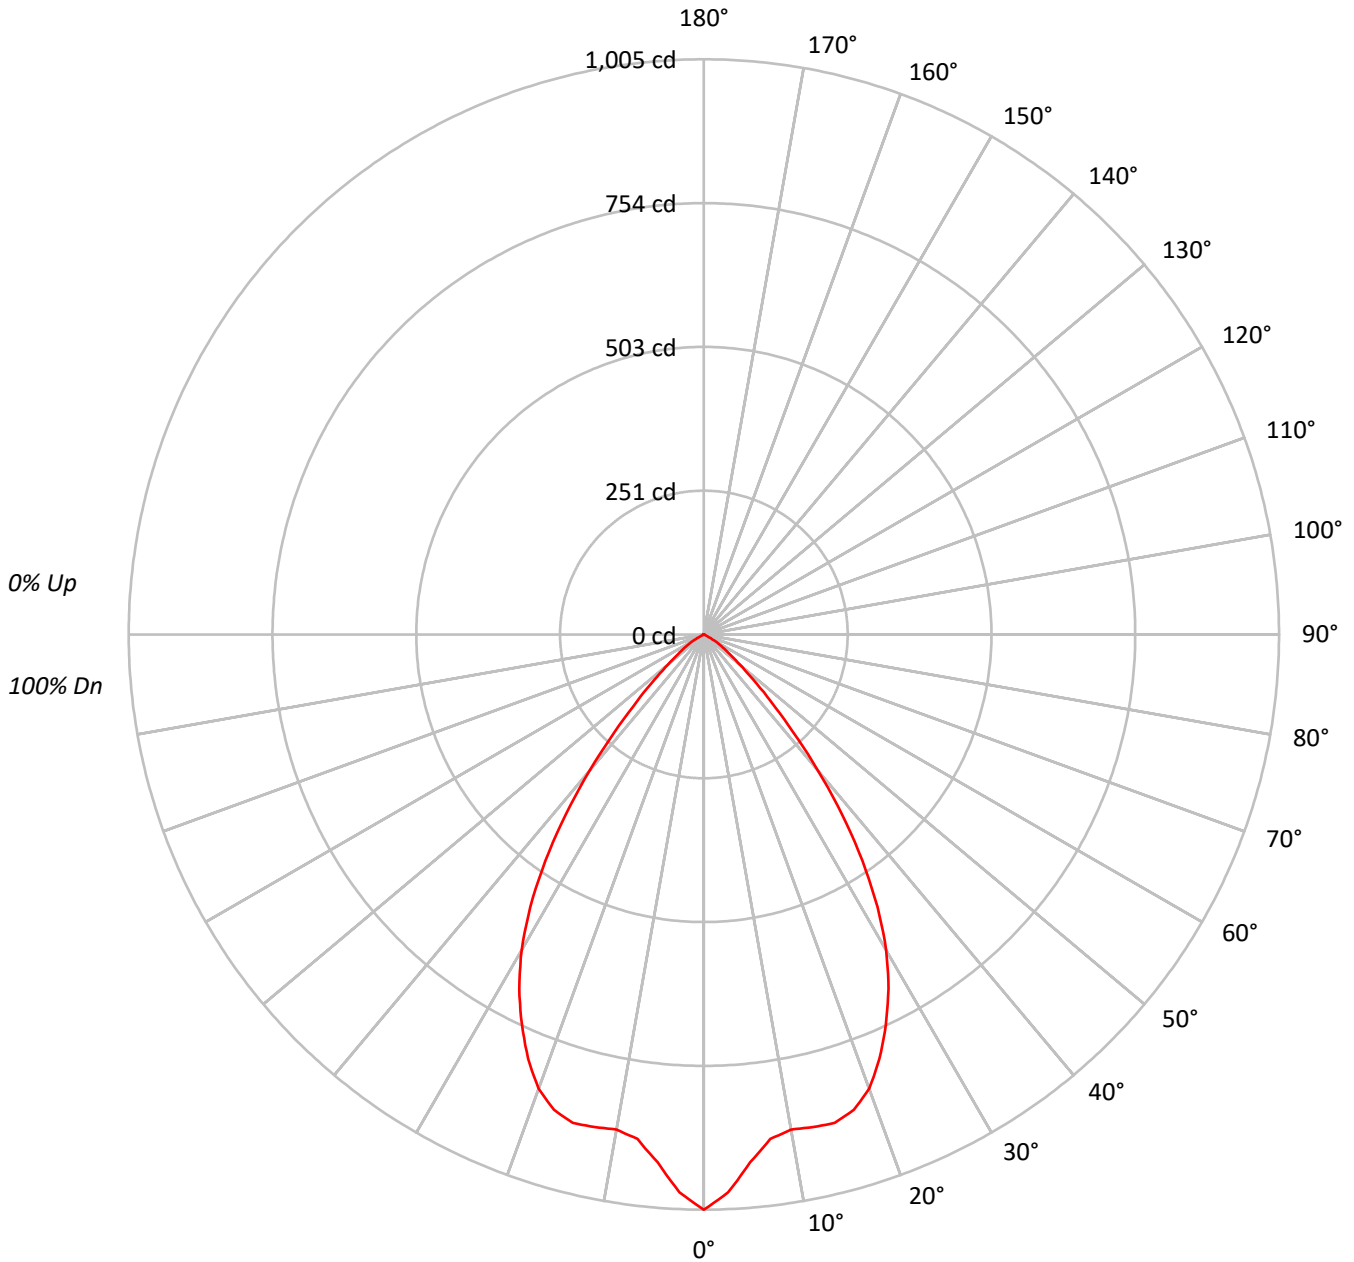



TEST NUMBER: P643268

CATALOG NUMBER: ML5615LSVWFL759FS1E - 692SC - 900LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92	92	92	92
2	107	101	97	93	104	100	96	92	96	93	90	93	91	88	91	88	86	85	85	85	85
3	101	94	88	84	99	92	87	83	89	85	82	87	83	80	85	82	79	78	78	78	78
4	95	86	80	76	93	85	80	75	83	78	74	81	77	73	79	76	73	71	71	71	71
5	89	80	74	69	88	79	73	69	77	72	68	76	71	67	74	70	67	65	65	65	65
6	84	74	68	63	83	74	67	63	72	66	62	70	66	62	69	65	61	60	60	60	60
7	79	69	63	58	78	68	62	58	67	62	57	66	61	57	65	60	57	55	55	55	55
8	75	65	58	53	74	64	58	53	63	57	53	62	57	53	61	56	53	51	51	51	51
9	71	60	54	50	70	60	54	49	59	53	49	58	53	49	57	52	49	47	47	47	47
10	67	57	50	46	66	56	50	46	55	50	46	54	49	46	54	49	46	44	44	44	44

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	55100
5°	50952
10°	48891
15°	50148
20°	49267
25°	45517
30°	40342
35°	32324
40°	22163
45°	12784
50°	6942
55°	4138
60°	2204
65°	545
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12784 cd/sqm



TEST NUMBER: P643268

CATALOG NUMBER: ML5615LSVWFL759FS1E - 692SC - 900LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	86.9	7.5
10°-20°	247.4	21.4
20°-30°	343.7	29.7
30°-40°	297.0	25.7
40°-50°	134.3	11.6
50°-60°	40.5	3.5
60°-70°	6.0	0.5
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	678.0	58.7
0°-40°	975.0	84.4
0°-60°	1149.8	99.5
0°-90°	1155.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1155.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1005	
5°	926	87
15°	884	247
25°	752	344
35°	483	297
45°	165	134
55°	43	41
65°	4	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P643268

CATALOG NUMBER: ML5615LSVWFL759FS1E - 692SC - 900LM - 3500K

CANDELA DISTRIBUTION (FULL):

	0°
0°	1005.1
2.5°	975.5
5°	925.9
7.5°	888.9
10°	878.3
12.5°	881.5
15°	883.6
17.5°	870.9
20°	844.5
22.5°	802.2
25°	752.5
27.5°	698.6
30°	637.3
32.5°	564.4
35°	483.0
37.5°	396.3
40°	309.7
42.5°	229.3
45°	164.9
47.5°	116.3
50°	81.4
52.5°	58.1
55°	43.3
57.5°	30.7
60°	20.1
62.5°	9.5
65°	4.2
67.5°	1.1
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)