

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643375

Luminaire Tested: ML5615LSVWFL759FS1E - 694WB - 900LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643375
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-90)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL759FS1E - 694WB - 900LM - 5000K
Description: ML56 RR, 75D TIR OPTIC, 6" WHITE GIMBAL TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1255.5 lumens
Efficiency: N/A
Efficacy: 119.6 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.08
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643375
CATALOG NUMBER: ML5615LSVWFL759FS1E - 694WB - 900LM - 5000K

Luminous Intensity Polar Plot

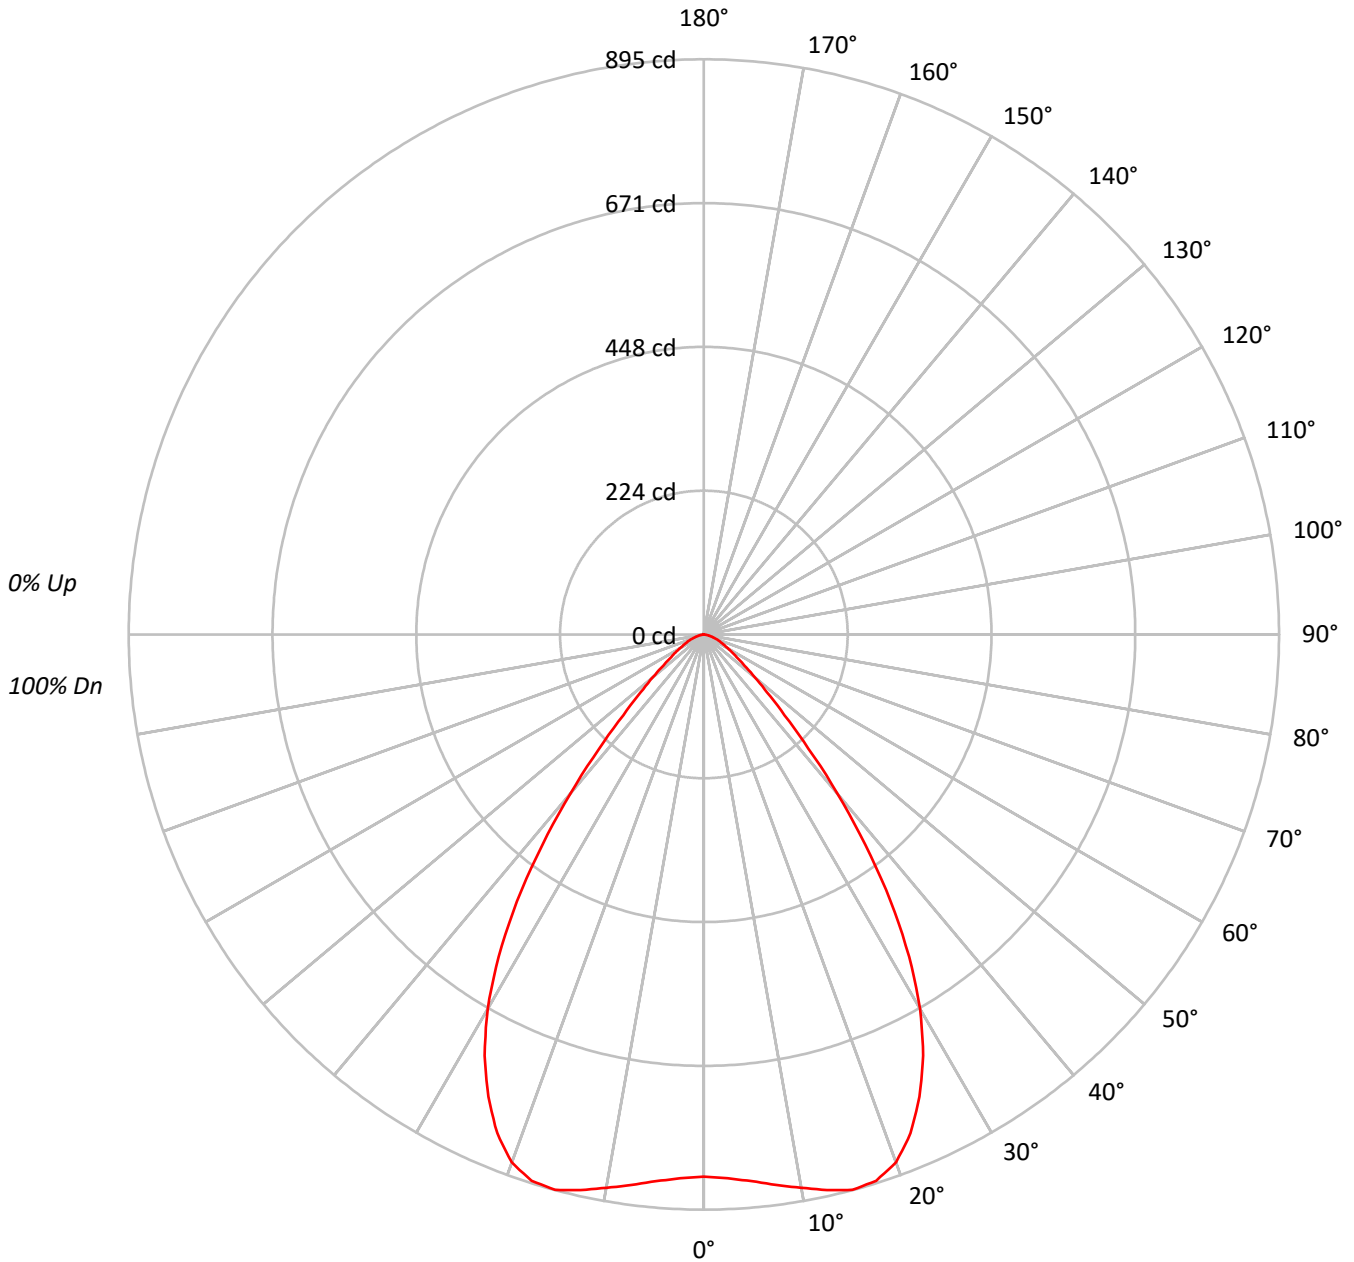



TEST NUMBER: P643375

CATALOG NUMBER: ML5615LSVWFL759FS1E - 694WB - 900LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	104	110	107	104	102	103	101	99	99	98	96	96	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83			
3	99	92	86	81	97	90	85	81	88	83	79	85	81	78	83	80	77	75			
4	93	84	78	73	91	83	77	73	81	76	72	79	74	71	77	73	70	68			
5	88	78	71	66	86	77	71	66	75	69	65	73	68	65	72	67	64	62			
6	82	72	65	60	81	71	65	60	70	64	60	68	63	59	67	62	59	57			
7	78	67	60	55	76	66	60	55	65	59	55	64	58	54	62	58	54	53			
8	73	62	56	51	72	62	55	51	61	55	50	59	54	50	58	54	50	48			
9	69	58	51	47	68	58	51	47	57	51	47	56	50	47	55	50	46	45			
10	65	54	48	44	64	54	48	44	53	47	43	52	47	43	52	47	43	42			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	46241
5°	46979
10°	48663
15°	50772
20°	50999
25°	47997
30°	42601
35°	33930
40°	23100
45°	13746
50°	8818
55°	6088
60°	4736
65°	3840
70°	3093
75°	2415
80°	1421
85°	692

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13746 cd/sqm



TEST NUMBER: P643375

CATALOG NUMBER: ML5615LSVWFL759FS1E - 694WB - 900LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	82.2	6.5
10°-20°	251.3	20.0
20°-30°	361.3	28.8
30°-40°	311.6	24.8
40°-50°	145.7	11.6
50°-60°	59.8	4.8
60°-70°	29.9	2.4
70°-80°	12.1	1.0
80°-90°	1.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	694.8	55.3
0°-40°	1006.5	80.2
0°-60°	1212.0	96.5
0°-90°	1255.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1255.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	844	
5°	854	82
15°	895	251
25°	794	361
35°	507	312
45°	177	146
55°	64	60
65°	30	30
75°	11	12
85°	1	2
90°	0	



TEST NUMBER: P643375

CATALOG NUMBER: ML5615LSVWFL759FS1E - 694WB - 900LM - 5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	843.5
2.5°	846.9
5°	853.7
7.5°	863.9
10°	874.2
12.5°	885.5
15°	894.6
17.5°	891.2
20°	874.2
22.5°	840.1
25°	793.5
27.5°	738.9
30°	673.0
32.5°	594.5
35°	507.0
37.5°	412.6
40°	322.8
42.5°	241.0
45°	177.3
47.5°	133.0
50°	103.4
52.5°	79.6
55°	63.7
57.5°	52.3
60°	43.2
62.5°	35.2
65°	29.6
67.5°	25.0
70°	19.3
72.5°	14.8
75°	11.4
77.5°	8.0
80°	4.5
82.5°	2.3
85°	1.1
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)