

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643390

Luminaire Tested: ML5615LSVWFL759FS1E - 696WB - 900LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643390
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-92)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL759FS1E - 696WB - 900LM - 5000K
Description: ML56 RR, 75D TIR OPTIC, 6" SHALLOW WHITE BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1247.6 lumens
Efficiency: N/A
Efficacy: 118.8 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.09
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643390

CATALOG NUMBER: ML5615LSVWFL759FS1E - 696WB - 900LM - 5000K

Luminous Intensity Polar Plot

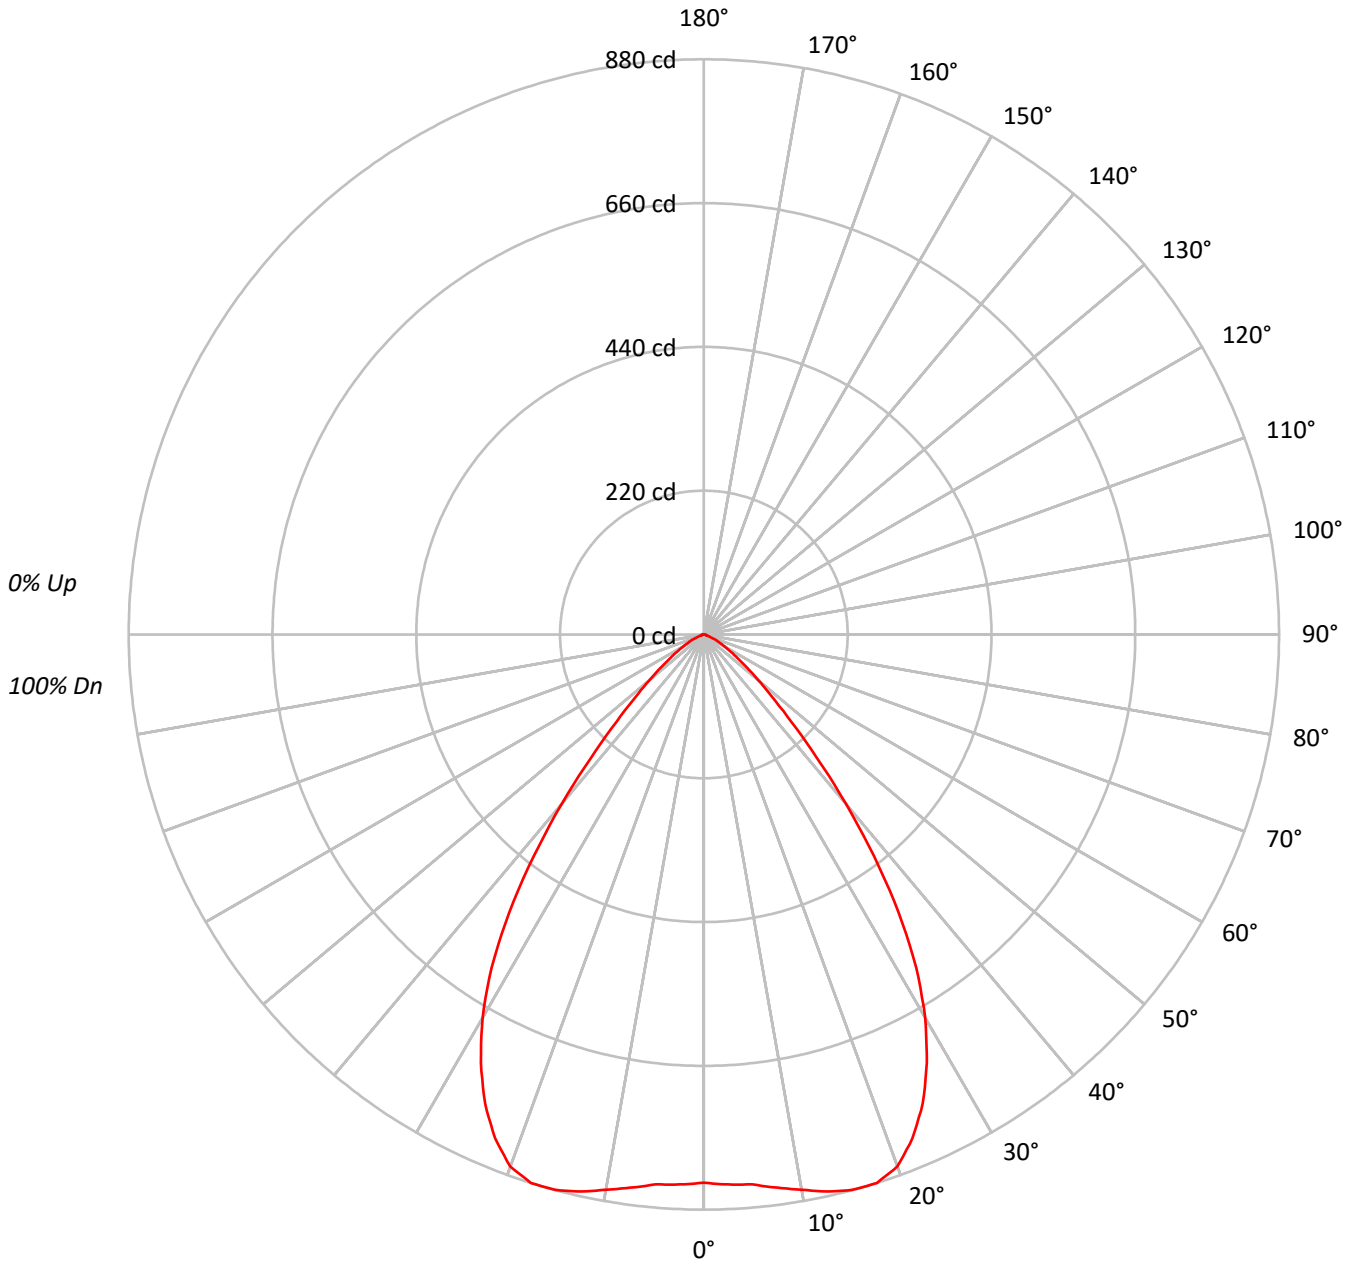



TEST NUMBER: P643390

CATALOG NUMBER: ML5615LSVWFL759FS1E - 696WB - 900LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	107	104	110	107	105	103	103	101	99	99	98	96	96	95	94	92			
2	106	100	96	92	104	99	94	91	95	92	89	92	89	87	90	87	85	83			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	77	76			
4	94	85	79	74	92	84	78	73	81	76	72	79	75	71	77	74	71	69			
5	88	78	72	67	86	77	71	66	75	70	66	74	69	65	72	68	65	63			
6	83	73	66	61	81	72	65	61	70	64	60	69	64	60	67	63	59	58			
7	78	67	60	56	76	67	60	55	65	59	55	64	59	55	63	58	55	53			
8	73	63	56	51	72	62	56	51	61	55	51	60	54	51	59	54	50	49			
9	69	58	52	47	68	58	52	47	57	51	47	56	51	47	55	50	47	45			
10	66	55	48	44	64	54	48	44	53	48	44	52	47	43	52	47	43	42			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	45983
5°	46472
10°	48023
15°	49932
20°	50527
25°	47918
30°	42880
35°	34760
40°	24160
45°	14629
50°	9305
55°	5974
60°	3991
65°	2659
70°	1282
75°	720
80°	726
85°	692

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 14629 cd/sqm



TEST NUMBER: P643390

CATALOG NUMBER: ML5615LSVWFL759FS1E - 696WB - 900LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	81.3	6.5
10°-20°	247.9	19.9
20°-30°	360.4	28.9
30°-40°	319.1	25.6
40°-50°	154.1	12.4
50°-60°	58.8	4.7
60°-70°	20.3	1.6
70°-80°	4.0	0.3
80°-90°	1.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	689.6	55.3
0°-40°	1008.8	80.9
0°-60°	1221.7	97.9
0°-90°	1247.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1247.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	839	
5°	844	81
15°	880	248
25°	792	360
35°	519	319
45°	189	154
55°	62	59
65°	20	20
75°	3	4
85°	1	2
90°	0	



TEST NUMBER: P643390

CATALOG NUMBER: ML5615LSVWFL759FS1E - 696WB - 900LM - 5000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	838.8
2.5°	842.3
5°	844.5
7.5°	853.6
10°	862.7
12.5°	872.9
15°	879.8
17.5°	879.8
20°	866.1
22.5°	834.3
25°	792.2
27.5°	738.8
30°	677.4
32.5°	604.7
35°	519.4
37.5°	427.4
40°	337.6
42.5°	255.7
45°	188.7
47.5°	140.9
50°	109.1
52.5°	83.0
55°	62.5
57.5°	46.6
60°	36.4
62.5°	27.3
65°	20.5
67.5°	12.5
70°	8.0
72.5°	4.5
75°	3.4
77.5°	2.3
80°	2.3
82.5°	2.3
85°	1.1
87.5°	1.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)