

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643575

Luminaire Tested: ML5615LSVWFL9FS1E - 691WB - 1200LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643575
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-105)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL9FS1E - 691WB - 1200LM - 5000K
Description: ML56 RR, MILKY OPTIC, 6" DEADFRONT TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1511.7 lumens
Efficiency: N/A
Efficacy: 112.8 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.28
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643575
CATALOG NUMBER: ML5615LSVWFL9FS1E - 691WB - 1200LM - 5000K

Luminous Intensity Polar Plot

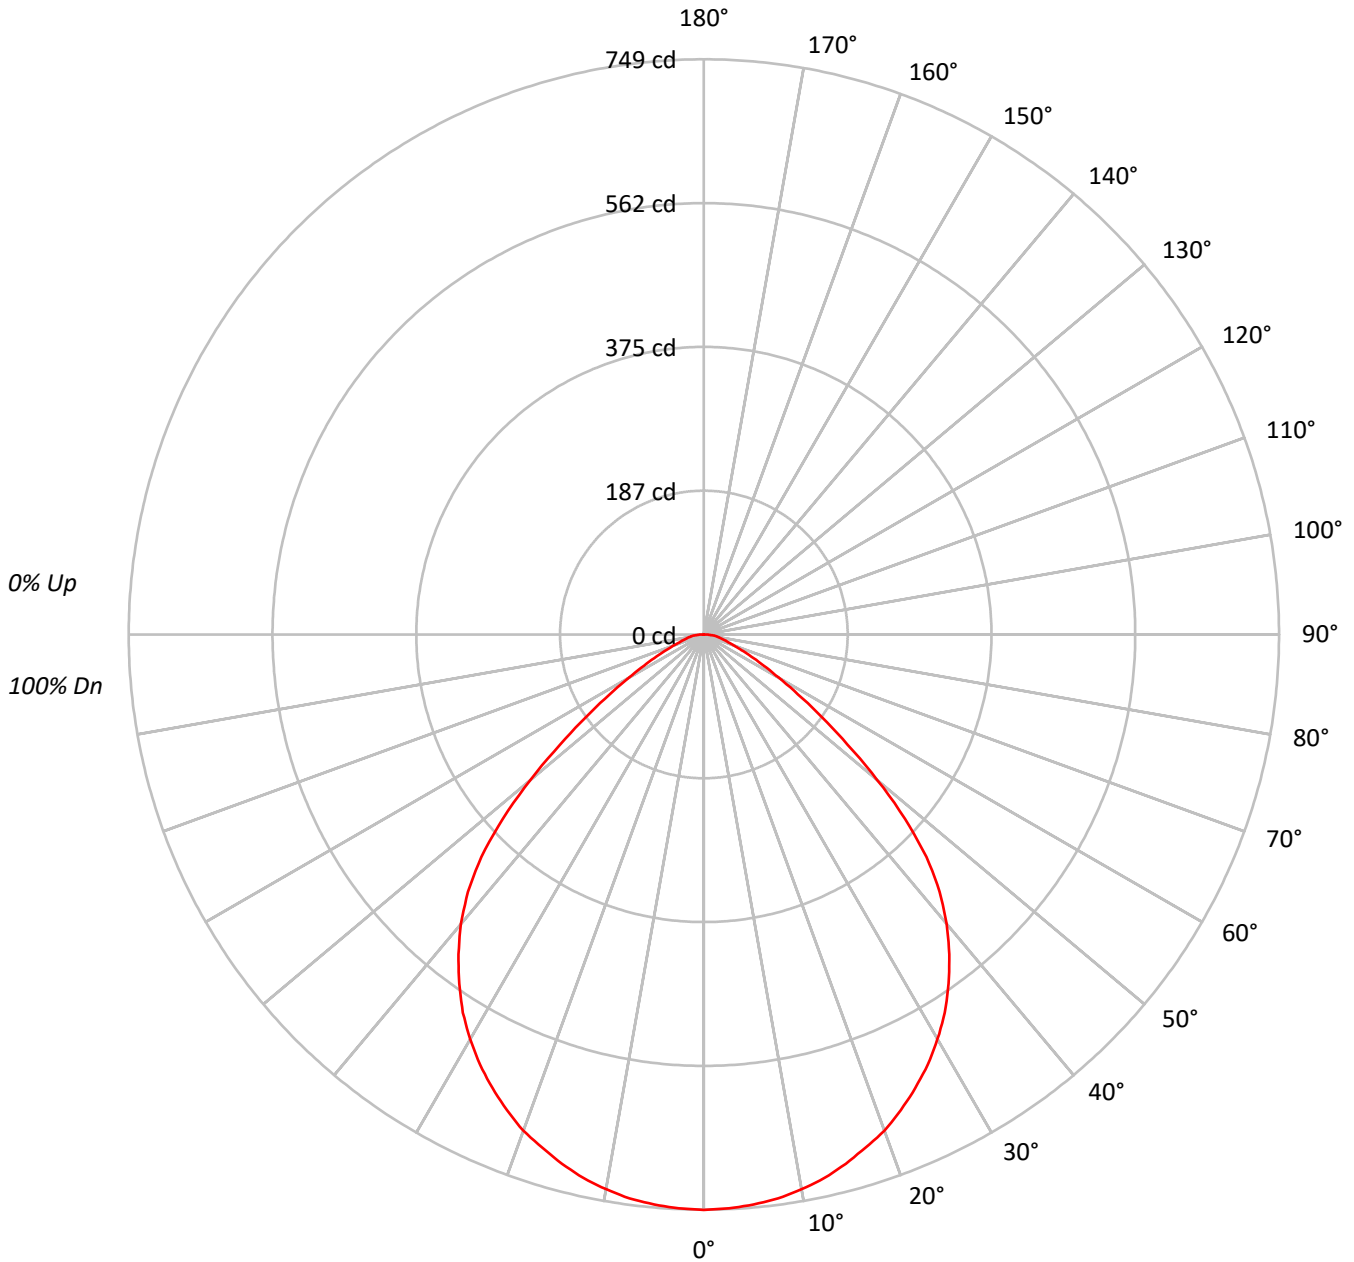



TEST NUMBER: P643575

CATALOG NUMBER: ML5615LSVWFL9FS1E - 691WB - 1200LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	89			
2	103	96	91	86	101	94	89	85	91	87	83	88	84	81	85	82	80	78			
3	95	87	80	74	93	85	79	74	82	77	72	80	75	71	77	73	70	68			
4	88	78	71	65	86	77	70	64	75	68	64	72	67	63	70	66	62	60			
5	82	71	63	57	80	70	62	57	68	61	56	66	60	56	64	59	55	53			
6	76	65	57	51	75	64	56	51	62	55	50	60	54	50	59	54	50	48			
7	71	59	51	46	70	58	51	46	57	50	45	55	49	45	54	49	45	43			
8	67	54	47	41	65	54	46	41	52	46	41	51	45	41	50	45	40	39			
9	62	50	43	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35			
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	41082
5°	41003
10°	40836
15°	40494
20°	40113
25°	39414
30°	38519
35°	37162
40°	35209
45°	31786
50°	25151
55°	17873
60°	12302
65°	8769
70°	6684
75°	5782
80°	5904
85°	6353

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 31786 cd/sqm



TEST NUMBER: P643575

CATALOG NUMBER: ML5615LSVWFL9FS1E - 691WB - 1200LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	70.8	4.7
10°-20°	201.3	13.3
20°-30°	300.0	19.8
30°-40°	346.4	22.9
40°-50°	310.3	20.5
50°-60°	171.5	11.3
60°-70°	70.4	4.7
70°-80°	30.0	2.0
80°-90°	11.2	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	572.0	37.8
0°-40°	918.4	60.8
0°-60°	1400.2	92.6
0°-90°	1511.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1511.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	749	
5°	745	71
15°	714	201
25°	652	300
35°	555	346
45°	410	310
55°	187	172
65°	68	70
75°	27	30
85°	10	11
90°	0	



TEST NUMBER: P643575
CATALOG NUMBER: ML5615LSVWFL9FS1E - 691WB - 1200LM - 5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	749.4
2.5°	748.0
5°	745.1
7.5°	740.8
10°	733.6
12.5°	725.0
15°	713.5
17.5°	700.5
20°	687.6
22.5°	670.3
25°	651.6
27.5°	631.5
30°	608.5
32.5°	584.0
35°	555.3
37.5°	525.0
40°	492.0
42.5°	454.6
45°	410.0
47.5°	355.3
50°	294.9
52.5°	235.9
55°	187.0
57.5°	145.3
60°	112.2
62.5°	87.7
65°	67.6
67.5°	53.2
70°	41.7
72.5°	33.1
75°	27.3
77.5°	23.0
80°	18.7
82.5°	15.8
85°	10.1
87.5°	5.8
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)