

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643585

Luminaire Tested: ML5615LSVWFL9FS1E - 691WB - 900LM - 5000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643585
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-105)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL9FS1E - 691WB - 900LM - 5000K
Description: ML56 RR, MILKY OPTIC, 6" DEADFRONT TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1195.3 lumens
Efficiency: N/A
Efficacy: 113.8 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.28
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643585

CATALOG NUMBER: ML5615LSVWFL9FS1E - 691WB - 900LM - 5000K

Luminous Intensity Polar Plot

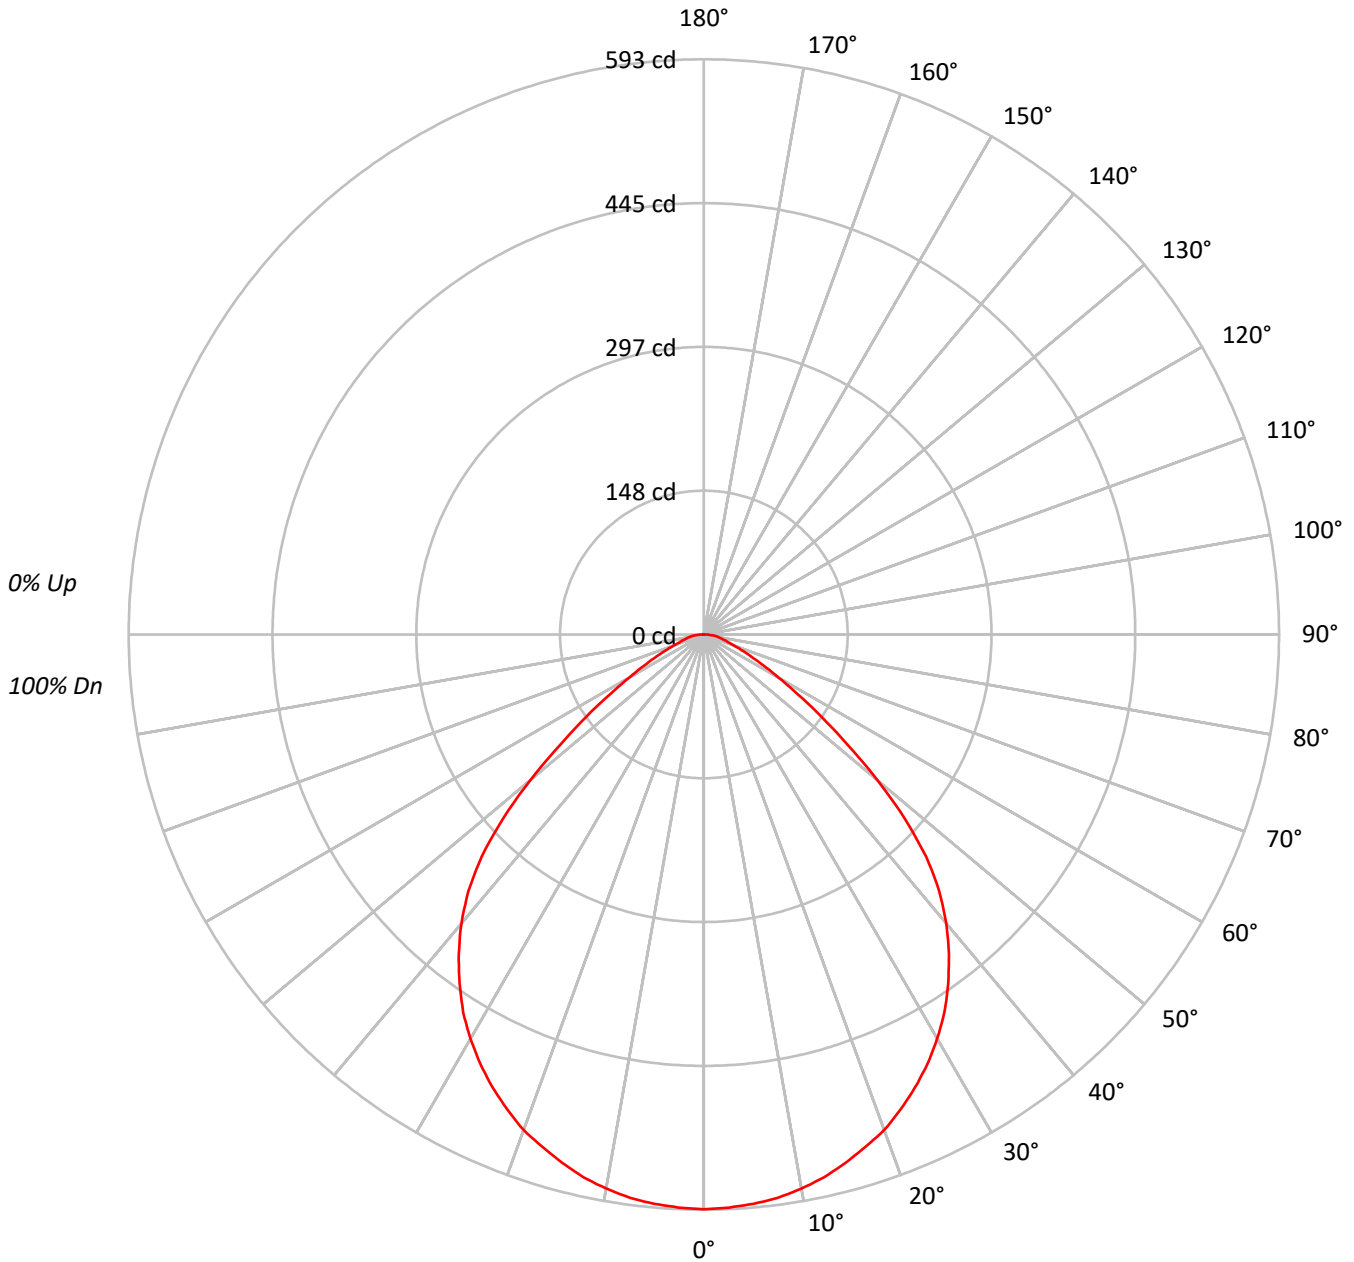



TEST NUMBER: P643585

CATALOG NUMBER: ML5615LSVWFL9FS1E - 691WB - 900LM - 5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	89			
2	103	96	91	86	101	94	89	85	91	87	83	88	84	81	85	82	80	78			
3	95	87	80	74	93	85	79	74	82	77	72	80	75	71	77	73	70	68			
4	88	78	71	65	86	77	70	64	75	68	64	72	67	63	70	66	62	60			
5	82	71	63	57	80	70	62	57	68	61	56	66	60	56	64	59	55	53			
6	76	65	57	51	75	64	56	51	62	55	50	60	54	50	59	54	50	48			
7	71	59	51	46	70	58	51	46	57	50	45	55	49	45	54	49	45	43			
8	67	54	47	41	65	54	46	41	52	46	41	51	45	41	50	45	40	39			
9	62	50	43	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35			
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	32486
5°	32423
10°	32292
15°	32015
20°	31719
25°	31163
30°	30454
35°	29379
40°	27838
45°	25127
50°	19888
55°	14136
60°	9725
65°	6940
70°	5289
75°	4575
80°	4672
85°	5032

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 25127 cd/sqm



TEST NUMBER: P643585

CATALOG NUMBER: ML5615LSVWFL9FS1E - 691WB - 900LM - 5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	56.0	4.7
10°-20°	159.1	13.3
20°-30°	237.2	19.8
30°-40°	273.9	22.9
40°-50°	245.3	20.5
50°-60°	135.6	11.3
60°-70°	55.7	4.7
70°-80°	23.7	2.0
80°-90°	8.8	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	452.3	37.8
0°-40°	726.1	60.7
0°-60°	1107.1	92.6
0°-90°	1195.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1195.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	593	
5°	589	56
15°	564	159
25°	515	237
35°	439	274
45°	324	245
55°	148	136
65°	54	56
75°	22	24
85°	8	9
90°	0	



TEST NUMBER: P643585

CATALOG NUMBER: ML5615LSVWFL9FS1E - 691WB - 900LM - 5000K

CANDELA DISTRIBUTION (FULL):

	0°
0°	592.6
2.5°	591.4
5°	589.2
7.5°	585.7
10°	580.1
12.5°	573.2
15°	564.1
17.5°	553.9
20°	543.7
22.5°	530.0
25°	515.2
27.5°	499.3
30°	481.1
32.5°	461.8
35°	439.0
37.5°	415.1
40°	389.0
42.5°	359.4
45°	324.1
47.5°	280.9
50°	233.2
52.5°	186.5
55°	147.9
57.5°	114.9
60°	88.7
62.5°	69.4
65°	53.5
67.5°	42.1
70°	33.0
72.5°	26.2
75°	21.6
77.5°	18.2
80°	14.8
82.5°	12.5
85°	8.0
87.5°	4.5
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)