

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643617

Luminaire Tested: ML5615LSVWFL9FS1E - 692W - 1200LM - 3000K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643617
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-108)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL9FS1E - 692W - 1200LM - 3000K
Description: ML56 RR, MILKY OPTIC, 6" WHITE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1317.8 lumens
Efficiency: N/A
Efficacy: 98.3 lumens/watt
Spacing Criteria (0/90/45): 1.15 / 1.15 / 1.2
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 13.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643617

CATALOG NUMBER: ML5615LSVWFL9FS1E - 692W - 1200LM - 3000K

Luminous Intensity Polar Plot

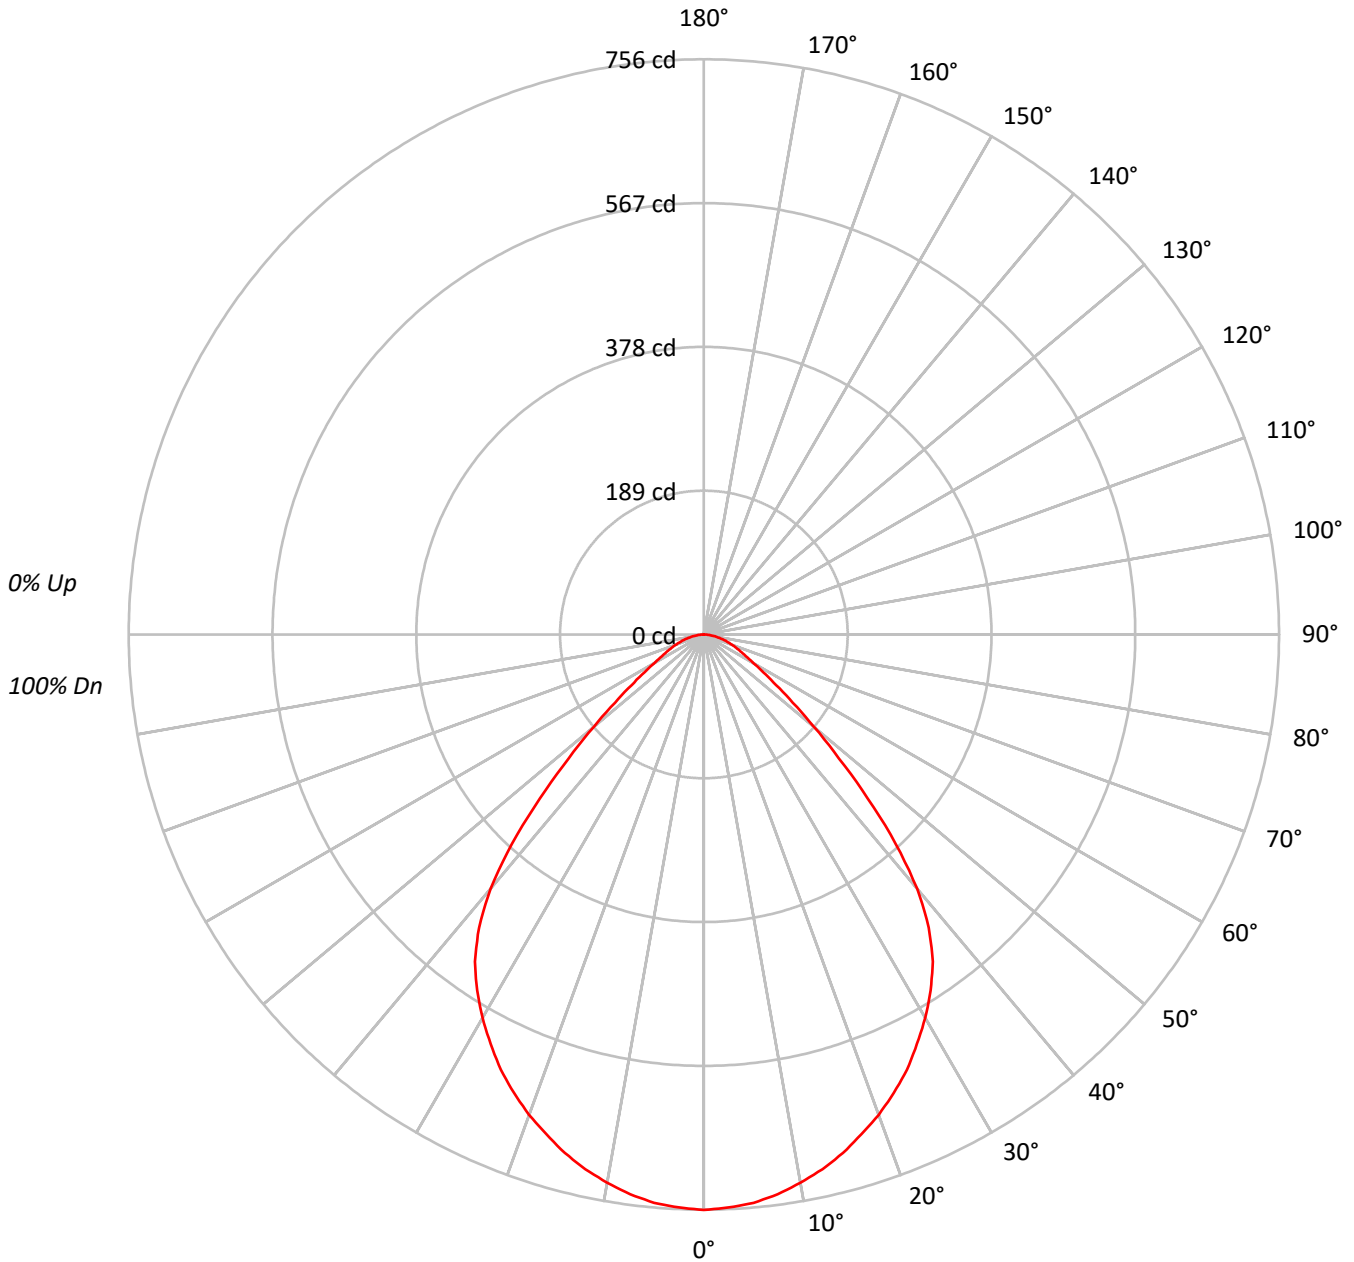



TEST NUMBER: P643617

CATALOG NUMBER: ML5615LSVWFL9FS1E - 692W - 1200LM - 3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 111 | 108 | 105 | 102 | 109 | 106 | 103 | 100 | 101 | 99 | 97 | 98 | 96 | 94 | 94 | 93 | 91 | 89 | | | | | | | | | | | | | | | | | | | |
| 2 | 104 | 97 | 92 | 87 | 101 | 95 | 91 | 86 | 92 | 88 | 84 | 89 | 86 | 83 | 86 | 83 | 81 | 79 | | | | | | | | | | | | | | | | | | | |
| 3 | 96 | 88 | 81 | 76 | 94 | 87 | 80 | 76 | 84 | 79 | 74 | 81 | 77 | 73 | 79 | 75 | 72 | 70 | | | | | | | | | | | | | | | | | | | |
| 4 | 90 | 80 | 73 | 67 | 88 | 79 | 72 | 67 | 76 | 71 | 66 | 74 | 69 | 65 | 72 | 68 | 64 | 63 | | | | | | | | | | | | | | | | | | | |
| 5 | 84 | 73 | 65 | 60 | 82 | 72 | 65 | 60 | 70 | 64 | 59 | 68 | 63 | 58 | 66 | 62 | 58 | 56 | | | | | | | | | | | | | | | | | | | |
| 6 | 78 | 67 | 59 | 54 | 76 | 66 | 59 | 54 | 64 | 58 | 53 | 63 | 57 | 53 | 61 | 56 | 52 | 50 | | | | | | | | | | | | | | | | | | | |
| 7 | 73 | 61 | 54 | 49 | 72 | 61 | 53 | 48 | 59 | 53 | 48 | 58 | 52 | 48 | 57 | 51 | 47 | 46 | | | | | | | | | | | | | | | | | | | |
| 8 | 69 | 57 | 49 | 44 | 67 | 56 | 49 | 44 | 55 | 48 | 44 | 54 | 48 | 44 | 53 | 47 | 43 | 42 | | | | | | | | | | | | | | | | | | | |
| 9 | 64 | 52 | 45 | 40 | 63 | 52 | 45 | 40 | 51 | 45 | 40 | 50 | 44 | 40 | 49 | 44 | 40 | 38 | | | | | | | | | | | | | | | | | | | |
| 10 | 61 | 49 | 42 | 37 | 59 | 48 | 42 | 37 | 47 | 41 | 37 | 47 | 41 | 37 | 46 | 40 | 37 | 35 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | 0° |
|-----|-------|
| 0° | 41466 |
| 5° | 41267 |
| 10° | 40731 |
| 15° | 40046 |
| 20° | 39192 |
| 25° | 38192 |
| 30° | 36835 |
| 35° | 35115 |
| 40° | 31208 |
| 45° | 23615 |
| 50° | 16102 |
| 55° | 11077 |
| 60° | 8278 |
| 65° | 6927 |
| 70° | 6267 |
| 75° | 5782 |
| 80° | 4925 |
| 85° | 4088 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 23615 cd/sqm



TEST NUMBER: P643617

CATALOG NUMBER: ML5615LSVWFL9FS1E - 692W - 1200LM - 3000K

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 71.0 | 5.4 |
| 10°-20° | 198.7 | 15.1 |
| 20°-30° | 290.1 | 22.0 |
| 30°-40° | 324.0 | 24.6 |
| 40°-50° | 235.7 | 17.9 |
| 50°-60° | 108.4 | 8.2 |
| 60°-70° | 54.1 | 4.1 |
| 70°-80° | 28.5 | 2.2 |
| 80°-90° | 7.4 | 0.6 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 559.7 | 42.5 |
| 0°-40° | 883.7 | 67.1 |
| 0°-60° | 1227.8 | 93.2 |
| 0°-90° | 1317.8 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1317.8 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-----|------|
| 0° | 756 | |
| 5° | 750 | 71 |
| 15° | 706 | 199 |
| 25° | 631 | 290 |
| 35° | 525 | 324 |
| 45° | 305 | 236 |
| 55° | 116 | 108 |
| 65° | 53 | 54 |
| 75° | 27 | 28 |
| 85° | 6 | 7 |
| 90° | 0 | |



TEST NUMBER: P643617

CATALOG NUMBER: ML5615LSVWFL9FS1E - 692W - 1200LM - 3000K

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|-------|
| 0° | 756.4 |
| 2.5° | 753.8 |
| 5° | 749.9 |
| 7.5° | 742.1 |
| 10° | 731.7 |
| 12.5° | 719.9 |
| 15° | 705.6 |
| 17.5° | 688.7 |
| 20° | 671.8 |
| 22.5° | 652.2 |
| 25° | 631.4 |
| 27.5° | 606.7 |
| 30° | 581.9 |
| 32.5° | 554.6 |
| 35° | 524.7 |
| 37.5° | 485.6 |
| 40° | 436.1 |
| 42.5° | 373.6 |
| 45° | 304.6 |
| 47.5° | 240.8 |
| 50° | 188.8 |
| 52.5° | 147.1 |
| 55° | 115.9 |
| 57.5° | 92.4 |
| 60° | 75.5 |
| 62.5° | 62.5 |
| 65° | 53.4 |
| 67.5° | 45.6 |
| 70° | 39.1 |
| 72.5° | 32.5 |
| 75° | 27.3 |
| 77.5° | 20.8 |
| 80° | 15.6 |
| 82.5° | 10.4 |
| 85° | 6.5 |
| 87.5° | 2.6 |
| 90° | 0.0 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)