

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: HALO

Report Number: P643673

Luminaire Tested: ML5615LSVWFL9FS1E - 693TBZB - 900LM - 3500K

Issue Date: 2/17/2023

Test Information

Test Method: LM-79-2019
Report Number: P643673
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2212-866-112)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/17/2023
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: HALO
Catalog Number: ML5615LSVWFL9FS1E - 693TBZB - 900LM - 3500K
Description: ML56 RR, MILKY OPTIC, 6" TUSCON BRONZE BAFFLE TRIM
Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 859.8 lumens
Efficiency: N/A
Efficacy: 81.9 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.21
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 10.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P643673
CATALOG NUMBER: ML5615LSVWFL9FS1E - 693TBZB - 900LM - 3500K

Luminous Intensity Polar Plot

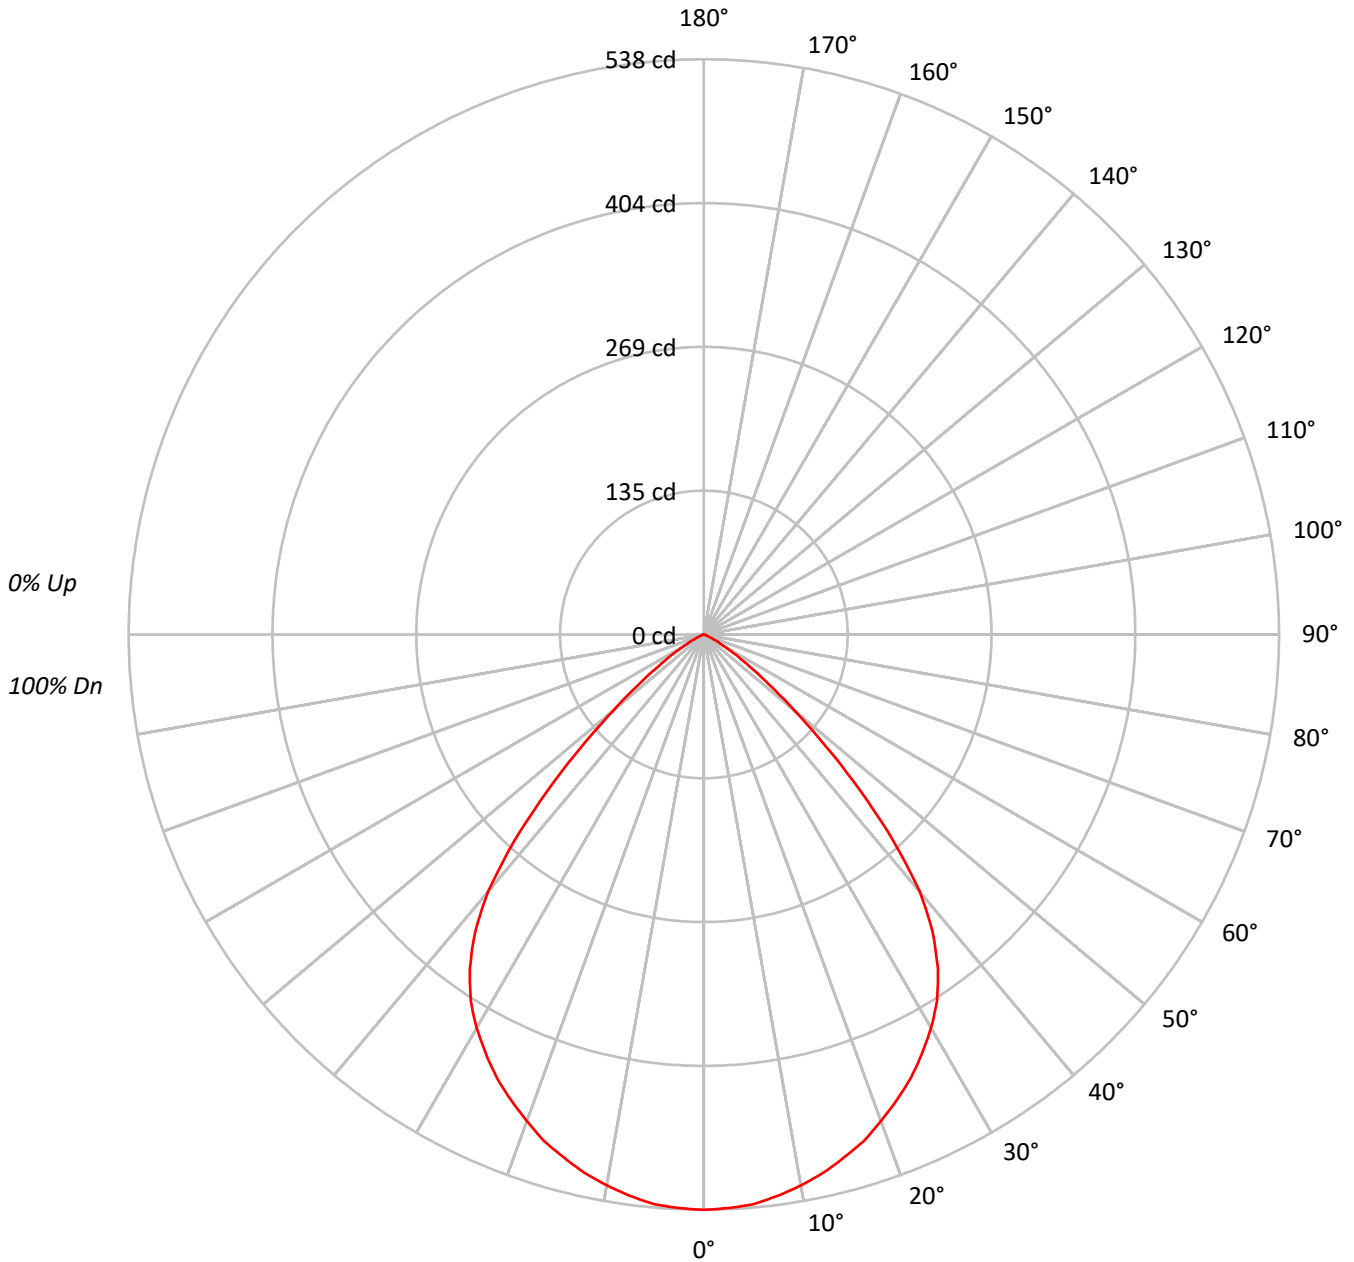



TEST NUMBER: P643673

CATALOG NUMBER: ML5615LSVWFL9FS1E - 693TBZB - 900LM - 3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	112	109	106	104	110	107	104	102	103	101	99	99	98	96	96	94	93	91					91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	86	84	82					82			
3	99	91	85	80	97	90	84	80	87	82	78	84	80	77	82	79	76	74					74			
4	92	83	77	72	90	82	76	71	80	75	70	78	73	69	76	72	69	67					67			
5	86	76	69	64	85	75	69	64	73	68	63	72	67	63	70	66	62	60					60			
6	81	70	63	58	79	69	63	58	68	62	57	66	61	57	65	60	56	55					55			
7	76	65	58	53	74	64	57	52	63	57	52	61	56	52	60	55	52	50					50			
8	71	60	53	48	70	59	53	48	58	52	48	57	51	47	56	51	47	46					46			
9	67	56	49	44	66	55	48	44	54	48	44	53	47	43	52	47	43	42					42			
10	63	52	45	40	62	51	45	40	50	44	40	49	44	40	49	44	40	38					38			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	29499
5°	29435
10°	29130
15°	28740
20°	28247
25°	27691
30°	26903
35°	25538
40°	22471
45°	16064
50°	9373
55°	4951
60°	2313
65°	960
70°	337
75°	233
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16064 cd/sqm



TEST NUMBER: P643673

CATALOG NUMBER: ML5615LSVWFL9FS1E - 693TBZB - 900LM - 3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	50.7	5.9
10°-20°	142.8	16.6
20°-30°	210.5	24.5
30°-40°	235.7	27.4
40°-50°	159.8	18.6
50°-60°	50.7	5.9
60°-70°	8.5	1.0
70°-80°	1.1	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	403.9	47.0
0°-40°	639.6	74.4
0°-60°	850.1	98.9
0°-90°	859.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	859.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	538	
5°	535	51
15°	506	143
25°	458	210
35°	382	236
45°	207	160
55°	52	51
65°	7	9
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P643673

CATALOG NUMBER: ML5615LSVWFL9FS1E - 693TBZB - 900LM - 3500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	538.1
2.5°	537.0
5°	534.9
7.5°	529.6
10°	523.3
12.5°	515.9
15°	506.4
17.5°	496.9
20°	484.2
22.5°	471.5
25°	457.8
27.5°	441.9
30°	425.0
32.5°	406.0
35°	381.6
37.5°	352.0
40°	314.0
42.5°	263.2
45°	207.2
47.5°	154.3
50°	109.9
52.5°	77.2
55°	51.8
57.5°	34.9
60°	21.1
62.5°	12.7
65°	7.4
67.5°	3.2
70°	2.1
72.5°	1.1
75°	1.1
77.5°	1.1
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)